INCH-POUND

MIL-DTL-17361/9B(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/9A(SH)
17 August 1994

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPES AQB-L400 QF, QM

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Instantaneous trip amperes and applicable rating plugs. 3
TABLE III. Tripping characteristics – long-time delay (LTD). 3
TABLE IV. Adjustable short-time pickup and delay trip settings. 4
TABLE V. Test requirements. 4

LIST OF FIGURES

FIGURE 1. Circuit breaker type AQB-L400, outline and mounting dimensions. 5
FIGURE 2. Circuit breaker type AQB-L400, mounting block. 7
FIGURE 3. Side view of circuit breaker and mounting blocks – retrofit package. 8
FIGURE 4. Drawout stud assembly/panel cutout dimensions – retrofit package. 9
FIGURE 5. Adaptor block – retrofit package. 10
FIGURE 6. Circuit breaker type AQB-L400QF with 250-amp rating plug time-current response. 11
FIGURE 7. Circuit breaker type AQB-L400QF with 300-amp rating plug time-current response. 12
FIGURE 8. Circuit breaker type AQB-L400QF with 350-amp rating plug time-current response. 13
FIGURE 9. Circuit breaker type AQB-L400QF with 400-amp rating plug time-current response. 14
FIGURE 10. Circuit breaker type AQB-L400QM with 250-amp rating plug time-current response. 15
FIGURE 11. Circuit breaker type AQB-L400QM with 300-amp rating plug time-current response. 16
FIGURE 12. Circuit breaker type AQB-L400QM with 350-amp rating plug time-current response. 17
FIGURE 13. Circuit breaker type AQB-L400QM with 400-amp rating plug time-current response. 18

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Retrofit package	An alternate retrofit package may be supplied to meet the mounting requirements for an AQB-LF400. This retrofit package shall consist of 2 adaptor blocks, 6 terminal assemblies, and 1 close out plate. Refer to figures 3, 4, and 5.
Maximum rated continuous current	400 amperes
Voltage and frequency	500 VAC, 60 Hz
Interrupting rating	150,000 amperes
Peak let-through current	40,000 amperes
Trip unit	Interchangeable rating plug for continuous ampere rating. Adjustable short-time pickup and short-time delay (STD) on frame; STD range is a function of rating plug type.
Current limiting fuses	Not applicable
Type of connections	Back (removable mtg.)
Electric operator	Available
Undervoltage trip or shunt trip	Either available. Excluding 28 VDC shunt trip and 33 VDC undervoltage. (Note: 33 VDC shall not be applicable for undervoltage tripping device.)
Auxiliary switch	Two (a) contacts; two (b) contacts
Handle lock	Group 3 (Figure 1 of MIL-DTL-17361)
Handle boot	Not available

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE II. Instantaneous trip amperes and applicable rating plugs.

Frame type /1	Interrupting amperes rating plug types /1 /2	Instant pickup	Maximum time (seconds) /3
AQB-L400QF	250 Q 300 Q 350 Q 400 Q	1850	0.032
AQB-L400QM	250 Q 300 Q 350 Q 400 Q	3280	0.032

NOTES:

/1 The suffix letters have the following denotations:
Q – electronic device trip device.
F – frame type for feeder applications.
M – frame type for high inrush applications.

/2 Rating plugs of the same designation are the same.

/3 Confirmation for qualification test only, not for routine calibration. The tolerance for instantaneous pickup amperes shall not exceed ±10%.

TABLE III. Tripping characteristics – long-time delay (LTD).

Current as multiple of trip element rating	Tripping time 60-Hz AC trip element
1.30	Not less than 1 hour
2.25	Less than 1 hour
6.00	Between 20 and 32 seconds

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE IV. Adjustable short-time pickup and delay trip settings.

Complete circuit breaker designation /1	Short-time pickup (amp) /2					STD	
	LO	#2	#3	#4	HI	Min. /3	Max. /3
AQB-L250QF	650	850	1050	1250	1500	0.253	0.824
AQB-L300QF	650	850	1050	1250	1500	0.349	1.170
AQB-L350QF	650	850	1050	1250	1500	0.464	1.580
AQB-L400QF	650	850	1050	1250	1500	0.596	2.060
AQB-L250QM	1700	2050	2400	2800	3200	0.74	0.184
AQB-L300QM	1700	2050	2400	2800	3200	0.093	0.250
AQB-L350QM	1700	2050	2400	2800	3200	0.115	0.329
AQB-L400QM	1700	2050	1240	2800	3200	0.140	0.420

NOTES:

/1 A complete circuit breaker designation consists of a frame type plus an applicable rating plug type. For example: A type AQB-L350QF circuit breaker consists of a type AQB-L400QF frame and a type 350Q rating plug; a type AQB-L400QM circuit breaker consists of a type AQB-L400QM frame and a type 400Q rating plug.

/2 Tolerances for each ampere setting shall not exceed ±10%.

/3 Maximum clearing times at the indicated setting, at the #3 short-time pickup setting. Confirmation for qualification test only.

TABLE V. Test requirements.

Electrical endurance test	The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.		
Temperature rise tests	Size of cable and bus bars for temperature rise tests		
	Copper rating-amperes	Cable size	Copper bus size (inch)
	400	Two (2) AWG 000	1-1/2 x 1/8

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

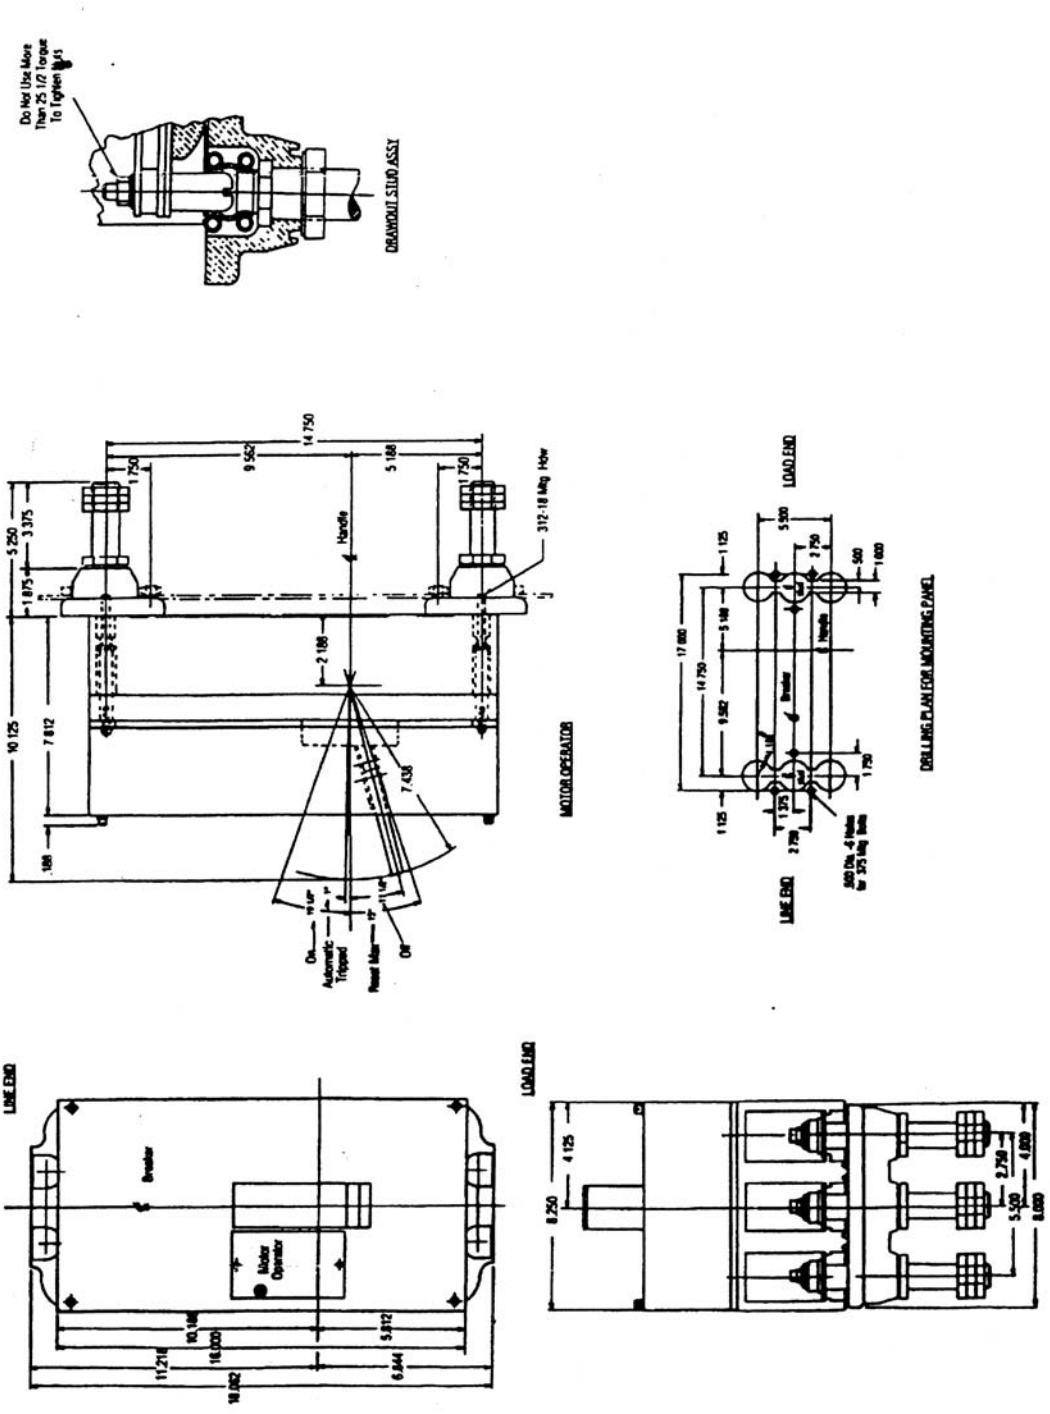


FIGURE 1. Circuit breaker type AQB-L400, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

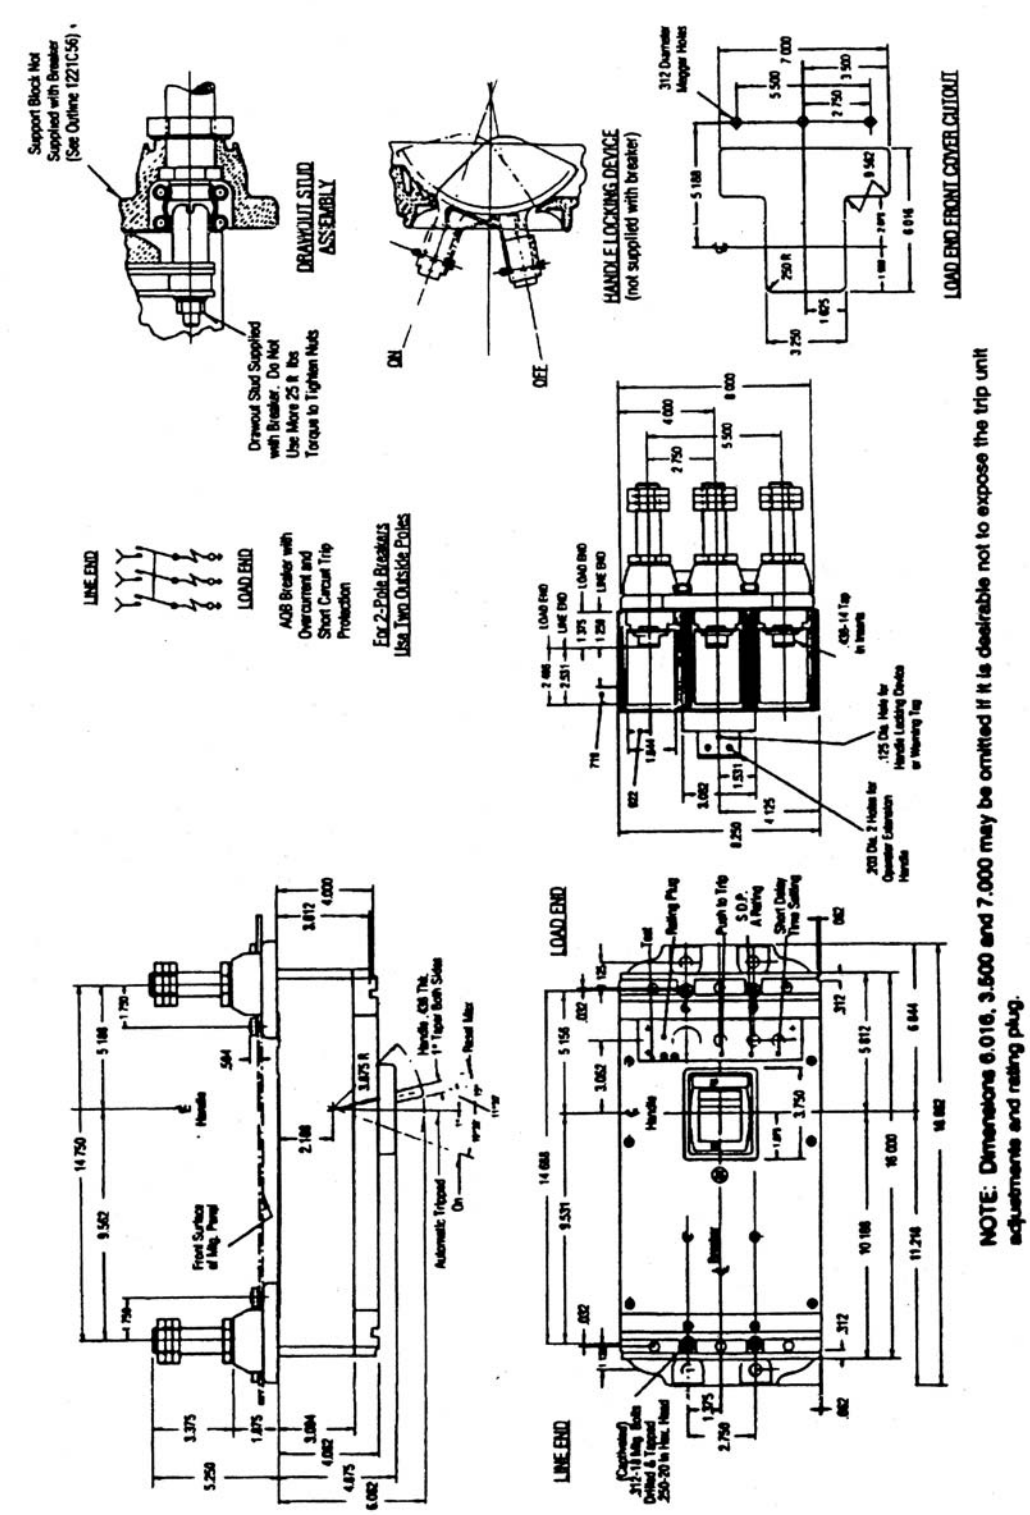


FIGURE 1. Circuit breaker type AQB-L400, outline and mounting dimensions - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

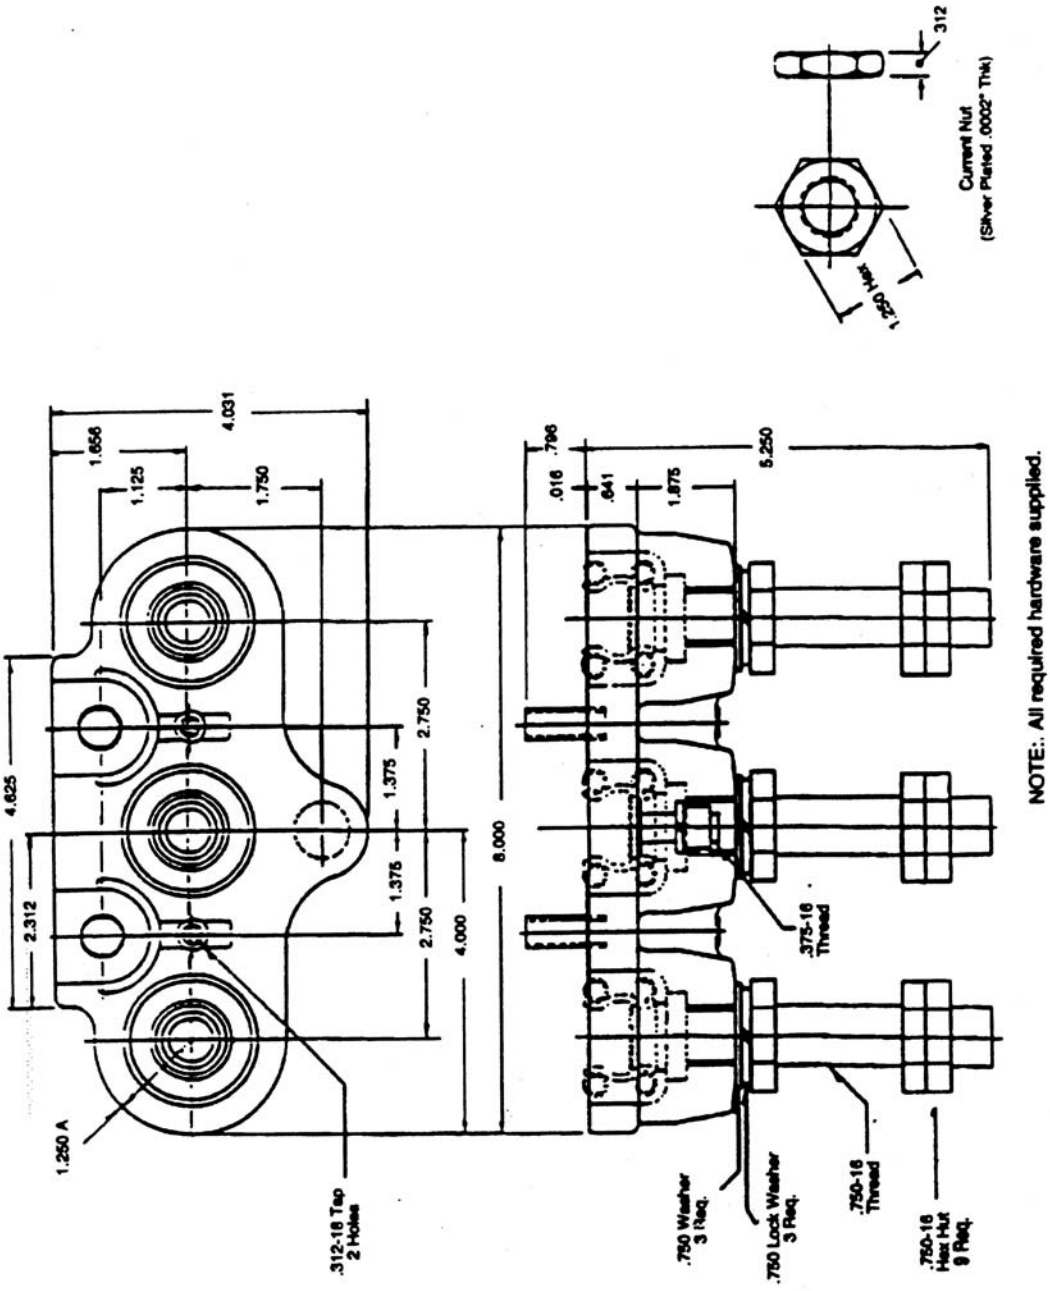


FIGURE 2. Circuit breaker type AQB-L400, mounting block.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

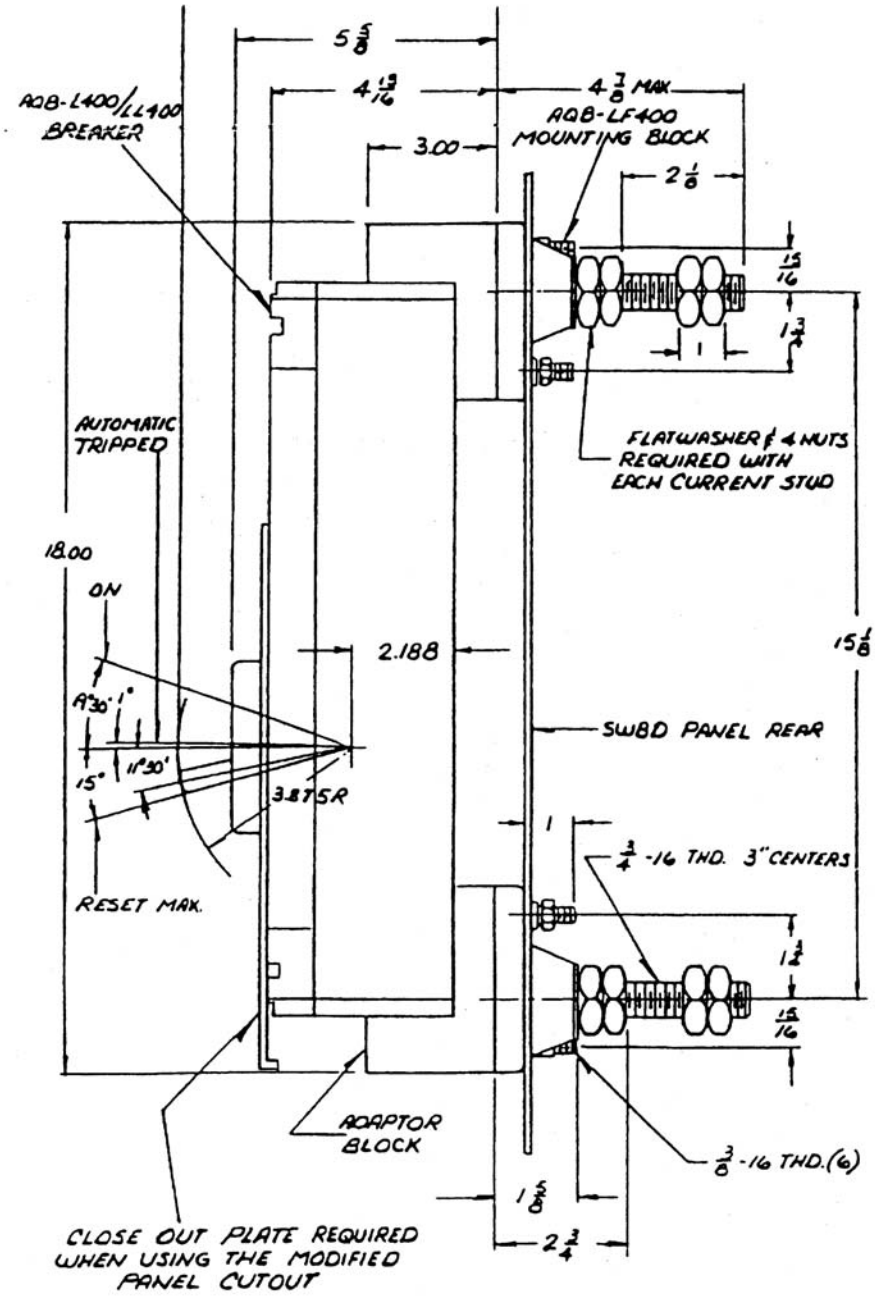


FIGURE 3. Side view of circuit breaker and mounting blocks – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

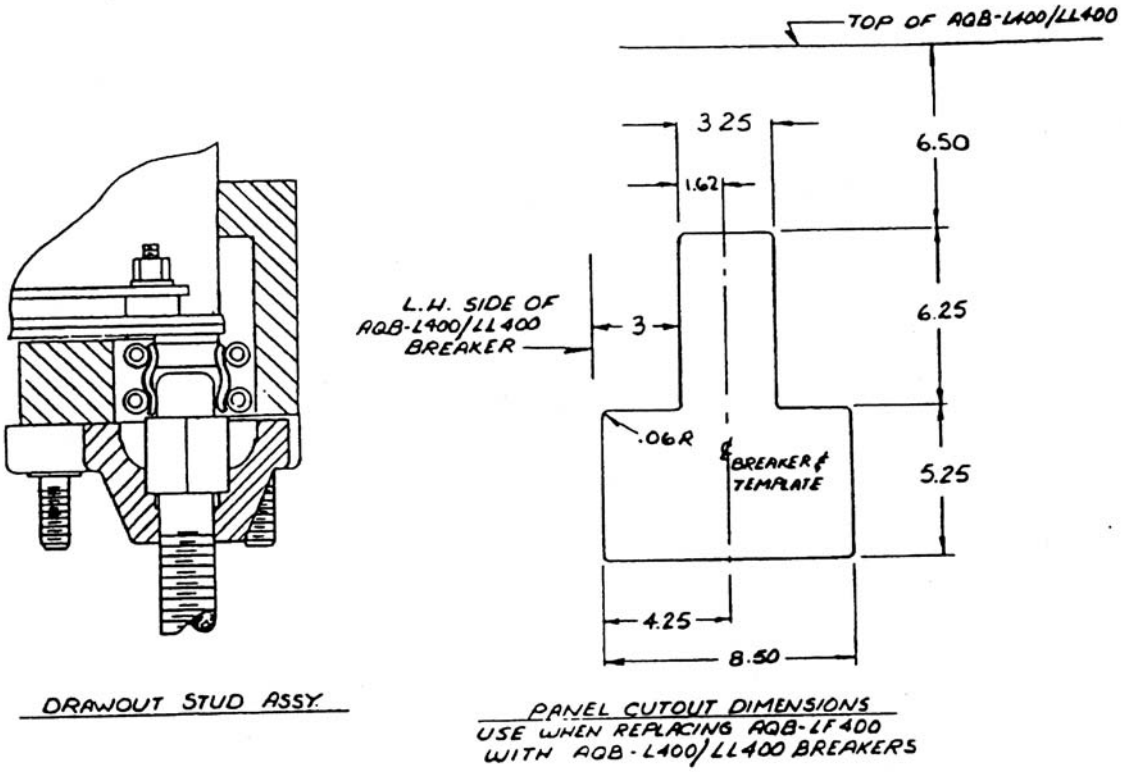


FIGURE 4. Drawout stud assembly/panel cutout dimensions – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

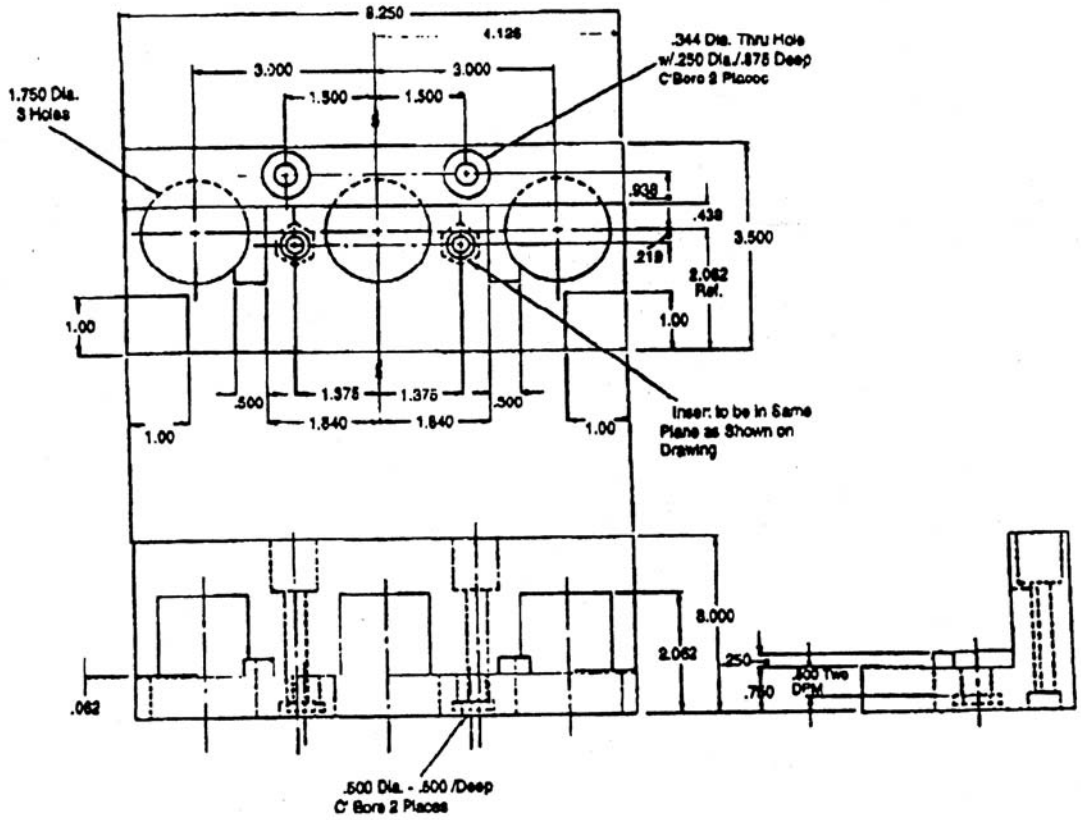


FIGURE 5. Adaptor block – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

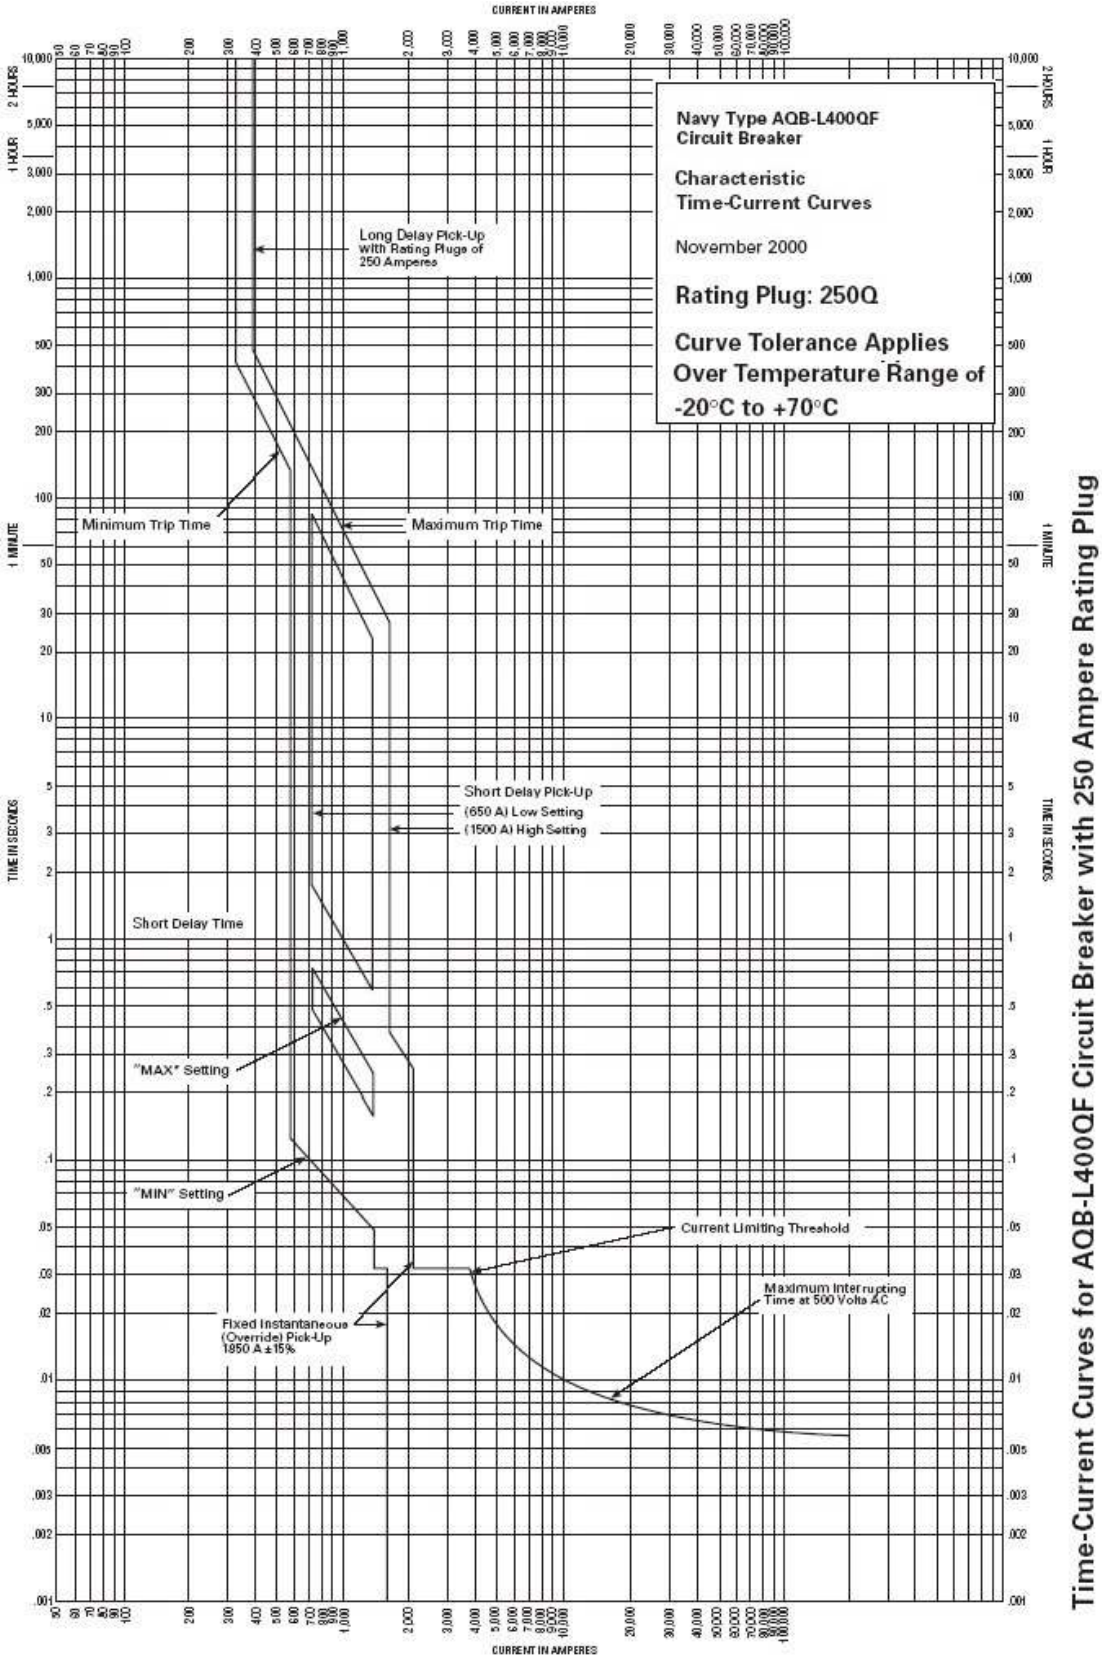


FIGURE 6. Circuit breaker type AQB-L400QF with 250-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

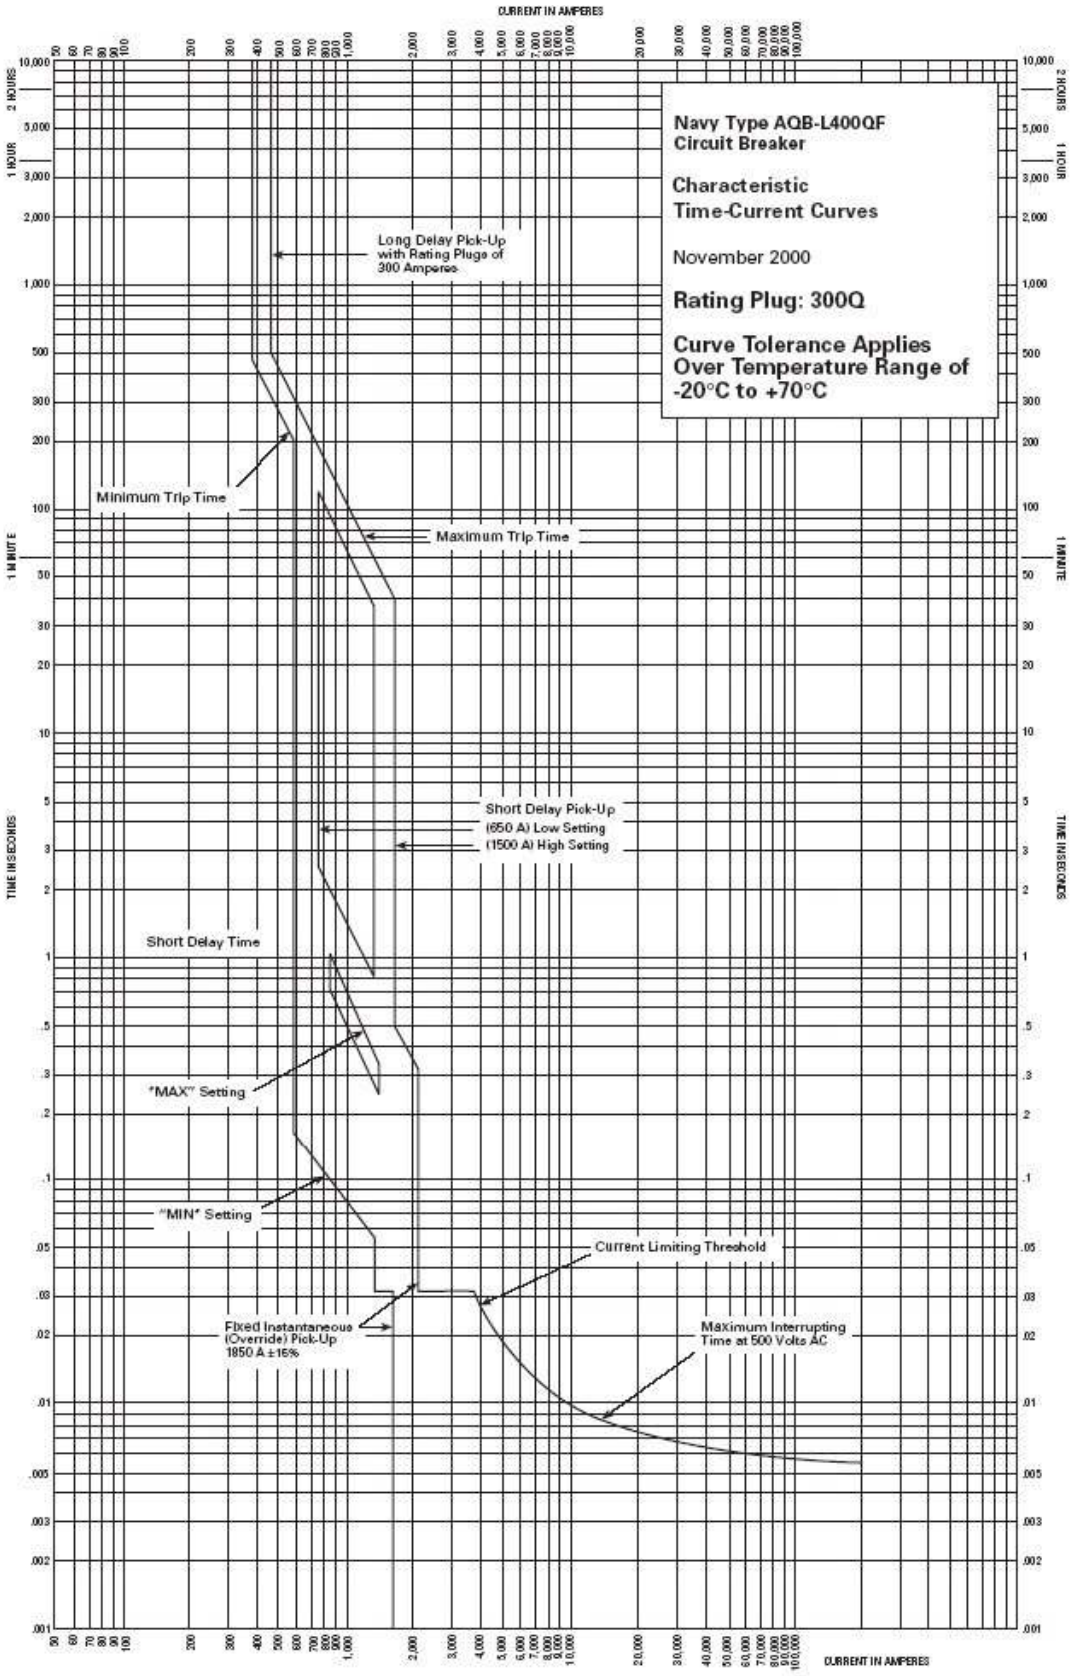


FIGURE 7. Circuit breaker type AQB-L400QF with 300-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

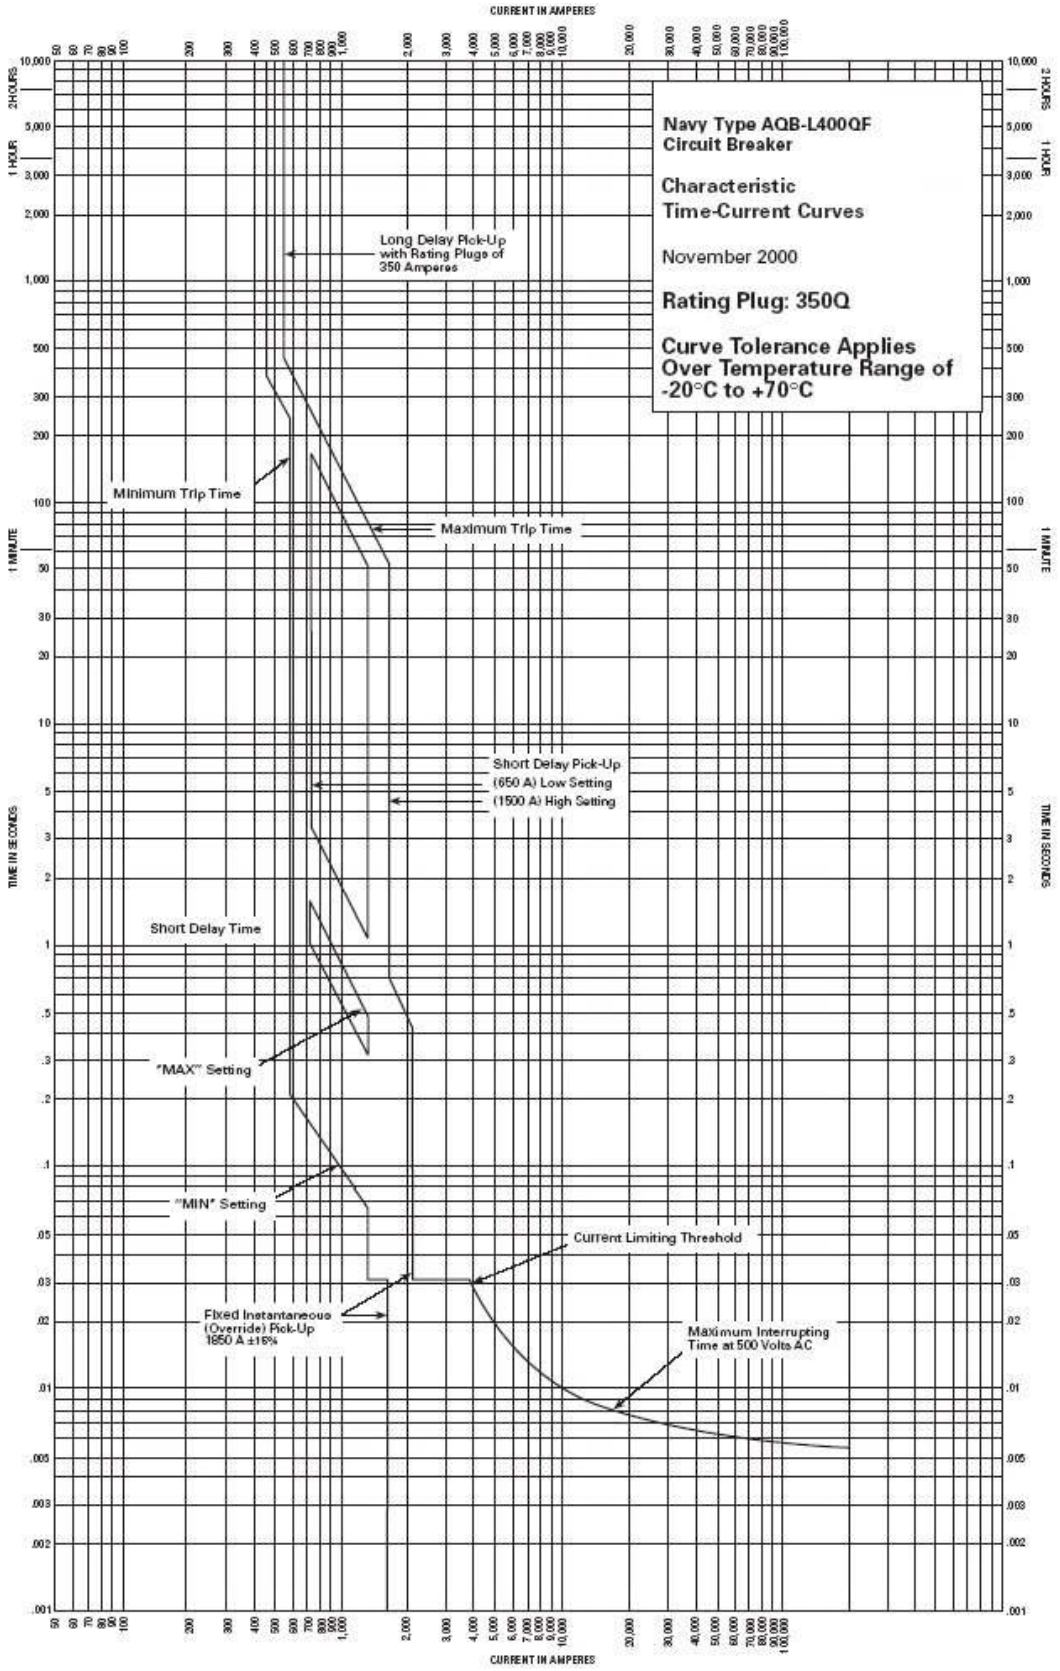


FIGURE 8. Circuit breaker type AQB-L400QF with 350-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

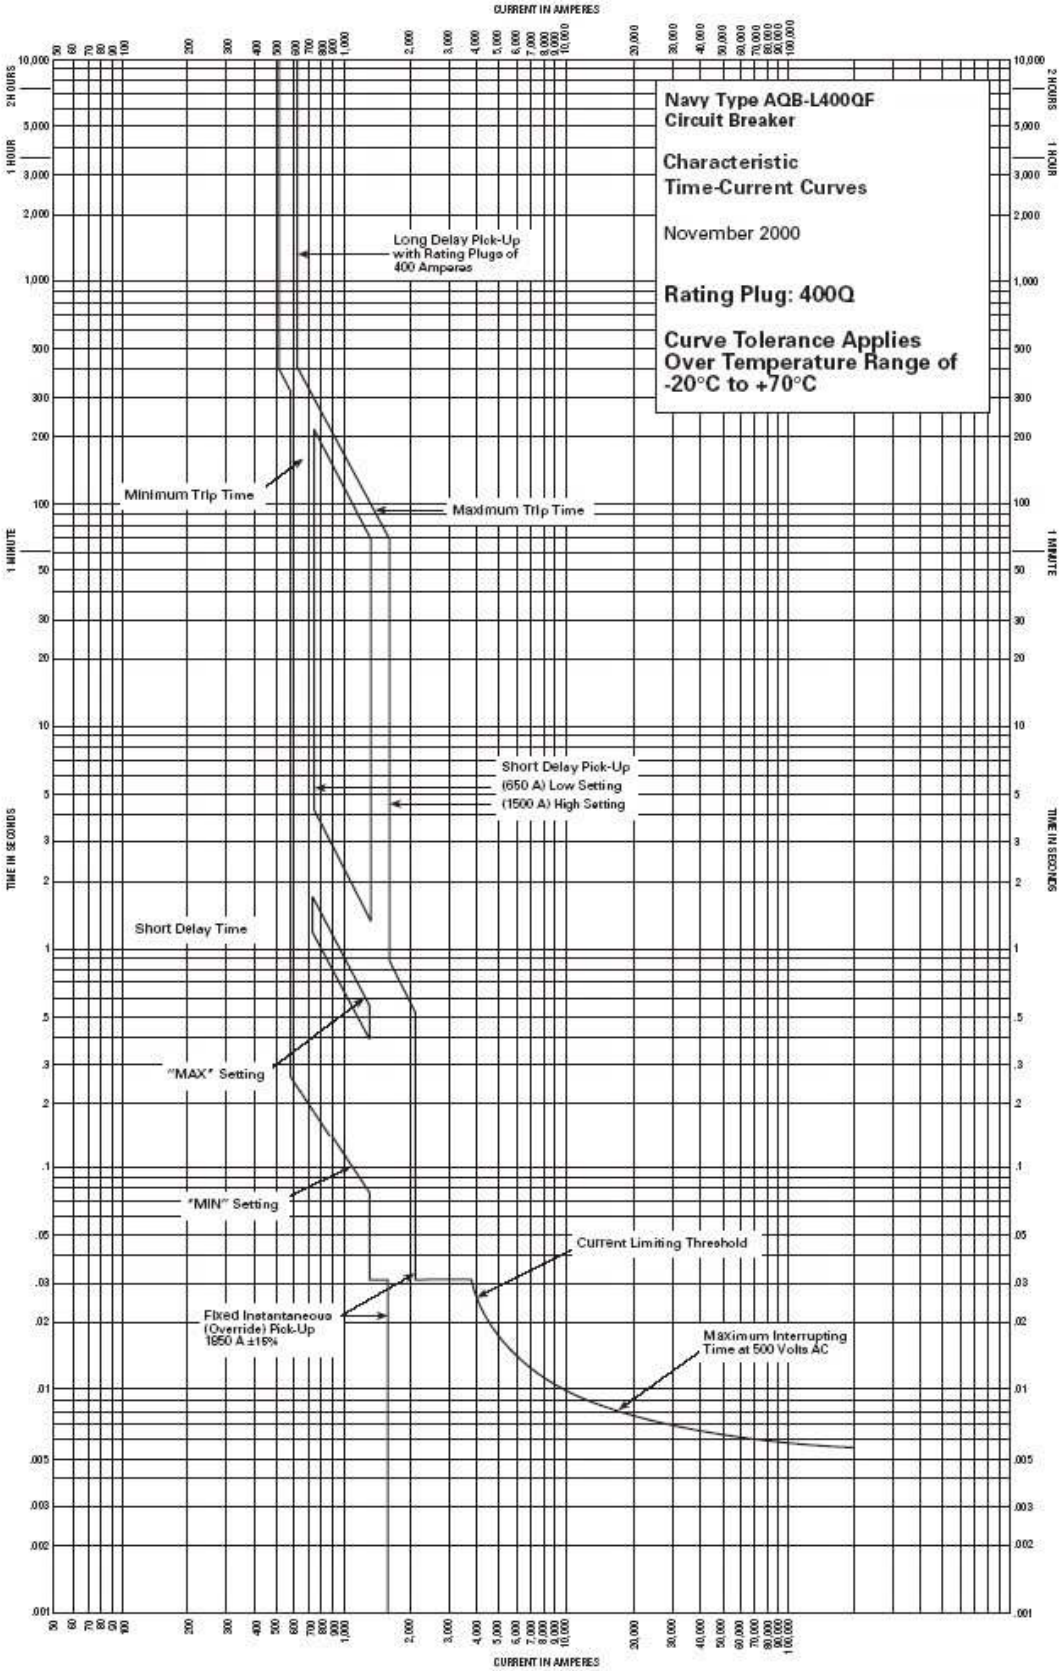


FIGURE 9. Circuit breaker type AQB-L400QF with 400-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

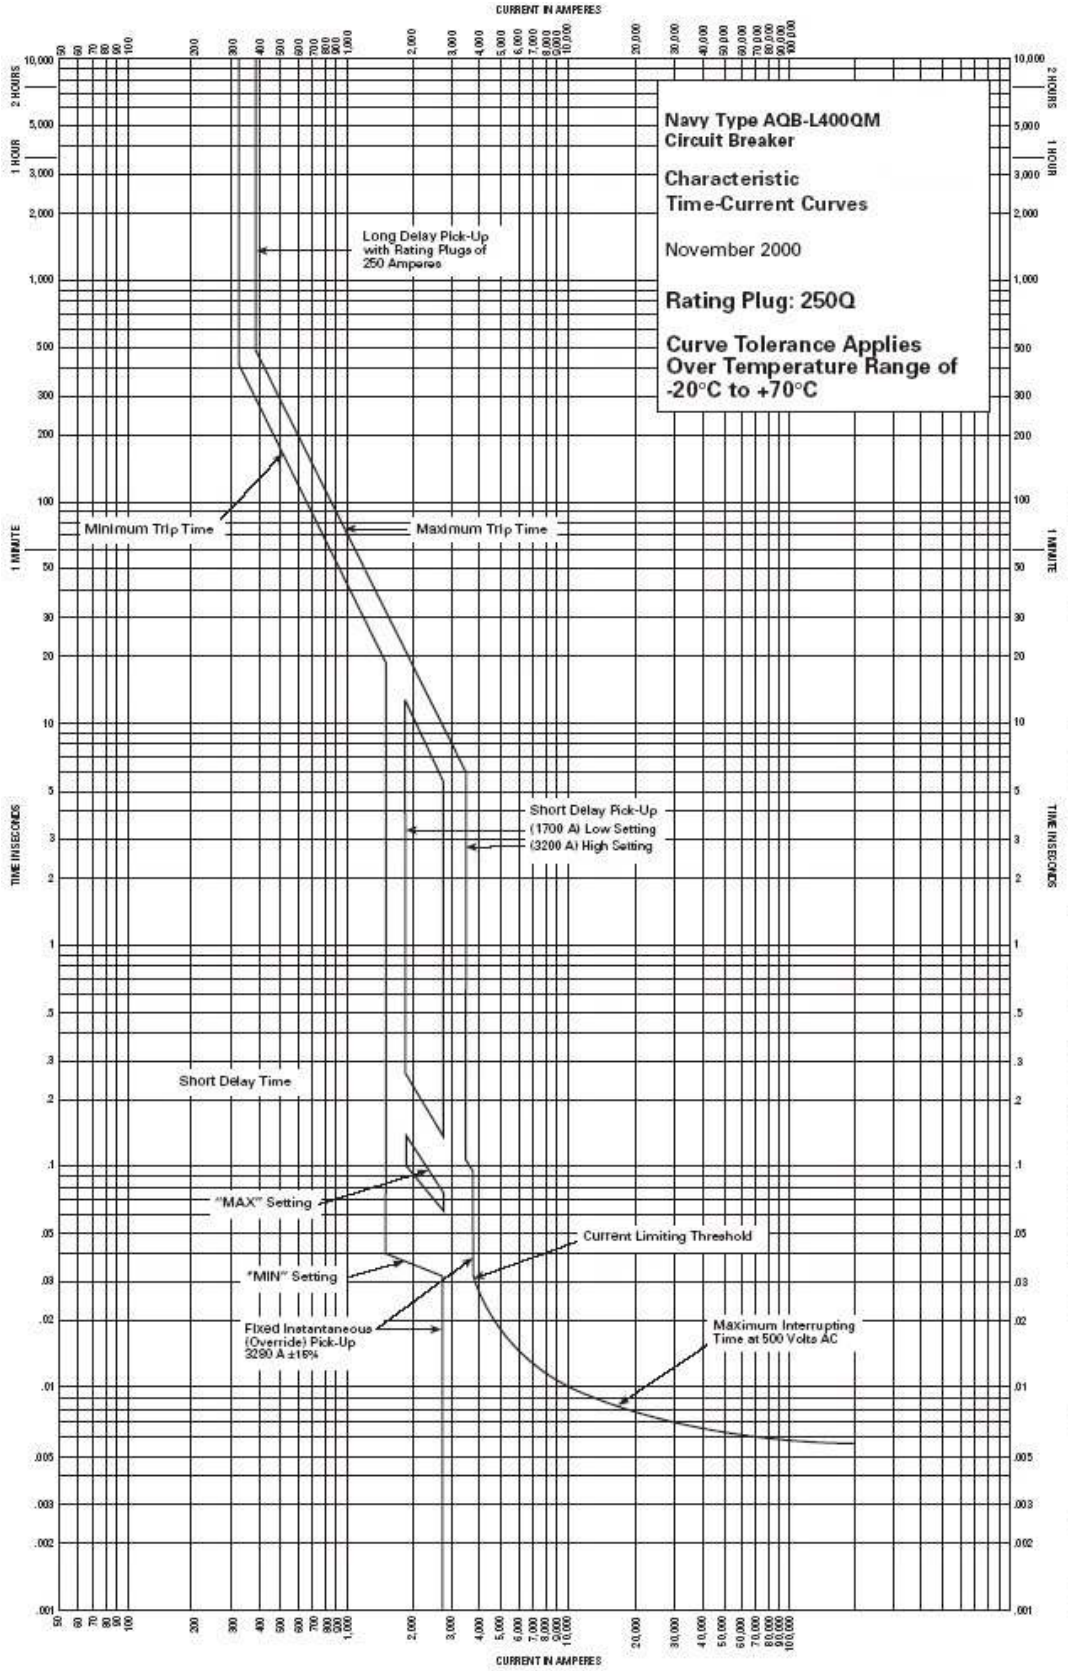


FIGURE 10. Circuit breaker type AQB-L400QM with 250-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

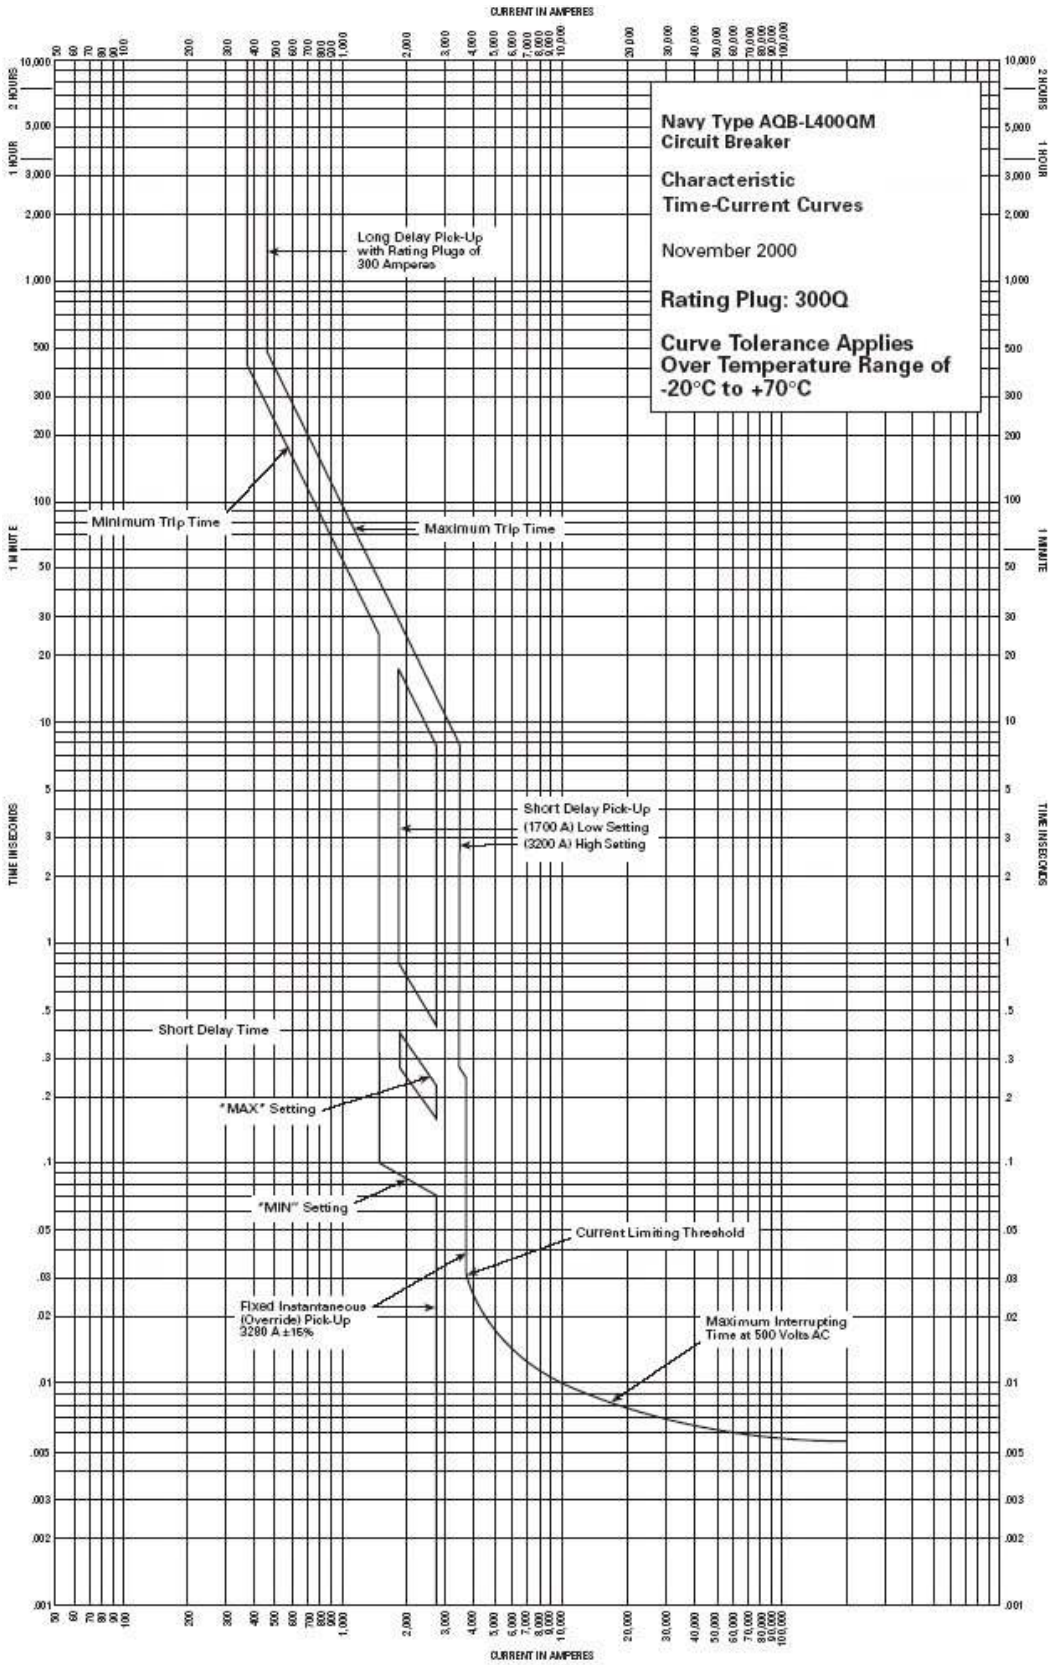


FIGURE 11. Circuit breaker type AQB-L400QM with 300-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

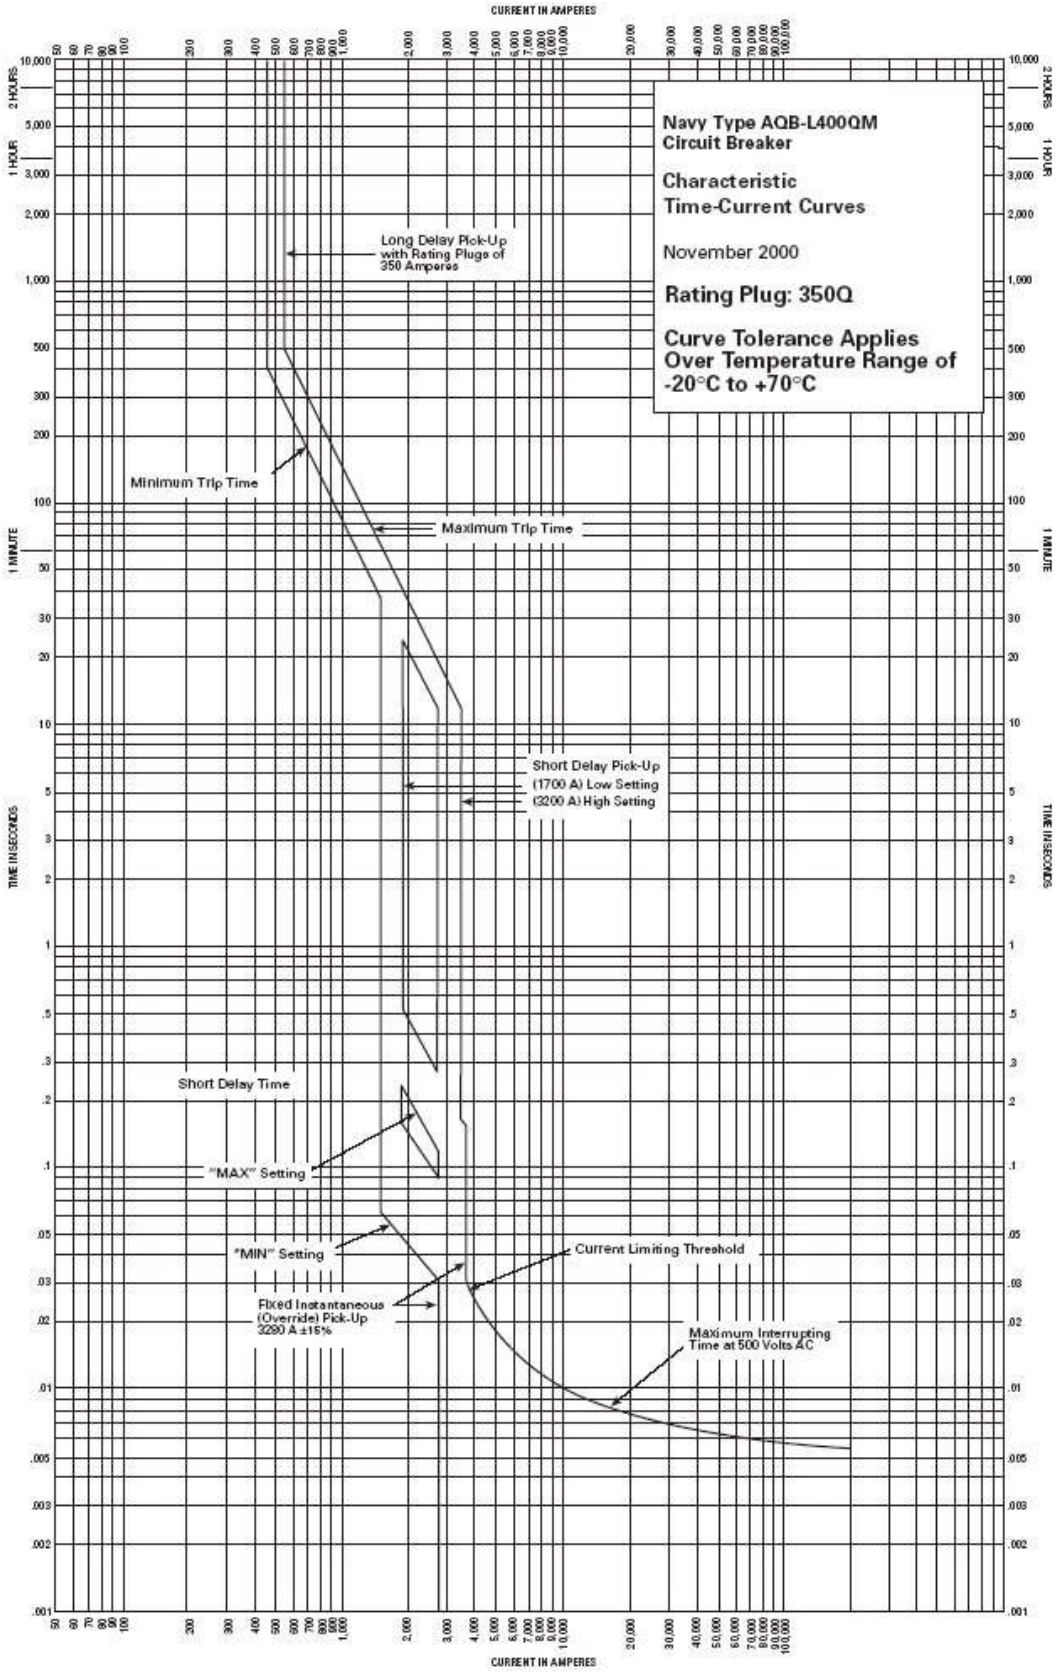


FIGURE 12. Circuit breaker type AQB-L400QM with 350-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

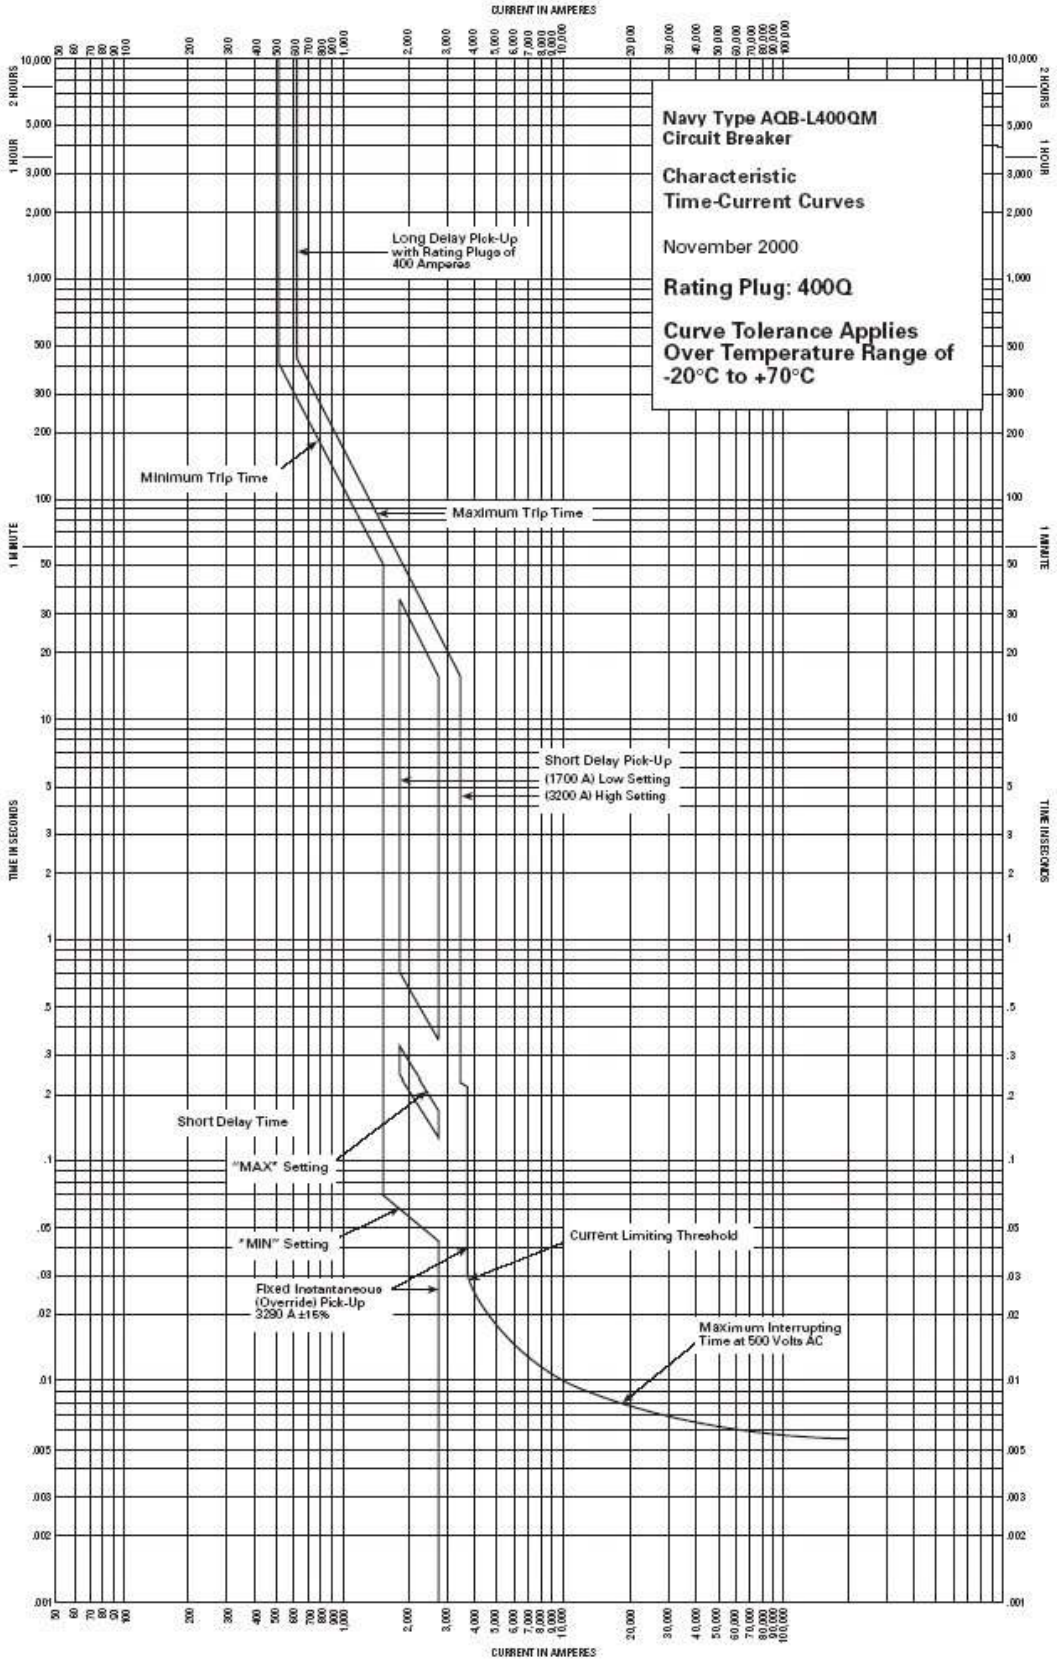


FIGURE 13. Circuit breaker type AQB-L400QM with 400-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-009)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.