INCH-POUND
MIL-DTL-16377/78A
w/AMENDMENT 1
25 July 2022
SUPERSEDING
MIL-DTL-16377/78A
30 June 2014


DETAIL SPECIFICATION SHEET

FIXTURES, LIGHTING; T8 FLUORESCENT, GENERAL LIGHTING, 17 WATTS, 120 VOLTS, 60 HERTZ, WATERTIGHT, SYMBOLS 331.1T8, 331.2T8, 347.2T8, AND 347.3T8

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-16377. If specified by the acquisition activity, solid state lighting (SSL) fixtures designed and manufactured in accordance with MIL-DTL-16377/8 may be substituted for fixtures manufactured in accordance with this specification sheet.

All dimensions are in inches. For tolerances other than specified herein, see 3.5.2 of MIL-DTL-16377.

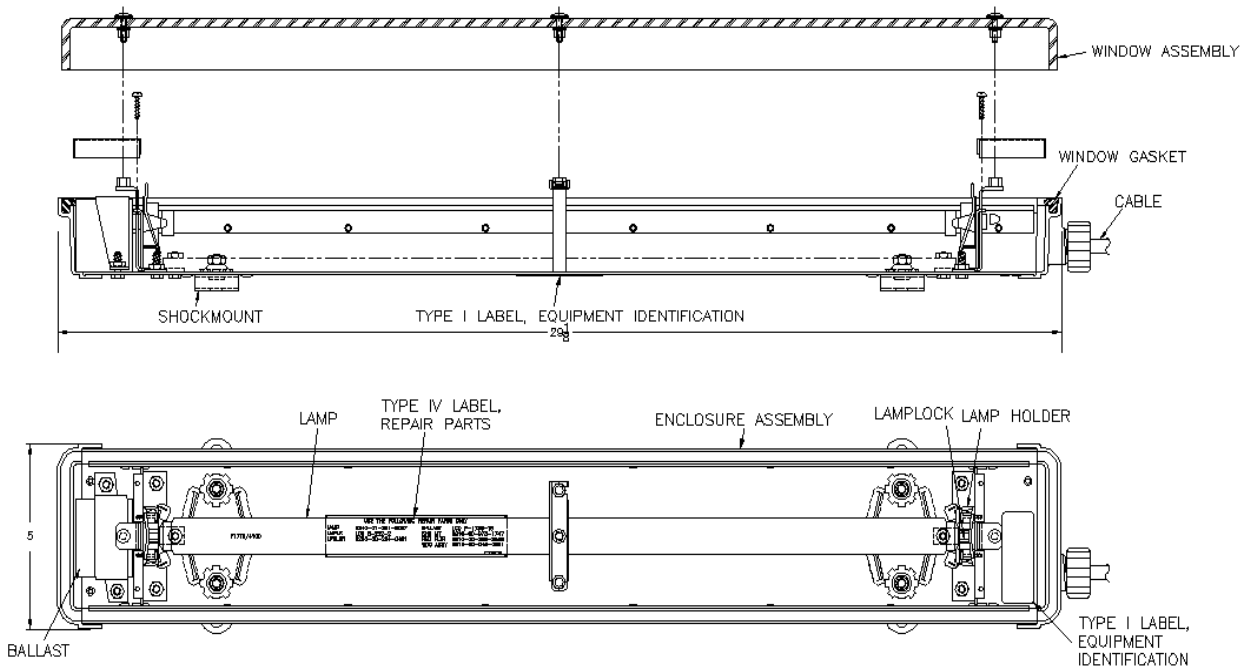

NOTE:

1. Symbols 331.2T8 and 347.3T8 use identical construction with flush mounting flange not shown.

FIGURE 1. Typical view of symbols 331.1T8 and 347.2T8.

DISTRIBUTION STATEMENT A. Approved for public release. Distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.


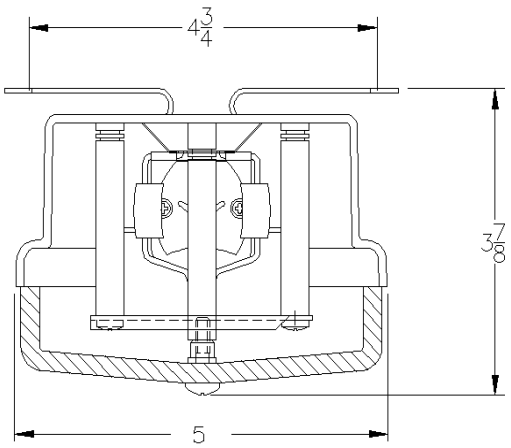


FIGURE 2. Typical section for symbols 331.1T8 and 347.2T8.

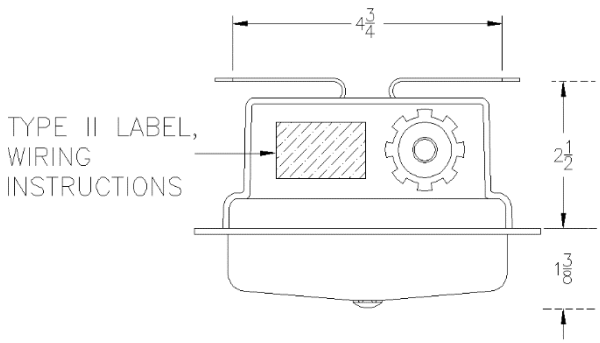

NOTE:

1. Type II label required for all fixtures.

FIGURE 3. Typical section for symbols 331.2T8 and 347.3T8.

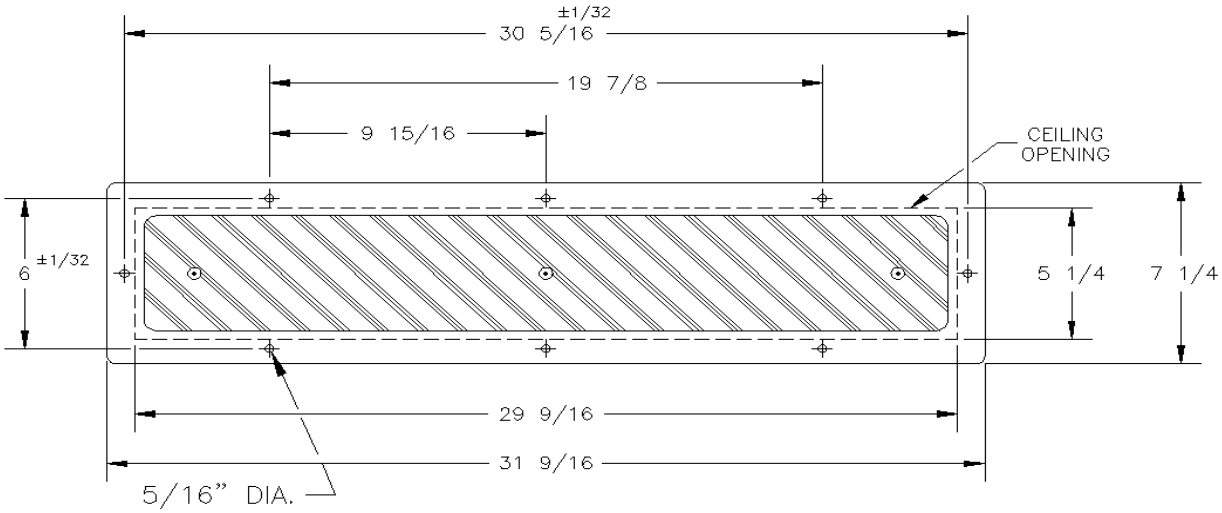


FIGURE 4. Flush mounting dimensions for symbols 331.2T8 and 347.3T8.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

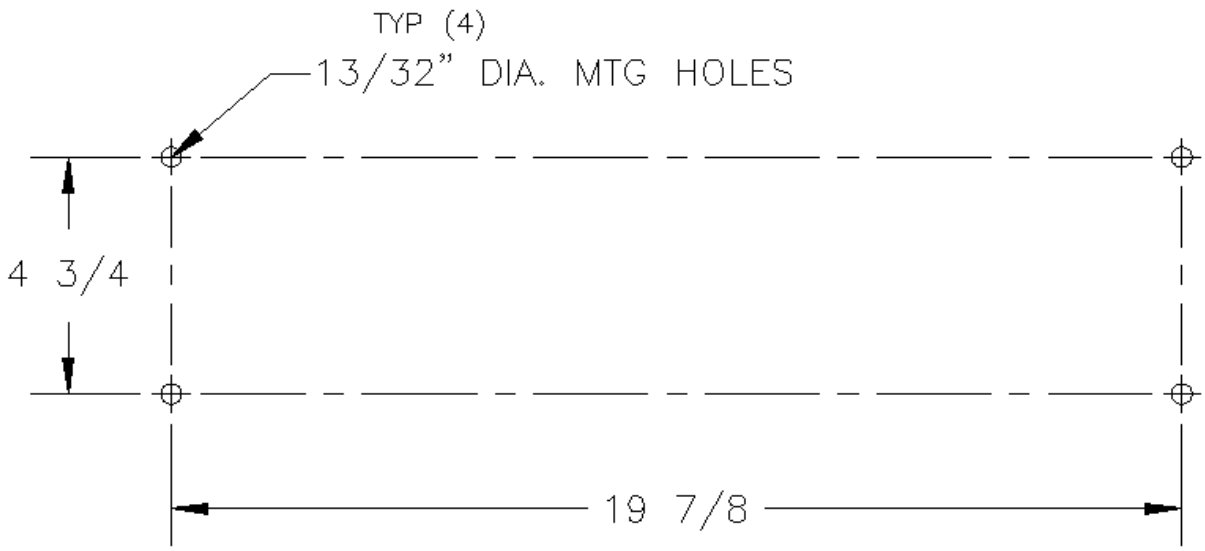


FIGURE 5. Standard mounting dimensions utilizing shock mounts for symbols 331.1T8 and 347.2T8.

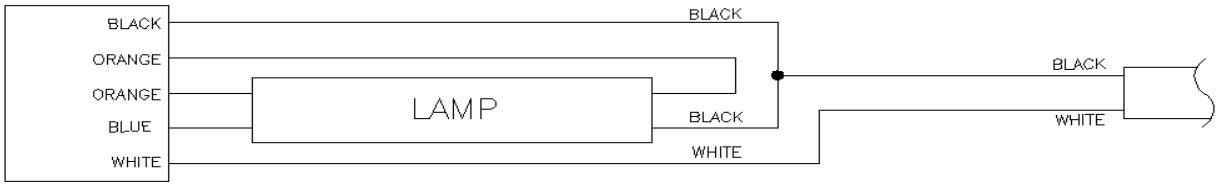


FIGURE 6. Typical wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

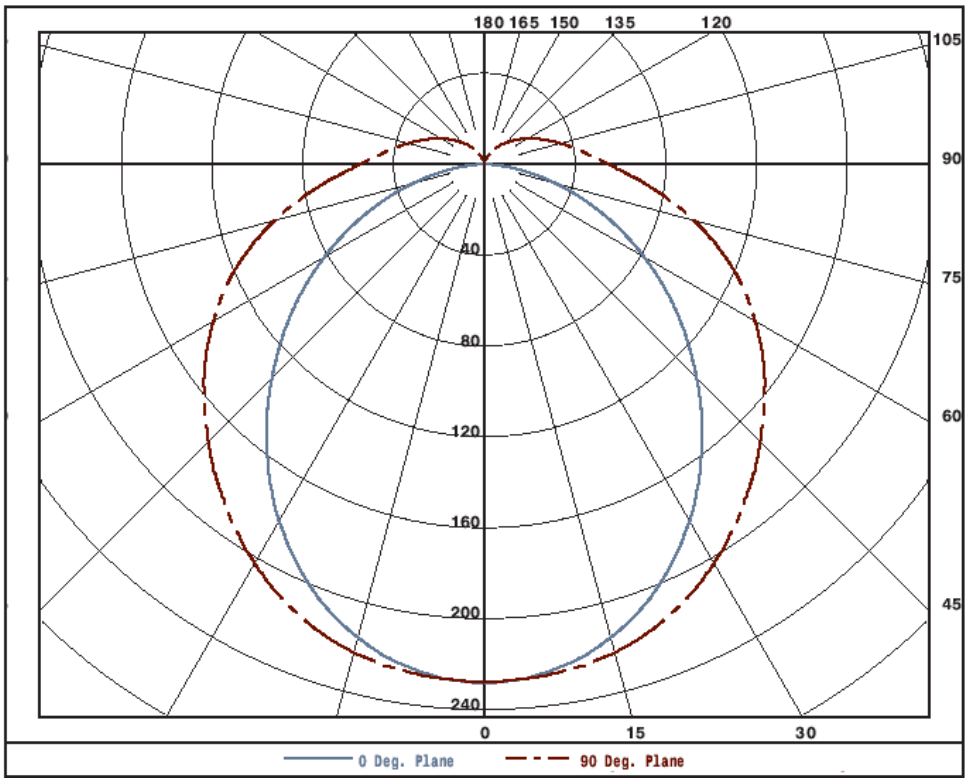


FIGURE 7. Candela distribution curves, white diffusing window, symbols 331.1T8 and 331.2T8.

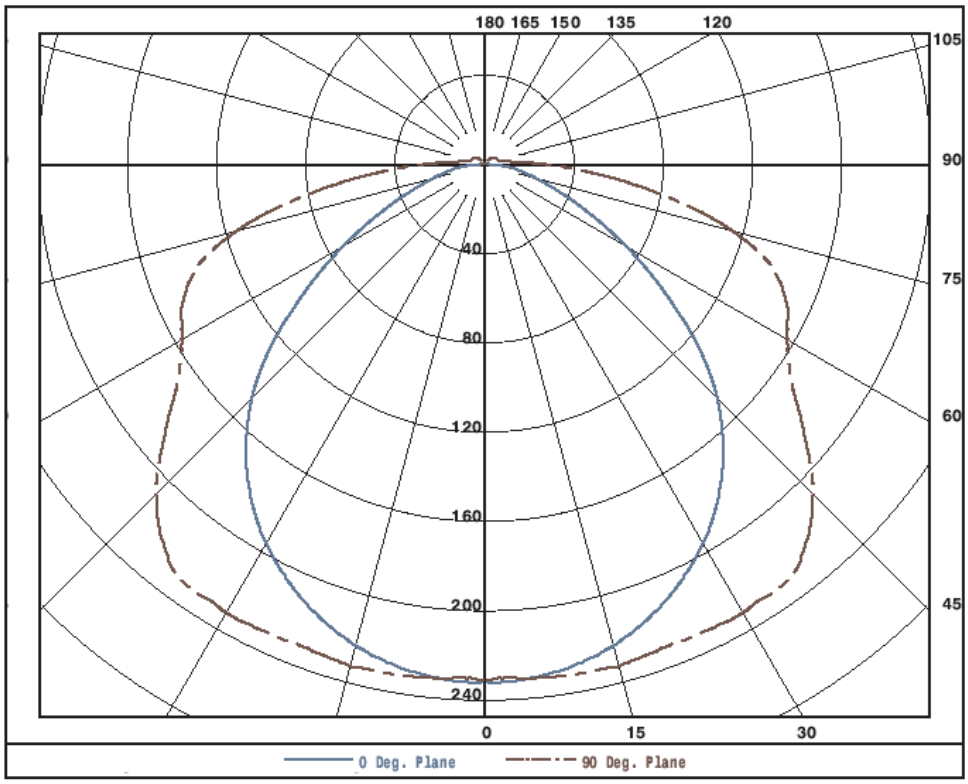


FIGURE 8. Candela distribution curves, prismatic window, symbols 347.2T8 and 347.3T8.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

TABLE I. Numerical candela distribution, white diffusing window, symbols 331.1T8 and 331.2T8.

Vertical Angle	Candela Distribution	
	0-Degree	90-Degree
0	228	228
5	227	227
15	216	223
25	195	211
35	166	193
45	132	172
55	98	150
65	64	125
75	32	95
85	7	66
90	2	55

Vertical Angle	Candela Distribution	
	0-Degree	90-Degree
105	1	46
115	0	35
125	0	26
135	0	19
145	0	13
155	0	8
165	0	4
175	0	0
180	0	0

TABLE II. Numerical candela distribution, prismatic window, symbols 347.2T8 and 347.3T8.

Vertical Angle	Candela Distribution	
	0-Degree	90-Degree
0	231	231
5	231	231
15	223	233
25	207	231
35	182	231
45	147	208
55	97	167
65	52	149
75	23	115
85	9	51
90	2	28

Vertical Angle	Candela Distribution	
	0-Degree	90-Degree
95	2	13
105	2	6
115	1	6
125	0	5
135	0	4
145	0	2
155	0	1
165		
175		
180		

PHOTOMETRIC DATA:

Photometry reports based on LM-41 and other pertinent Illuminating Engineering Society (IES) procedures.

Plane:	0 degrees is parallel to lamp, 90 degrees is perpendicular to lamp.
Electrical values:	120 volts, 60 hertz, 18.0 watts input power.
Ambient temperature:	77±1.8 °F (25±1 °C).
Lamps:	GE F17T8-SP41-ECO, or equal (seasoned for at least 100 hours).
Lamps correction:	Lamps rated at 1,325 lumens.
Ballast:	Furnished with fixture, see MIL-DTL-16377/81 for specification.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

CLASSIFICATION:

Type: I
Class: 2

SYMBOL NUMBERS:

331.1T8: Complete lighting fixture assembly, standard mounting with one 17-watt T8 cool white fluorescent lamp and white diffusing window assembly.
331.2T8: Complete lighting fixture assembly, flush mounting with one 17-watt T8 cool white fluorescent lamp and white diffusing window assembly.
347.2T8: Complete lighting fixture assembly, standard mounting with one 17-watt T8 cool white fluorescent lamp, clear and white prismatic window assembly.
347.3T8: Complete lighting fixture assembly, flush mounting with one 17-watt T8 cool white fluorescent lamp, clear and white prismatic window assembly.

DESIGN:

Electrical rating: 17 watts, 120 volts, 60 hertz.
Dimension and configurations: See figures 1, 2, and 3.
Photometric data: See figures 7 and 8 and tables I and II.
Wiring diagram: See figure 6 for typical wiring.
Ballast: See MIL-DTL-16377/81 for specification.
Mounting dimensions:
Symbols 331.1T8 and 347.2T8: Standard mounting (surface), see figure 5.
Symbols 331.2T8 and 347.3T8: Flush mounting (recessed), see figure 4.
Window assembly:
Symbols 331.1T8 and 331.2T8: White window, see table III and figure 27 of MIL-DTL-16377.
Symbols 347.2T8 and 347.3T8: Prismatic window, see table III and figure 27 of MIL-DTL-16377.
Enclosure: Watertight, see 3.5.11 of MIL-DTL-16377.
Cable: 10 feet (minimum) of Type LSDHOF-3 in accordance with MIL-DTL-24643/3.
Weight:
Symbols 331.1T8 and 347.2T8: Not to exceed 8 pounds, 10 ounces.
Symbols 331.2T8 and 347.3T8: Not to exceed 10 pounds, 2 ounces.
Designation and marking: The following labels shall be furnished in accordance with MIL-DTL-16377 and applied as shown on figures 1 and 3:

a. Two Type I labels, equipment identification, reference MIL-DTL-16377 figure 11; shall include manufacturer and address, one located on back and other located on an inner nonreflecting surface.
b. One Type II label, circuit wiring information, reference MIL-DTL-16377 figure 12; located on outside surface adjacent to cable entrance.
c. One Type IV label, repair parts, reference MIL-DTL-16377 figure 14; information to be shown shall be “USE THE FOLLOWING REPAIR PARTS ONLY:” followed by a list of all standard parts shown in table III, located on an inner nonreflecting surface.

Standard parts: The standard parts shown in table III shall be used in the construction of the fixtures specified herein.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

EXAMINATIONS AND TESTS:

Examinations and tests shall be as specified in MIL-DTL-16377 and the following:

First article testing/inspection:
Complete fixtures: See table IV.
Window assemblies: See table V.
Conformance:
Comparison inspection: Same as first article inspection.
Conformance inspection: See MIL-DTL-16377.

GENERAL INFORMATION:

Assignment of military part numbers and general information is shown in table VI.

TABLE III. Standard parts.

Name	Military P/N or Specification	National Stock Number (NSN)	Remarks
Lamp	Commercial identification F17T8/CW	6240-01-391-6027	
Lamplock	M16377/40-003		
Lampholder	UL 542	6250-00-284-0481	Commercial
Ballast	M16377/81-001		Integrated starter type
High-temperature ballast	M16377/81-002		High-temperature applications
High-temperature starter	FS-4	6250-00-179-2354	High-temperature applications
Startersocket	UL 496	6250-00-295-2738	High-temperature applications
Shock mount	M16377/41-008	6210-01-393-4302	0.067 steel, zinc plated
Window assembly, diffusing	M16377/8-001	6210-00-548-0601	1/
Window assembly, prismatic	M16377/8-003	6210-01-438-2960	1/
Filter, 17-watt T8 fluorescent lamp (Dark adaptation)	M16377/42-010	6210-01-313-8169	Red transparent
Filter, 17-watt T8 fluorescent lamp (1% transmission gray)	M16377/42-011		
Filter, 17-watt T8 fluorescent lamp (2.5% transmission gray)	M16377/42-012		
Filter, 17-watt T8 fluorescent lamp (Amber)	M16377/42-015		
Filter, 17-watt T8 fluorescent lamp (Broad band blue)	M16377/42-016		

NOTE:
1/ Window assemblies (diffusing and prismatic) are the same as T12 lamp fixtures (MIL-DTL-16377/8).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

TABLE IV. First article tests and comparison inspection for complete fixtures. 1/

Test	Requirement	Test Method	Remarks
Examination	3.13	4.5	
Operation	3.13	4.8.1	
Electromagnetic interference	3.6.14	4.8.16	
Power interface	3.6.18	4.8.21	
Power quality	3.6.18.1	4.8.22	2/
Voltage transient spike	3.6.18.2	4.8.23	3/
Dielectric withstanding voltage	3.6.15	4.8.2	4/
Insulation resistance	3.6.16	4.8.3	4/
Enclosure effectiveness	3.5.11	4.8.14.4	4/ Watertight
Shock	3.5.12	4.8.7	4/
Vibration	3.5.13	4.8.8	4/
Enclosure effectiveness	3.5.11	4.8.14.4	4/ Watertight
Dielectric withstanding voltage	3.6.15	4.8.2	4/
Insulation resistance	3.6.16	4.8.3	4/
Noise	3.5.14	4.8.9	
Continuity of grounding	3.6.13.4	4.8.12	
Light output	3.7.1	4.8.6.1	
Optical uniformity	3.7.6.1.1	4.8.4	
Stress relief	3.8.5.3	4.8.5	
Magnetic permeability	3.4.8	4.8.18	

NOTES:

1/ Requirement and test method paragraph numbers refer to MIL-DTL-16377.

2/ If less, then 1 KVA exception not applicable for input waveform total harmonic distortion.

3/ Solid state components shall be subject to 250 positive spikes and 250 negative spikes (500 total spikes), one spike per minute, using testing method identified in MIL-STD-1399-300-1.

4/ Tests shall be performed in the order specified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.

TABLE V. First article tests and comparison inspection for window assemblies. 1/

Test	Requirement	Test Method	Remarks
Examination	3.13	4.5	
Optical uniformity	3.7.6.1.1	4.8.4	
Stress relief	3.8.5.3	4.8.5	
Shock	3.5.12	4.8.7	2/
Vibration	3.5.13	4.8.8	2/
Enclosure effectiveness	3.5.11	4.8.14.4	2/ Watertight
Light output	3.7.1	4.8.6.1	Candela distribution

NOTES:
1/ Requirement and test method paragraph numbers refer to MIL-DTL-16377.
2/ Tests shall be performed in the order specified.

TABLE VI. Complete fixture part numbers.

Military Part Number M16377/78-	Item Name	National Stock Number (NSN)
331.1T8	Complete fixture, Symbol 331.1T8	6210-01-592-2374
331.2T8	Complete fixture, Symbol 331.2T8	
347.2T8	Complete fixture, Symbol 347.2T8	
347.3T8	Complete fixture, Symbol 347.3T8	

AMENDMENT NOTATIONS: The margins of this specification are marked with vertical lines to indicate modifications generated by this amendment. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations.

Custodians:
Army – CR4
Navy – SH
Air Force – 03

Review activities:
Navy – AS, CG
DLA – GS2

Civil agency:
GSA – FAS

Preparing activity:
Navy – SH
(Project 6210-2022-002)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:55Z
Check the source to verify that this is the current version before use.