INCH-POUND

MIL-P-10360G
26 February 1993
SUPERSEDING
MIL-P-10360F
30 May 1984

MILITARY SPECIFICATION

PUMPING UNITS, CENTRIFUGAL: 4-INCH AND 6-INCH, DIESEL-ENGINE-DRIVEN, FOR WATER

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers 4-inch and 6-inch self-priming centrifugal pumping units for water pumping service.

1.2 Classification. The pumps shall be integral self-priming of the following sizes as specified (see 6.2 and 6.13):

Size 4 - 4-inch suction and discharge.
Size 6 - 6-inch suction and discharge.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DoDISS) and supplement thereto, cited in the solicitation (see 6.2).

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: USA Belvoir Research, Development, and Engineering Center, ATTN: SATBE-TSE, Fort Belvoir, VA 22060-5606 by using the Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4320

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

SPECIFICATIONS

FEDERAL

VV-F-800 - Fuel Oil, Diesel.
WW-P-471 - Pipe-Fittings: Bushings, Locknuts, and Plugs; Iron, Steel, and Aluminum; (threaded); 125-150 Pounds.

MILITARY

MIL-P-514 - Plates, Identification, Instruction and Marking, Blank.
MIL-T-704 - Treatment and Painting of Materiel.
MIL-L-2104 - Lubricating Oil, Internal Combustion Engine, Combat/Tactical Service.
MIL-L-2105 - Lubricating Oil, Gear, Multipurpose.
MIL-F-3541 - Fittings, Lubrication.
MIL-G-3859 - Grease Guns, Hand-Operated, Lever, Push and Screw Type.
MIL-E-10062 - Engines: Preparation for Shipment and Storage of.
MIL-P-10603 - Pumps and Pumping Units, Centrifugal, Power-Driven, for Water, Packaging of.
MIL-G-10924 - Grease, Automotive and Artillery.
MIL-R-12144 - Reflector, Indicating, Clearance.
MIL-P-14105 - Paint, Heat-Resisting (for Steel Surfaces).
MIL-V-18436 - Valves, Check: Bronze, Cast Iron, and Steel Body.
MIL-G-23827 - Grease, Aircraft and Instrument, Gear and Actuator Screw.
MIL-A-46153 - Antifreeze, Ethylene Glycol, Inhibited, Heavy Duty, Single Package.
MIL-L-46167 - Lubricating Oil, Internal Combustion Engine, Arctic.
MIL-C-46168 - Coating, Aliphatic Polyurethane, Chemical Agent Resistant.
MIL-E-52649 - Engine Cold Starting Aids, Ether Fuel Primers.
MIL-P-62669 - Primer Coating, Synthetic (for Brake Drums).
MIL-S-81733 - Sealing and Coating Compound, Corrosion Inhibitive.
MIL-T-83133 - Turbine Fuel, Aviation, Kerosene Type, Grade JP-8.

STANDARDS

FEDERAL

FED-STD-H28 - Screw Thread Standards for Federal Services.

MILITARY

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.
MIL-STD-130 - Identification Marking of US Military Property.
MIL-STD-209 - Slinging and Tiedown Provisions for Lifting and Tying Down Military Equipment
MIL-STD-461 - Electromagnetic Emission and Susceptibility Requirements for the Control of Electromagnetic Interference.
MIL-STD-642 - Identification Marking of Combat and Tactical Transport Vehicles.
MIL-STD-810 - Environmental Test Methods.
MIL-STD-889 - Dissimilar Metals.

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the current version before use.

MIL-STD-1366	- Material Transportation System Dimensional and Weight Constraints, Definition of.
MIL-STD-1400	- Engines, Gasoline and Diesel, Methods of Test.
MIL-STD-1410	- Method for Selection of Industrial Engines for End Item Application.
MIL-STD-1472	- Human Engineering Design Criteria for Military Systems, Equipment, and Facilities.
MIL-STD-1474	- Noise Limits for Army Materiel.
MS33800	- Connector, Receptacle, Electrical - Pin Contact, No. 12, 14 and 16 A.W.G., Waterproof.
MS35644	- Filler Neck: Fuel Tank-Military Vehicles.
MS35645	- Cap, Fuel Tank: Tactical Vehicle, Fording.
MS35829	- Hinge, Butt, Continuous, (Piano) 0.075 Thickness, 0.187 and 0.250 Pin Dia.
MS35844	- Plug, Machine Thread, Magnetic: Drain.
MS49006	- Plug, Pipe, Magnetic-Headless; Aluminum, Iron or Steel.
MS51339	- Coupler, Drawbar, Ring: Offset Taper Shank), 60,000 Lb. GVW.
MS52125	- Composite Light-Tail, Stop, Turn and Marker.
MS53004	- Valve, Relay, Emergency-Breakaway, Air Brake.
MS53063	- Indicator, Air Cleaner, Intake, Restriction, Mechanical Type.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from the Standardization Documents Order Desk, Building 4D, 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

2.1.2 Other Government documents, drawings, and publications. The following other Government documents, drawings, and publications form a part of this document to the extent specified herein. Unless otherwise specified, the issues are those cited in the solicitation.

DRAWINGS

AT

C7070301	- Chart, Electrical, Circuit, Numbers.
C7339458	- Chain Assembly, Safety (Welded Construction).
D8247200	- Schematic, Wiring Diagram, Cart-Type,Trailer, 24 Volts (Typical).

(Copies of drawings required by contractors in connection with specific acquisition functions should be obtained from the USA Tank Automotive Command, ATTN: AMSTA-MD, Warren, MI 48397-5000.)

DEPARTMENT OF TRANSPORTATION (DOT)

Motor Carrier Safety Regulations.

(Application for copies should be addressed to the Superintendent of Documents, Government Printing Office, Washington, DC 20402.)

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the currentversion before use.

2.2 Non-Government publications. The following document(s) form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the DODISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

B 16.1 - Cast Iron Pipe and Flanged Fittings, Class 24, 125, and 800.

(Application for copies should be addressed to the American National Standards Institute, 1430 Broadway, New York, NY 10018.)

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME Boiler and Pressure Vessel Code, Section IX

(Application for copies should be addressed to the American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.)

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

A 36 - Structural Steel.
A 48 - Gray Iron Castings.
A 269 - Seamless and Welded Austenitic Stainless Steel Tubing for General Service.
A 278 - Gray Iron Castings for Pressure-Containing Parts for Temperatures up to 650 °F (345 °C).
A 283 - Low and Intermediate Tensile Strength Carbon Steel Plates, Shapes, and Bars.
A 331 - Steel Bars, Alloy, Cold-Finished.
A 827 - Plates, Carbon Steel, for Forging and Similar Applications.
B 584 - Copper Alloy Sand Castings for General Applications.

(Application for copies should be addressed to American Society For Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1 Structural Welding Code - Steel.

(Application for copies should be addressed to the American Welding Society, 550 N.W. LeJeune Road, P. O. Box 351040, Miami, FL 33135.)

HYDRAULIC INSTITUTE

Standards of the Hydraulic Institute.

(Application for copies should be addressed to the Hydraulic Institute, 122 East 42nd Street, New York, NY 10017.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

SOCIETY OF AUTOMOTIVE ENGINEERS (SAE)

J429 - Mechanical and Material Requirements for Externally Threaded Fasteners.
J614 - Engine and Transmission Dipstick Marking.
J702 - Brake and Electrical Connection Locations - Truck-Tractor and Trailer.

(Application for copies should be addressed to the Society of Automotive Engineers, 400 Commonwealth Drive, Warrendale, PA 15086.)

TIRE AND RIM ASSOCIATION (TRA)

TRA Yearbook.

(Application for copies should be addressed to the Tire and Rim Association, 3200 West Market Street, Akron, OH 44313.)

(Non-Government standards and other publications are normally available from the organizations that prepare or distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this document and the references cited herein, (except for related associated detail specifications, specification sheets or MS standards), the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 Description. The pumping unit shall consist of a centrifugal pump and a diesel engine (see 3.12). The pumping unit shall be either skid mounted or wheel mounted (see 3.13).

3.2 First article. Unless otherwise specified (see 6.2), a pumping unit shall be subjected to first article inspection (see 6.3) in accordance with 4.3.

3.3 Material. Material shall be as specified herein. Materials not specified shall be selected by the contractor and shall be subject to all provisions of this specification.

3.3.1 Material deterioration and control. The pumping unit shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide protection against the various forms of corrosion and deterioration that may be encountered in any of the applicable storage and operating environment to which the item may be exposed.

3.3.2 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion. Dissimilar metals and methods of protection are defined and detailed in MIL-STD-889.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

3.3.3 Identification of materials and finishes. The contractor shall identify the specific material, material finish or treatment for use with components and subcomponents, and shall make information available, upon request, to the contracting officer or designated representative.

3.3.4 Recovered materials. For the purpose of this requirement, recovered materials are those materials which have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the pump may be newly fabricated from recovered materials to the maximum extent practicable, provided the pumps produced meets all other requirements of this specification. Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the pumps.

3.4 Environmental conditions.

3.4.1 Operating temperature. The pumping unit shall perform as specified herein in any ambient temperature from +32 to +130 °F (0 to 54 °C).

3.4.2 Storage temperature. The pumping unit shall not be damaged by storage under the following conditions:

a. High temperature: +155 °F (68 °C) for not less than 12 hours.
b. Low temperature: to -65 °F (-54 °C) for not less than 24 hours without benefit of solar radiation.

3.5 Safety. All shafts or rotating or moving parts of the pumping unit shall be guarded when such parts are exposed to contact by personnel or otherwise create a hazard. All hot surfaces of the equipment, including exhaust pipes exposed to contact by personnel or which create a fire hazard, shall be fully guarded or insulated. Fuel tanks shall be located in a manner which will not allow spills or overflows to run into the engine, exhaust, or electrical equipment. Exhaust or discharges from the equipment shall be directed so that they do not endanger personnel or obstruct the view of the operator. Electrical equipment shall be effectively guarded and grounded to protect all persons and objects from electrical shock hazard. Battery terminals and cable connections shall be provided with non-conductive covers.

3.6 Human factors engineering. The pumping unit shall conform to the human factors engineering design criteria as described in MIL-STD-1472. Special design emphasis shall be given to simplicity of design (4.6), safety (4.8), Ruggedness (4.9), design for NBC survivability (4.10), general criteria (5.4.1), labeling (5.5), anthropometry (5.6), design for maintainer (5.9), and hazards and safety (5.13) of MIL-STD-1472, as applicable. The pumping units shall be operable and maintainable by 5th through 95th percentile male and female personnel dressed appropriately for the environments of intended use.

3.7 Noise limits. Noise levels produced by the pumping assembly shall comply with the requirements of MIL-STD-1474, with the exception of 5.2, 5.3, and 5.4, when tested in accordance with 4.5.2.10. The noise level at the operator's position and occasionally occupied positions shall not exceed Category D of MIL-STD-1474 (see 6.11). Noise hazard caution signs shall be provided in accordance with MIL-STD-1474, 4.2, when applicable (see 6.11).

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the current version before use.

3.8 Reliability. The specified mean-time-between-failure (MTBF) shall be 140 hours when the pumping unit is tested as specified in 4.5.2.11.

3.9 Maintainability.

3.9.1 Maintenance ratio. The pumping unit shall have a maintenance ratio of not more than 0.08. Maintenance ratio is defined as the ratio of the total active maintenance man-hours required (scheduled and unscheduled) to the total operating time. Man-hours for repair of replaced components and scheduled before-and-after operation checks are excluded. A maintenance schedule shall be furnished prior to the start of any testing.

3.10 Ease of maintenance. All major assemblies and installed attachments shall be accessible for maintenance, repair, and replacement without the removal of other major assemblies and installed attachments not normally removed. Covers or plates which must be removed for component adjustment, repair, replacement, or maintenance shall be equipped with quick-disconnect fasteners. Drain outlets shall be located for accessibility. Provisions shall be made to permit the use of receptacles for collecting drainage. Design for maintainability shall conform to 3.6.

3.11 Pumps. The pumps shall be integral self-priming of the single-stage single-suction centrifugal type. Each pump shall be provided with replaceable wearing surfaces and a pump case drain port and plug. The drain port shall be internally threaded with American standard taper pipe threads (NPT) and shall be of such size and located so as to drain the pump case in not more than 2 minutes. The drainplug shall be a square-head pipe plug conforming to WW-P-471, type A, class A, material B, and finish U. When the drainplug is in the volute passage, the plug shall be flush with the inner surface of the pump case. The direction of suction of each pump shall be horizontal. The direction of discharge of each pump shall be horizontal either by the design of the pump case or by the use of fittings. The suction and discharge fittings shall be the same nominal size as the suction and discharge ports of the pumps.

3.11.1 Size 4-inch suction and discharge pumping unit. The size 4 pumping unit shall have 4-inch nominal pipe size suction and discharge ports. The suction and discharge ports shall be internally threaded NPT. The capacity of the size 4 pump shall be as shown in figure 1. The ports shall be appropriately labeled "SUCTION" and "DISCHARGE" in accordance with 3.6. A check valve shall be provided on the suction inlet of each pump. When subjected to a static discharge head equal to the maximum total head indicated on figure 1, as applicable, the valve shall prevent siphoning of water from the pump case and shall not leak or show permanent deformation of the body, cover, seat, or any of its components.

3.11.2 Size 6-inch suction and discharge pumping unit. The size 6 pumping unit shall have 6-inch nominal pipe size suction and discharge ports. The suction and discharge ports shall have cast-iron flanges conforming to ANSI B16.1, class C-125 pounds. The capacity of size 6 pumps shall be as shown in figure 2. The ports shall be appropriately labeled "SUCTION" and "DISCHARGE" in accordance with 3.6.

3.11.2.1 Check valve. Unless otherwise specified (see 6.2), a check valve shall be installed in the suction end of each size 6 pumping unit. The check valve shall conform to MIL-V-18436, group B, type I, style A, class 250.

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the currentversion before use.

3.11.2.2 Impeller shaft. The impeller shaft shall be steel alloy conforming to ASTM A 331, grade 4140. The shaft shall have an ultimate tensile strength of not less than 130,000 psi.

3.11.2.3 Coupling. A flexible or spline-type coupling shall be provided which shall enable the pump and bearing housing to be removed from the engine as a unit by uncoupling the drive half from the driven half of the coupling. The coupling shall be the dry type and shall provide for misalignment and end float. The coupling shall transmit power from the engine to the impeller shaft through an arrangement which will reduce transmission of torsional vibration. The coupling shall have a horsepower rating in excess of the maximum brake horsepower required by the pump.

3.11.2.4 Intermediate bearing housing. Close-coupling shall be accomplished through the use of an intermediate bearing housing. The housing shall mount directly to the engine flywheel housing and to the pump case. The housing shall be provided with antifriction bearings of such size and type so as to absorb the maximum radial and thrust loads imposed by the pump impeller. The bearings shall be either sealed for life or in a grease-filled enclosure that will not require periodic refilling except when the bearings are removed from the enclosure. The housing shall be cast iron conforming to ASTM A 48, class 30.

3.11.3 Hydrostatic pressure. The pumps shall not leak or show permanent deformation when subjected to an internal hydrostatic pressure equal to 1-1/2 times the shutoff head developed at full throttle operation.

3.11.4 Pump case. The pump case shall be an iron casting conforming to ASTM A 278, class 20. The pump case shall be provided with replaceable wearing rings, or wearing plates. The wearing rings shall be bronze conforming to ASTM B 584, alloy C83600. The wearing plates shall be steel conforming to ASTM A 827, No. UNS G10200.

3.11.5 Pump impeller. Unless otherwise specified herein, the impeller shall be an iron casting conforming to ASTM A 278, class 20, and shall be the semi-open vane nonclogging type. The impeller shall be keyed to the impeller shaft and held in position by a lock-cap nut with a shaft-protecting washer, or the impeller shall be screwed on the shaft in a direction opposite to the direction of rotation with enough piloting surface to insure that the impeller is normal to the axis of the shaft.

3.11.5.1 Impeller balancing. The impeller, mounted on its shaft, shall be dynamically balanced. The out-of-balance condition shall be not more than 0.25 ounce-inch at the rated operating speed of the pump.

3.11.6 Pump shaft sleeve. A shaft sleeve shall be provided between the pump shaft and the seal. The shaft sleeve shall be aluminum-bronze or corrosion-resistant steel conforming to ASTM A 269, grade optional, as specified (see 6.2).

3.11.7 Pump shaft seal. The pumps shall be provided with a mechanical-type self-lubricating seal to prevent leakage. The seal shall be self-aligning and shall be removable from the pump shaft without disassembling the pump from the engine mounting face. The adjustment of the sealing surface shall be independent of the impeller adjustment. The seal may be fabricated from dissimilar

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

noncorrosive materials of different hardness properties. All components of the mechanical-type seal shall be resistant to corrosion.

3.11.8 Priming. When operating at conditions equivalent to sea level atmospheric conditions of 29.92 inches of mercury, and with water with a specific weight of 62.3 pounds per cubic foot at a temperature of 68 °F (20 °C), the pump shall perform as follows:

a. Prime in not more than 3 minutes when subjected to a static suction lift equivalent to 25 feet, using 30 feet of appropriate size suction line and one elbow.
b. Prime in not more than 1 minute when subjected to a static suction lift equivalent to 10 feet, using 15 feet of appropriate size suction line and one elbow.

3.11.9 Manual pressure relief valve. A manually operated pressure relief valve shall be provided on the discharge outlet of each pump to provide for quicker hose removal when the pump is shut down at high head conditions. The pressure relief port shall be internally threaded with American standard taper pipe threads (NPT) and located so as to drain the water downward when the pressure relief valve is opened.

3.12 Engine. The pumping unit shall be powered by a diesel engine, selected in accordance with MIL-STD-1410, class II. The diesel engine, including all systems, components, accessories, and auxiliaries, shall be a heavy-duty standard commercial-industrial type capable of operating on JP-8 conforming to MIL-T-83133 and on diesel fuel conforming to VV-F-800 and lubricating oil as specified in 3.15.1. If the normal operating oil pressure of the engine is 15 psi or above, a full-flow oil filter shall be furnished. A dry-type air cleaner shall be furnished. A cold starting aid in accordance with MIL-E-52649, type III, electrically operated shall be furnished. A primary, water-separating type and a secondary type fuel filter, both with drainage provisions shall be furnished. The temperature of the oil in the oil sump shall not exceed 250 °F and the temperature of the coolant in the radiator top tank, if liquid cooled, shall not exceed 210 °F when the engine is operated under any conditions specified herein. The engine shall be equipped with a standard 12-volt negative ground electrical starting and charging system. The engine shall be equipped with a housing. When wheel mounting is specified, the engine radiator or cooling air inlet shall have a hinged door that can be latched open and closed. The door shall be marked in bold lettering: "OPEN WHEN OPERATING". The engine shall be the same engine which has been used in the manufacturer's standard commercial pump of the same size and capacity for at least 1 year.

3.12.1 Power and speed rating. The power and speed rating of the diesel engine shall be such that operation of the pump under any of the operating conditions specified herein will not require horsepower in excess of the continuous rating of the engine as previously published by the engine manufacturer, or 85 percent of the engine manufacturer's previously published maximum horsepower rating at the applied speed, whichever is less.

3.12.2 Filling, draining, and checking provisions. The engine crankcase shall be equipped with a dipstick to determine the fluid levels. The dipstick shall be labeled in accordance with SAE J614. The crankcase drain outlet shall be filled with a magnetic drainplug having either tapered pipe threads or shoulder and

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the current version before use.

gasket, size conforming to MS35844 or MS49006. In lieu of a magnetic drainplug, a separate magnetic device may be fastened inside the enclosure at or near the bottom and shall be removable for cleaning without removal of other parts or components. The separate magnetic device may be used if and only if the device is as effective and as accessible as a magnetic drain plug. Each drainplug or valve shall be located so that removal of the plug or valve will result in complete drainage of the fluid from the enclosure. When the pumping unit is in a level position, drainage of fluids shall be to a container without draining on or over any part of the pumping unit. Integral tubes, hose, or troughs may be used to convey the fluids from the drain outlet. Accessibility to the fill opening, the fluid level checking device, and the drainplug or valve shall be provided without removal or adjustment of accessories and parts except plates equipped with hand-operable quick-disconnect fasteners. Access covers shall be labeled to indicate the items accessed through them in accordance with 3.6. The drain outlets for the engine cooling system of liquid-cooled engines shall provide complete drainage of the system. The radiator drain shall be such that coolant will not drain onto any part of the pumping unit. An extension hose shall be permitted.

3.12.3 Instrumentation. An instrument panel shall be furnished and shall be equipped with the following instruments:

a. Lubricating oil pressure gage.
b. Tachometer.
c. Ammeter, battery charging.
d. Hourmeter.
e. Cooling liquid temperature indicator.
f. Air cleaner restriction indicator conforming to MS53063.
g. Fuel pressure gage.
h. High temperature and low oil pressure shut off indicator lights (see 3.12.4).
i. Manual engine controls (see 3.12.5).
j. Battery disconnect switch (see 3.12.7).

The tachometer and hourmeter may be incorporated into one instrument provided the hourmeter corresponds to the clock time at the normal pump operating speed. The instrument panel shall be designed in accordance 3.6.

3.12.4 Control device system. The liquid-cooled engines shall be provided with a high cooling liquid temperature device for stopping the engine if the engine reaches an overheated condition. The air-cooled engines shall be provided with a high cylinder head temperature device for stopping the engine if the engine reaches an overheated condition. Both liquid- and air-cooled engines shall be provided with a low lubricating oil pressure control device for stopping the engine when a low lubricating oil pressure condition exists. Each safety device shall have individual signal lights and manual reset (if reset is required) mounted on the instrument panel. The signals shall indicate which condition has caused the shutdown and shall be marked as to their function in accordance with 3.6. All control devices shall be designed to actuate at the engine manufacturer's recommended temperatures and pressures.

3.12.5 Manual engine controls. Manual engine controls for diesel engines shall include a switch to activate the engine electrical circuits, including fuel solenoid valve, safety control devices, and starter and battery charging circuits. A waterproof push button starter switch shall be furnished. The throttle shall be

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

the micrometer type and shall permit operation of the engine at any selected governed speed from idling to maximum governed speed. The throttle shall be provided with a convenient and positive means for locking in any position. The engine controls shall be in accordance with 3.6.

3.12.6 Fuel tank. A corrosion-resisting fuel tank shall be furnished. The capacity of the tank shall be sufficient for not less than 4 hours of continuous operation at the rated load. The fuel tank shall be equipped with a cap conforming to MS35645, a strainer, and a neck conforming to MS35644. The tank shall be provided with a hand-operated fuel shutoff valve attached directly to the tank and a mechanically actuated fuel gage mounted on the tank. The fuel tank outlet shall be not less than 1/2-inch above the bottom of the tank. The tank outlet or the fuel line shall be provided with a 3-way selector valve and a 1/2-inch 20 SAE flared fitting for connection with an auxiliary fuel supply. A corrosion-resisting circular metal face plate shall be mounted on the fuel selector valve and shall be marked "OFF", "UNIT TANK", and "AUXILIARY". A label stating "DIESEL or JP-8 FUEL ONLY", as appropriate, shall be provided near the fuel fill port in accordance with 3.6.

3.12.7 Battery-disconnect switch. The pump unit shall be provided with a battery-disconnect switch to permit disconnecting the battery in the event of an emergency. The switch shall be installed in a convenient position on the instrument panel and shall withstand the full cranking motor load. The switch shall be labeled as to function and the ON and OFF positions shall be labeled in accordance with 3.6.

3.13 Mounting. The pumping unit shall be skid mounted or wheel mounted, as specified (see 6.2).

3.13.1 Skid mounted. The skid base shall be structural steel conforming to ASTM A 283, grade D. The skid base shall maintain alinement when the pumping unit is being towed and handled in the field. The skid shall be provided with upturned ends and shall be equipped with a retractable towing eye at each end of the skid base. The retractable towing eyes shall be located so that the possibility of overturning the pumping unit is minimized and positive tracking is assured when the unit is being towed. Each towing eye shall be a U-bolt with an opening of not less than 2-1/2 inches in diameter when extended.

3.13.2 Wheel mounted. The pumping unit shall be mounted on two wheels, as specified herein.

3.13.2.1 Gross vehicle weight. The gross vehicle weight (GVW) of the 2 wheel-mounted pumping unit shall not be more than the following:

a. 2000 pounds for size 4.
b. 3500 pounds for size 6.

3.13.2.2 Rated payload. The rated payload of the trailer for the 2-wheel-mounted pumping unit for unrestricted cross-country operations shall not be less than the following:

a. 1000 pounds for size 4.
b. 2500 pounds for size 6.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

3.13.2.3 Lunette loads. The load on the lunette shall be as follows:

a. The maximum load shall be not more than 200 pounds and the minimum load shall be not less than 100 pounds for size 4.
b. The maximum load shall be not more than 350 pounds and the minimum load shall be not less than 150 pounds for size 6.

3.13.2.4 Dimensions. The 2-wheel-mounted pumping unit shall conform to the following limitations:

Overall length, maximum	- 100 inches
Overall width, maximum	- 75 inches
Overall height, maximum	- 70 inches
Overall clearance, minimum	- 14 inches
Tread, axle, minimum	- 62 inches

3.13.2.5 Mobility characteristics. When towed by a military cargo truck (see 3.22), the pumping unit shall perform without malfunction, damage, or permanent deformation to any of its components when subjected to the following conditions (see 6.9):

a. Cross-country operation. Over open, rolling, hilly, or cross-country terrain at speeds up to 20 miles per hour (mph).
b. Unimproved road operation. Over unimproved and secondary roads at speeds up to 30 mph.
c. Highway operation. Over smooth hard-surfaced roads at speeds up to 50 mph.

3.13.2.6 Trailing and turning ability. When coupled to a military cargo truck (see 3.22), the pumping unit shall track without bottoming, weaving, or sidesweying. The turning clearance of the pumping unit shall be such that, when the pumping unit becomes jackknifed, its longitudinal centerline shall form a minimum horizontal angle of 40 degrees to the right and 40 degrees to the left with the longitudinal centerline of the truck. Turns shall be performed without interference or damage to either the pumping unit or the truck at the truck's minimum turning radius.

3.13.2.7 Frame. The frame shall be structural steel conforming to ASTM A 36 or a material of comparable strength and toughness and shall be suitable for the installation of the pump, engine, and running gear.

3.13.2.8 Lunette and support legs. The pumping unit shall be equipped with a lunette and three support legs.

3.13.2.8.1 Lunette. The lunette shall conform to MS51339 and shall be installed so that the offset of the eye may be reversed.

3.13.2.8.2 Front support leg (lunette end). A front support leg and bracket assembly shall be provided and shall be installed so that the level ground height of the lunette shall be 15 inches, ±1/2 inch, when rotated to the lower position. The leg shall fold to provide ground clearance and not reduce the angle of approach.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

3.13.2.8.3 Rear support legs. Two rear support legs shall be provided to prevent the frame from tipping over when hose or pipe is coupled to the pump or when the pump or bearing housing is being filled or serviced by personnel. The legs shall be capable of being securely locked in both the retracted and extended positions. The locking device and the legs shall be captive-chained to the pump unit frame to prevent loss. The legs shall be capable of being adjusted in 2-inch increments from the fully retracted position to the fully extended position (and vice versa) by hand. When in the fully retracted position, the jack stand shall not protrude more than 2 inches below the bottom of the side member of the frame.

3.13.2.9 Intervehicular connectors. Intervehicular connectors shall be installed on the pumping unit so that they shall be extended between 36 and 42 inches toward the prime mover from the center of the lunette eye. A clip, in accordance with SAE J702, shall be furnished to securely hold the electrical harness plug and to double the harness back on the tongue or frame. these connectors shall not interfere with vehicle operations when tested in accordance with 4.5.2.6.2.

3.13.2.10 Safety chains. The pumping unit shall be equipped with two safety chains conforming to Drawing C7339458, except that the length of each chain shall be the same as the intervehicular connectors. The forged eyes of the safety chains shall be perimeter welded or bolted to the tongue or frame.

3.13.2.11 Axle assembly. The axle assembly shall include spindle, hub, backing plate, brakes, and wheel components, as specified herein. The rated capacity of the axle shall be not less than the following:

a. 3000 pounds for size 4.
b. 5000 pounds for size 6.

3.13.2.11.1 Suspension. The axle suspension system shall be of a spring capacity to sustain the rated payload under the performance characteristics specified herein without transmitting damaging shock to the pumping unit. The suspension shall result in as low a center of gravity as possible without affecting the ground clearance requirements. Rubber bumper stops shall be provided to prevent metal-to-metal bottoming of the suspension.

3.13.2.11.2 Shock absorbers. Two telescoping-type shock absorbers without linkage shall be mounted on the frame and shall control jounce and rebound.

3.13.2.11.3 Wheels. Wheels shall be in accordance with the guidelines of the Tire and Rim Association. The weight of the pumping unit shall be proportionately distributed over the wheels so as to assure proper balance.

3.13.2.11.4 Tires. Tires shall be in accordance with the guidelines of the Tire and Rim Association and shall be of sufficient size and durability to support loads in off-road conditions with not more than 50 psi air pressure. The tires shall contain properly sized heavy duty tubes. Tire pressure shall be indicated directly above the tires "T.P. 50 PSI" in 1-inch high letters. Tires furnished shall not be more than 12 months old on the date of shipment and shall be for all terrain conditions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

3.13.2.11.5 Wheel assembly balancing. Each assembly of tire, tube, wheel, and hub components shall be balanced to preclude wheel tramp and drumming at road speeds up to 50 mph.

3.13.2.12 Brake system. The 2-wheel-mounted pumping unit shall be equipped with an air-over-hydraulic brake system. All components and lines of the system shall be installed and protected so as to prevent damage or malfunction from water, ground obstructions, and debris. The air-over-hydraulic power cluster(s) shall be the tandem master cylinder type or, at the contractor's option, shall consist of two power clusters, each having a single master cylinder. A rupture or leakage-type failure of any single hydraulic system pressure component shall not prevent actuation of the other system and the actuated brakes shall not cause unbalanced braking or swerving of the pumping unit. Not less than 5 inches of slack in the flexible air lines shall be provided at each of the emergency relay valve connections to permit interchange of the various makes of MS53004 valves. All brake lines shall be installed to facilitate replacement from bulk supply. All nonlubricated metal surfaces that are enclosed by the brake drum and the backing plate shall be coated with primer conforming to MIL-P-62669. Moving parts shall be coated with grease conforming to MIL-G-10924.

3.13.2.12.1 Braking ability. The combined service brakes of the assembled towing and towed vehicle shall control, decelerate, and stop the assembly in conformance to DOT Motor Carrier Safety Regulations, except that the stopping distance shall be accurately measured from the point of initial application of the brake pedal to the stopping point. When actuated, the emergency breakaway system shall produce emergency brake application in accordance with DOT Motor Carrier Safety Regulations.

3.13.2.12.2 Parking brake. The pumping unit shall be equipped with a parking brake with positive locking device. The parking brake shall be capable of holding the pumping unit on a 20-percent-grade dry paved ramp, while heading either up or down ramp, without evidence of slippage.

3.13.2.13 Vehicular electrical system. The pumping unit shall be equipped with a 24-volt complete vehicular electrical system conforming to Drawing D8347200, and as specified herein. All wiring and all components shall be located or guarded to provide protection against damage and breakage. The friction retainment wiring connectors shall conform to MS33800 and shall be lubricated prior to assembly with paste-type electrical insulation compound. Each connector assembly shall be secured by the clip shown on Drawing D8347200. All wires shall be number coded near each connection in accordance with the wiring diagram and Drawing C7070301. Wires and harnesses shall be fastened by the support strap at intervals of not more than 3 feet and shall be routed within the framing where possible. Except for the intervehicular harness, unsupported wires are not acceptable. Grommets shall be installed where wires or harnesses pass through sheet metal and framing members.

3.13.2.14 Lighting. The pumping unit shall be equipped with a service and blackout lighting system. The service lighting shall conform to the requirements of DOT Motor Carrier Safety Regulations. Two taillamps conforming to MS52125 shall be installed at the rear of the pumping unit as far apart as possible to indicate vehicle width and for turn-signal operation. A blackout stoplight conforming to MS52125 shall be installed to the left of the right taillamp.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

3.13.2.15 Reflectors. Reflectors conforming to MIL-R-12144, types I and II, shall be furnished and shall be mounted in accordance with DOT Motor Carrier Safety Regulations. In addition, one amber reflector shall be mounted facing forward on each front corner and one red reflector shall be mounted on each side near the rear of the pumping unit and shall be installed at approximately the same height as those installed on the rear. All reflector mounting locations shall give the maximum reflected warning.

3.14 Electromagnetic interference. The electromagnetic interference emission characteristics of the pumping unit shall conform to MIL-STD-461, class C1.

3.15 Lubrication.

3.15.1 Lubricants. The pumping unit shall operate as specified herein when serviced with the following military lubricants:

Engine: MIL-L-2104 or MIL-L-46167.
Axle: MIL-L-2104, MIL-L-2105, or MIL-L-46167.
Hydraulic system: MIL-L-2104 or MIL-L-46167.
Grease lubrication: MIL-G-10924 or MIL-G-23827.

3.15.2 Lubrication fittings. Lubrication fittings shall conform to MIL-F-3541, type I, II, or III. Fittings shall be located in a protected position and shall be accessible to a hand-operated grease gun conforming to MIL-G-3859 with a 10-inch flexible extension. Accessibility to fittings shall be provided without the removal or adjustment of accessories or parts. Access panels equipped with hand-operable quick-disconnect fasteners may be used to provide accessibility if and only if the panels conform to 3.6. A chart indicating the type and quantity of engine oil required shall be provided near the oil fill port in accordance with 3.6.

3.15.3 Pressure-release device. A pressure-release device shall be provided where the use of pressure lubricating equipment could damage grease seals or other parts.

3.16 Transportability. The pumping units shall be capable of being transported by trains and must be capable of withstanding the impact forces encountered in shipment without damage or permanent deformation. The pumping units shall be equipped with tie-down and slinging provisions.

3.16.1 Slinging provisions. The slinging provisions shall conform to MIL-STD-209, class 1 or 3, type IV. The provisions shall enable the complete pumping unit to be lifted in the normal operating position. The provisions shall be located so that not less than 1-inch clearance is maintained between slings and all exterior parts and shall be fastened to members which will withstand stresses in the amount and direction of pull specified for the provisions without weld failure, permanent deformation, cracking, loosening, or breaking of the provision or its connecting structural components. Slinging provisions may also be used as tiedown provisions when such provisions meet the requirements specified in 3.16.2. All lift points shall be labeled "LIFT HERE". The labels shall conform to 3.6.

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the currentversion before use.

3.16.2 Tiedown provisions. The tiedown provisions shall conform to MIL-STD-209, class 2 or 3, type IV equipment. The tiedown provisions shall satisfactorily complete the pull testing as specified without weld failure, permanent deformation, cracking, loosening, or breaking of the provision or its connecting structural components. Tiedown points shall be labeled "LIFT/TIEDOWN HERE". The labels shall conform to 3.6.

3.16.3 Rail transportability. When specified (see 6.2). the unpackaged pumping unit shall be rail transportable in CONUS and NATO countries without restrictions. When loaded on a 50-inch (127 cm) high rail car, the pumping unit shall have a dimensional profile within the AAR outline diagram and the Gabarit International de Chargement (GIC) or PPI, as specified in MIL-STD-1366. The pumping unit shall be capable of withstanding the shock loads resulting from rail impact testing specified in 4.5.2.13 without failure, damage, or permanent deformation.

3.17 Identification marking. The pumping unit shall be identified in accordance with MIL-STD-130. The marking shall be applied to the pumping unit on plates conforming to MIL-P-514, type I, style 1, composition C, of type I, grade A, class 1 material. Each plate shall be attached by screws, bolts, or rivets in a location where the plate will be both visible and legible.

3.17.1 Identification marking of pump inlet and outlet. The pump suction and discharge shall be identified by markings integrally cast in the pump or by plates specified in 3.17 permanently secured in place by means of metal fasteners.

3.17.2 Wheel mount marking. Marking of the wheel-mounted pumping unit shall be in accordance with MIL-STD-642. The gross vehicle weight shall be so marked on each side of the unit in such a manner as to be readily discernible. The prescribed tire pressure shall be marked on the side near the tires.

3.17.3 Skid mount marking. The gross weight shall be stenciled near the center on both sides of each skid-mounted pumping unit. The letters shall be Gothic capitals and the numerals shall be Arabic. The letters and numerals shall be 2 inches high where space permits.

3.18 Shipping data plate. A shipping data plate conforming to MIL-P-514, type III, composition C, of type I, grade A, class 1 material shall be provided. In addition, the plate shall show the silhouette of the pumping unit in transport position, indicating the center of gravity and the location and capacity of the slinging and tiedown provisions. Each plate shall be attached by screws, bolts, or rivets in a location where the plate will be both visible and legible.

3.19 Treatment and painting. The portions of the pumping unit normally painted internally and externally shall be cleaned, treated, and painted in accordance with MIL-T-704, type F or G, as applicable. Unless otherwise specified (see 6.2), top coat color shall be green 383 conforming to MIL-C-46168, except for surfaces which will reach a temperature of 350 °F (177 °C) or greater at any time during operation. These surfaces shall be coated green 383 in accordance with MIL-P-14105. The surfaces coated in accordance with MIL-P-14105 shall not be coated with an epoxy primer.

3.20 Toolbox. A toolbox made of steel not less than 0.071 inch in thickness or aluminum shall be attached to the pumping unit. The toolbox shall contain all the tools and operating and maintenance manuals required for the general maintenance

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

and operation of the pumping unit (see 6.5 and 6.6). The toolbox lid shall be secured to one edge of a side by a continuous hinge conforming to MS35829 extending the full length of the box edge. The lid shall be held in the closed position by one fastener. The hasp shall be suitably located to secure the lid to the box and to accommodate a lock. The toolbox shall be securely mounted in an accessible protected location permitting the lid to be opened through an arc of 90 degrees. The lid shall be held fully open by the weight of the lid or a suitable fastener. Adequate drainage of the toolbox shall be provided.

3.21 Government-loaned property. When specified (see 6.2), one truck, cargo, of the current design and suitable size military vehicle shall be loaned by the Government (see 6.4).

3.22 Threads. Screw threads shall be in accordance with FED-STD-H28.

3.23 Workmanship. All parts, components, and assemblies of the pumping unit, including castings, forgings, molded parts, stampings, bearing seals, machined surfaces, and welded parts, shall be clean and free from sand, dirt, fins, sprues, scale, flux, and other harmful extraneous material. All edges shall be rounded or beveled.

3.23.1 Welding, welders, and welding operators.

3.23.1.1 Welding. The surfaces of parts to be welded shall be free from rust, scale, paint, grease, mill scale that can be removed by chipping and wire brushing, and other foreign matter. Welds shall transmit stress without permanent deformation or failure when the parts connected by the welds are subjected to proof and service loading. Welding procedures shall be qualified in accordance with the applicable ASME or AWS code, and all welding and welds shall be in accordance with ASME or AWS code.

3.23.1.2 Welders and welding operators. Welder and welding operators assigned to manual welding work covered by this specification shall be qualified in accordance with AWS D1.1 or the ASME Boiler and Pressure Vessel code for the materials joined and the type of welding operation to be performed. The contractor is responsible for determining that automatic welding equipment operators are capable of producing quality welds in accordance with AWS and ASME codes (see 6.12).

3.23.2 Bolted connections. Boltholes shall be accurately formed and shall have the burrs removed. Washers or lockwashers shall be provided where necessary. Matching thread areas securing bolts conforming to SAE J429 or capscrews shall be of sufficient strength to withstand the tensile strength of the bolt. All fasteners shall be correctly torqued and shall have full thread engagement. Bolts shall protrude not more than 2 full threads.

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the currentversion before use.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items shall meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.1.2 Component and material inspection. The contractor is responsible for insuring that components and materials used are manufactured, examined, and tested in accordance with referenced specifications, standards, and drawings, as applicable.

4.2 Classification of inspections. Inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.3).
b. Quality conformance inspection (see 4.4).
c. Inspection of packaging (see 4.6).

4.3 First article inspection.

4.3.1 Examination. The first article pumping unit shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.3.2 Tests. The first article pumping unit shall be tested as specified in 4.5.2 through 4.5.2.13. Failure of any test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sample size shall be in accordance with MIL-STD-105, table I and table IIa. A lot shall be accepted when zero defects are found and rejected when one or more defects are found.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined for the defects specified in 4.5.1.

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the currentversion before use.

4.4.3 Tests.

4.4.3.1 Individual. Each pumping unit shall be subjected to the tests specified in 4.5.2.2.1 and 4.5.2.2.2.

4.4.3.2 Samples. Samples selected in accordance with 4.4.1 shall be tested as specified in 4.5.2.5 through 4.5.2.8.

4.5 Inspection procedure.

4.5.1 Examination. The pumping units shall be examined as specified herein for the following defects:

101. Materials not as specified (see 3.3).
102. Materials are not corrosion resistant or treated to be made corrosion resistant for the applicable storage and operating environment (see 3.3.1).
103. Dissimilar metals as defined in MIL-STD-889 are not effectively insulated from each other (see 3.3.2).
104. Contractor does not have documentation available for identification of material, material finishes or treatments (see 3.3.3).
105. Used, rebuilt or remanufactured components, pieces, or parts incorporated in the pumping unit (see 3.3.4).
106. Safety not as specified (see 3.5).
107. Human factors engineering not as specified (see 3.6).
108. Major assemblies, installed attachments, and drain outlets not accessible for maintenance, repair, or replacement (see 3.10).
109. Removable covers and plates not equipped with quick-disconnect fasteners (see 3.10).
110. Pump not as specified (see 3.11).
111. Pump fittings not the same size as the pump suction and discharge ports (see 3.11).
112. Suction and discharge ports not as specified (see 3.11.1 and 3.11.2).
113. Check valve not as specified (see 3.11.2.1)
114. Impeller shaft not as specified (see 3.11.2.2)
115. Coupling not as specified (see 3.11.2.3).
116. Intermediate bearing housing not as specified (see 3.11.2.4).
117. Pump case not as specified (see 3.11.4).
118. Pump impeller not as specified (see 3.11.5).
119. Pump shaft sleeve not as specified (see 3.11.6).
120. Adjustment of pump shaft seal not independent of the adjustment of the impeller shaft (see 3.11.7).
121. Manual pressure relief valve not as specified (see 3.11.9).
122. Engine not as specified (see 3.12).
123. Doors for cooling air intake on wheel mounted unit missing or not as specified, or sign on doors missing (see 3.12).
124. Filling, draining, and checking of engine crankcase not as specified (see 3.12.2).
125. Instrumentation of the engine not as specified (see 3.12.3).
126. Engine safety devices missing or not as specified (see 3.12.4).
127. Manual engine controls not as specified (see 3.12.5).
128. Fuel tank not as specified (see 3.12.6).
129. Engine not equipped with 3-way fuel valve (see 3.12.6).
130. Battery-disconnect switch missing (see 3.12.7).
131. Skid mounting not as specified (see 3.13.1).

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the currentversion before use.

132. Wheel mounting not as specified (see 3.13.2).
133. Gross vehicle weight not as specified (see 3.13.2.1)
134. Rated payload not as specified (see 3.13.2.2).
135. Lunette loads not as specified (see 3.13.2.3).
136. Dimensions of wheel mounted unit not within tolerance specified (see 3.13.2.4).
137. Frame not suitable for installation of pump, engine, and running gear (see 3.13.2.7).
138. Lunette missing (see 3.13.2.8.1).
139. Front or rear support legs missing or not adjustable (see 3.13.2.8.2 and 3.13.2.8.3).
140. Intervehicular connectors not as specified (see 3.13.2.9).
141. Safety chains missing or not as specified (see 3.13.2.10).
142. Rated capacity of axle less than specified (see 3.13.2.11).
143. Rubber bumper stops not provided for axle suspension (see 3.13.2.11.1).
144. Shock absorbers not as specified (see 3.13.2.11.2).
145. Wheels not as specified (see 3.13.2.11.3)
146. Tires not as specified (see 3.13.2.11.4).
147. Wheel assembly balancing not as specified (see 3.13.2.11.5).
148. Brake system not as specified (see 3.13.2.12).
149. Parking brake positive locking device not provided (see 3.13.2.12.2).
150. Vehicular electrical wiring and lighting system not as specified on wheel mounted unit (see 3.13.2.13).
151. Lighting not as specified (see 3.13.2.14).
152. Reflectors not as specified or not mounted as specified on wheel mounted unit (see 3.13.2.15).
153. Lubricants not as specified (see 3.15.1).
154. Lubrication fittings not as specified or missing (see 3.15.2).
155. Pressure release device missing (see 3.15.3).
156. Slinging provisions not as specified (see 3.16.1).
157. Tiedown provisions not as specified (see 3.16.2).
158. Rail transport not as specified (see 3.16.3).
159. Identification marking or instruction plates missing or not as specified (see 3.17 through 3.17.3).
160. Shipping data plate not as specified (see 3.18).
161. Treatment and painting not as specified (see 3.19).
162. Tool box not as specified (see 3.20).
163. Screw threads not as specified (see 3.22).
164. Workmanship not as specified (see 3.23).
165. Welding and welds not as specified (see 3.23.1.1).
166. Welders and welding operators not qualified as specified (see 3.23.1.2).
167. Welders and welding operators not certified as specified (see 3.23.1.2).

4.5.2 Tests. Prior to any test, the complete pumping unit shall be lubricated and serviced. Lubrication shall be with the lubricants specified in 3.15. Servicing shall be in accordance with the contractor's recommended practice.

4.5.2.1 Engine. Prior to examination and tests of the pumping unit, the engine which will be installed in the first article units shall be tested in accordance with MIL-STD-1400, test method 2000 except that test method 2400 shall not apply. One engine out of each lot of 50 or less shall be tested in accordance with MIL-STD-1400, test method 3000. Each engine furnished, except the engines selected for the first article pumping units and production control tests (test method 3000), shall be tested in accordance with MIL-STD-1400, test method series

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the current version before use.

4000, except that the engine manufacturer's standard commercial run-in may be used in lieu of test method series 4000 provided it equals or exceeds the requirements of MIL-STD-1400, test method series 4000. Failure to meet any requirements in the above tests shall constitute failure of this test.

4.5.2.2 Pump preassembly.

4.5.2.2.1 Impeller. Prior to assembly, the pump impeller shall be tested for out-of-balance by a dynamometer at the operating speed of the pump. An out-of-balance condition of more than 0.25 ounce-inch shall constitute failure of this test.

4.5.2.2.2 Hydrostatic. Subject the pump to a hydrostatic pressure equal to 1-1/2 times the shutoff head obtained at full throttle operation. Leakage or permanent deformation of the pump shall constitute failure of this test.

4.5.2.2.3 Brake horsepower. Prior to assembling the pump to the engine, the brake horsepower required to operate the pump at rated capacity shall be determined. Nonconformance to 3.12.1 shall constitute failure of this test.

4.5.2.3 Electromagnetic interference. The pumping units shall be tested to determine conformance to 3.14. The contractor shall furnish the contracting officer a report of tests required by MIL-STD-461. Disapproval of the report shall constitute failure of this test.

4.5.2.4 Storage and operational temperature. Place the pumping unit in a shelter or container equipped for heating and cooling. Stabilize shelter or container temperature at 155 °F (68 °C) for not less than 12 hours. Lower and stabilize the pumping unit temperature at 130 °F (54 °C) and operate the pump for not less than 4 hours. Lower and stabilize the pumping unit temperature at 32 °F (0 °C) and operate pump for not less than 4 hours. Stabilize shelter or container at -65 °F (-54 °C) for 24 hours without benefit of solar radiation. Raise and stabilize the pumping unit temperature at 32 °F (0 °C) and operate pump for not less than 4 hours. Stabilize the pumping unit temperature at 130 °F (54 °C) and operate pump for not less than 4 hours. Nonconformance to 3.4.1 or 3.4.2 shall constitute failure of this test.

4.5.2.5 Performance. The performance test of the pumping unit shall be conducted in accordance with the applicable provisions of the test code for centrifugal pumps of the Standards of the Hydraulic Institute. All data shall be corrected to standard sea level atmospheric conditions of 29.92 inches of mercury and to the specific weight of water of 62.3 pounds per cubic foot at a temperature of 68 °F (20 °C).

4.5.2.5.1 Priming. The pumping unit shall be primed and operated under the conditions specified herein. Nonconformance to 3.11.8 shall constitute failure of this test.

4.5.2.5.2 Capacity. The pumping unit shall be primed and operated to determine which will be installed in the first article units shall be tested in accordance with MIL-STD-1400, test method 2000 except that test method 2400 shall not apply. One engine out of each lot of 50 or less shall be tested in accordance with MIL-STD-1400, test method 3000. Each engine furnished, except the engines selected for the first article pumping units and production control tests (test method 3000), shall be tested in accordance with MIL-STD-1400, test method series

Source: https://assist.dla.mil -- Downloaded: 202610-17T13:57Z
Check the source to verify that this is the current version before use.

4.5.2.5.3 Check valve. After the pump has been completely primed, subject the check valve to a maximum test pressure (total static discharge head) equal to the maximum total head as shown on the applicable figure. Shut off the pump and allow it to sit for not less than 30 minutes. Restart the pump. Determine whether the pump primes itself. Self-priming of the pump is an indication that the valve prevents siphoning of water from the pump case. Examine the check valve. Failure of the pump to prime itself, leakage, or permanent deformation of any component of the valve shall constitute failure of this test.

4.5.2.5.4 Pump case drain. With the pump case filled with water, remove the drainplug. Inability of the drain to remove all the water from the case in 2 minutes shall constitute failure of this test.

4.5.2.6 Mobility.

4.5.2.6.1 Skid tow. The pumping unit, mounted on skids, shall be towed over a concrete surface for a distance of not less than 100 feet. Evidence of damage to or permanent deformation of the skid mounting shall constitute failure of this test.

4.5.2.6.2 Trailer towing. The pumping unit, mounted on its trailer, shall be coupled to the Government-loaned truck (see 3.21) and shall be towed as follows:

a. Cross-country - 50 miles at 20 mph.
b. Unimproved road - 150 miles at 30 mph.
c. Paved highway - 200 miles at 50 mph.

After this portion of the test, perform 10 left-circle and 10 right-circle turns at minimum radius on surfaces specified in a, b, and c above. Nonconformance to 3.13.2.5 or 3.13.2.6 shall constitute failure of this test.

4.5.2.7 Tiedown provisions.

4.5.2.7.1 Test procedure. With the pumping unit anchored by means other than the tiedown being tested, apply the static loads specified in MIL-STD-209 to each provision. Measure the dimensions of the tiedowns.

4.5.2.7.2 Failure criteria. Weld failure, permanent deformation of the pumping unit or its tiedown provisions, breakage of the provisions, or nonconformance to MIL-STD-209 or 3.17 shall constitute failure of this test.

4.5.2.8 Slinging provisions.

4.5.2.8.1 Test procedure.

a. Lift the pumping unit and hold it in suspension in its normal travel position, using slings that converge not more than 24 feet above the lowest extremity of the pumping unit. Determine the forward angles of application for each provision. Measure the clearance between each sling and the pumping unit. Measure the eye openings and clearance dimensions of the provisions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

b. Restrain the pumping unit by anchoring the main frame and subject each slinging provision to a force of 2-1/2 times the load it carried when suspended. This force shall be applied in the direction as determined in a. above. An acceptable alternate method of test shall be to lift the pumping unit as in a. above and add weights to the pumping unit until the force on each provision is 2-1/2 times the initial force. Hold the pumping unit under either of the above loading conditions for not less than 90 seconds.

4.5.2.8.2 Failure criteria. Weld failure, permanent deformation of the pumping unit or any slinging provision, slings converging more than 24 feet above the lowest extremity of the pumping unit, and nonconformance to MIL-STD-209 or 3.16 shall constitute failure of this test.

4.5.2.9 Human factors engineering. The pumping unit shall be evaluated during the first article examination for compliance with 3.6. Nonconformance to 3.6 shall constitute failure of this evaluation.

4.5.2.10 Noise level test. Noise levels shall be measured in accordance with MIL-STD-1474, 5.1.2 and 5.5 requirements and reported in the format indicated by MIL-STD-1474, figure 11. As a minimum: noise levels shall be measured when equipment is operating under full load. Per MIL-STD-1474, 5.1.2.1.2, measurement locations shall be defined as follows. Occasionally occupied areas shall be defined as 39 inches from the assembly and a vertical distance of 55 inches above the ground. The operators position shall be defined as 24 inches horizontally from the instrument panel and 12 inches vertically above the center of the instrument panel. MIL-STD-1474, 5.1.2.1.4 contours shall be taken at not fewer than 12 equal horizontal arc increments, one increment shall include data from the noisiest position. Additionally, the noise level at the typical operator position shall be provided as dB(A) level. Failure to comply with MIL-STD-1474 and 3.7 provisions shall constitute failure of this test.

4.5.2.11 Reliability. Using the MTBF specified in 3.8, the pumping unit shall be tested for reliability. With the pump operating at the conditions of maximum water horsepower indicated on the appropriate performance curve (see figures 1 and 2), test until an "accept" or "reject" decision is reached, in accordance with figure 3. A failure is defined as any malfunction which cannot be corrected within 30 minutes (all waiting periods are excluded) by adjustment, repair, or replacement action using controls and on-equipment tools or parts available to the using element, and is a malfunction which causes or may cause one or more of the following:

a. Failure to commence operation, cessation of operation, or degradation of performance below specified levels.
b. Damage to the pumping unit by continued operation.
c. Safety hazards to personnel.

Nonconformance to 3.8, 3.11.3, 3.11.5.1, 3.11.7, or 3.11.6 shall constitute failure of this test.

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the current version before use.

4.5.2.12 Maintainability.

4.5.2.12.1 Maintenance ratio. The maintenance ratio shall be computed during first article testing. Nonconformance to 3.9.1 shall constitute failure of this test.

4.5.2.13 Railroad car impact. The first article pumping unit shall be tested in accordance with MIL-STD-810, method 516, procedure VIII rail impact test. Nonconformance to the requirements of 3.16.3 shall constitute failure of this test.

4.6 Inspection of packaging. The preservation, packing, and marking of the pumps shall be examined and tested in accordance with the quality assurance provisions of MIL-P-10603 and as specified in section 5 herein.

5. PACKAGING

5.1 Preservation. Preservation shall be level A or C as specified (see 6.2). Preservatives applied to the interior surfaces of the pump, connecting components and any other surface that normally contacts the liquid being transferred, shall be harmless should their residual material be inadvertently ingested by personnel.

5.1.1 Level A. Each complete pump shall be preserved in accordance with the level A requirements of MIL-P-10603 except the cooling system of liquid cooled engines shall be preserved by the water and antifreeze procedure specified in MIL-E-10062, using antifreeze conforming to MIL-A-46153.

5.1.2 Level C. Each complete pump shall be preserved in a manner to afford protection against deterioration and damage during shipment from the contractor to the initial destination except the engine shall be preserved in accordance with the level C requirements of MIL-E-10062.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2).

5.2.1 Level A. Each complete pump, preserved as specified in 5.1, shall be packed in accordance with the level A requirements of MIL-P-10603.

5.2.2 Level B. Each complete pump, preserved as specified in 5.1, shall be packed in accordance with the level B requirements of MIL-P-10603.

5.2.3 Level C. Each complete pump, preserved as specified in 5.1.3, shall be packed in accordance with the level C requirements of MIL-P-10603.

5.3 Marking. In addition to any special marking specified in the contract or order (see 6.2), marking shall be in accordance with MIL-STD-129.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The pumping units are intended for use in general purpose water pumping operations.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

6.2 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of the specification.
b. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).
c. Size of pumping units required (see 1.2).
d. When a first article is not required for inspection and approval and the number of units required (see 3.2).
e. When a check valve is not required (see 3.11.2.1).
f. Whether the impeller shaft sleeve will be of aluminum-bronze or corrosion-resistant steel (see 3.11.6).
g. Whether the pumping units shall be skid mounted or wheel mounted (see 3.13).
h. When rail humping test is required (see 3.16.3).
i. Color required (see 3.19).
j. When Government-loaned property is required (see 3.21).
k. Level of preservation and packing required (see 5.1 and 5.2).
l. Any special marking (see 5.3).
m. When a transportability report is required (see 6.7).

6.3 First article. When a first article inspection is required, the item(s) should be a first produced model. The first article should consist of one or more units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of the first article test results and disposition of the first articles. Invitation for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.4 Government-loaned property. The contracting officer should arrange to loan the property specified in 3.21, when applicable (see 6.2).

6.5 Data requirements. The contracting officer should include requirements for such data as technical publications, instructional materials, illustrated parts lists, and contractor's maintenance and operation manual to be furnished with each pumping unit.

6.6 Provisioning. The contracting officer should include provisioning requirements for repair parts and maintenance tools as necessary (including any special tools), and instructions regarding shipment of pumping units.

6.7 Consideration of data requirements. The following data requirements must be listed, as applicable, on the Contract Data Requirements List (DD Form 1423) when this specification is applied on a contract, in order to obtain the data, except where DOD FAR Supplement 27.475-1 exempts the requirement for a DD Form 1423.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

Paragraph No.	DID No.	DID title	Suggested Tailoring
3.16	DI-PACK-80880	Transportability Report.	None

The above DID is cleared as of the date of this specification. The current issue of DOD 5010.12-L, Acquisition Management Systems and Data Requirements Control List (AMSDL), must be researched to ensure that only current, cleared DID's are cited on the DD Form 1423.

6.8 Hazardous materials. The contracting officer should request the contractor to submit Material Safety Data Sheets (MSDS) for chemicals and hazardous materials required for operation, repair, or maintenance of the pumping units, except for those chemicals or hazardous materials already in the Federal Supply System.

6.9 Definitions.

6.9.1 Cross-country operation. Cross-country operation consists of traveling over open fields, broken ground, loose sand or gravel, and uneven terrain in general.

6.9.2 Unimproved road operation. Unimproved road operation consists of traveling over level or rolling gravel roads.

6.9.3 Highway operation. Highway operation consists of traveling over level or rolling paved roads.

6.10 Technical manuals. The requirement for technical manuals should be considered when this specification is applied on a contract. If technical manuals are required, military specifications and standards that have been cleared and listed in DOD 5010.12-L, Acquisition Management Systems and Data Requirements Control List (AMSDL) must be listed on a separate Contract Data Requirements List (DD Form 1423), which is included as an exhibit to the contract. The technical manuals must be acquired under separate contract line item in the contract.

6.11 Noise limits. Where the limit of Category D can be documented as being clearly beyond the state-of-the-art, per MIL-STD-1474, 5.1.1.2, selection of another noise limit should be considered by the procuring activity, as described in MIL-STD-1474, acceptance requirements (5.1.1.3). Particular attention should be given to 5.1.1.3.2.d. When permission is granted to exceed the limits of Category D, the procuring activity should insure that operator and maintenance manuals are prepared in accordance with MIL-STD-1474, manuals requirement (4.3)."

6.12 Welders and welding operators. The contracting officer should consider requalifying welders or welding operators in the event of evidence of poor welds (see 3.23.1.2).

6.13 Classification change. Type II (auxiliary self-priming) pumping units have been discontinued since they are no longer required.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

6.14 Subject term (key word) listing.

General purpose
Self-priming, integral
Skid mounted
Water pumping
Wheel mounted

6.15 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Custodians:
Army - ME
Air Force - 84

Review activity:
Army - AT
Navy - MC
Air Force - 99

Preparing activity:
Army - ME

Project 4320-0324

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

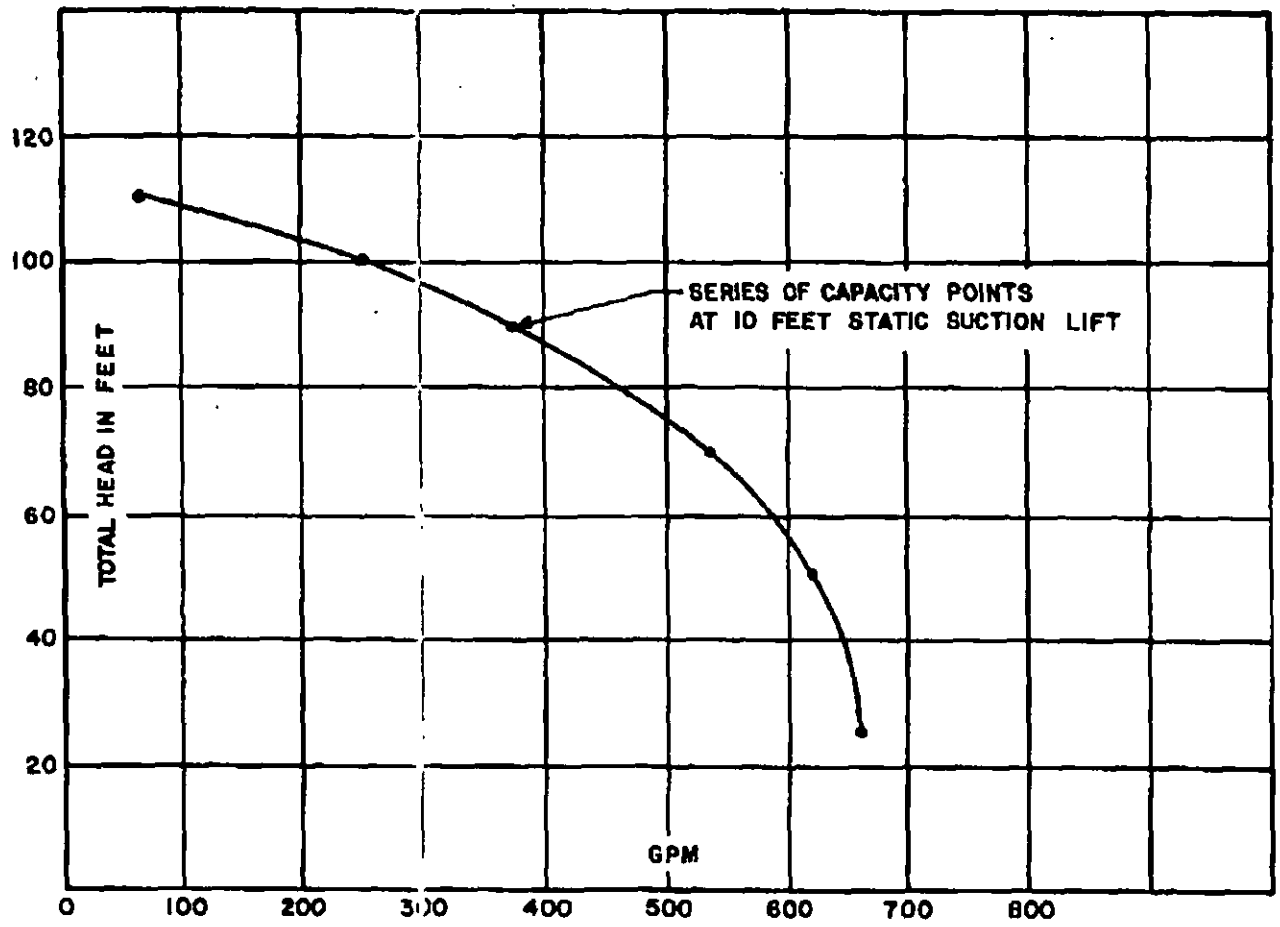


FIGURE 1. Pump, size 4.

X-3046A

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.


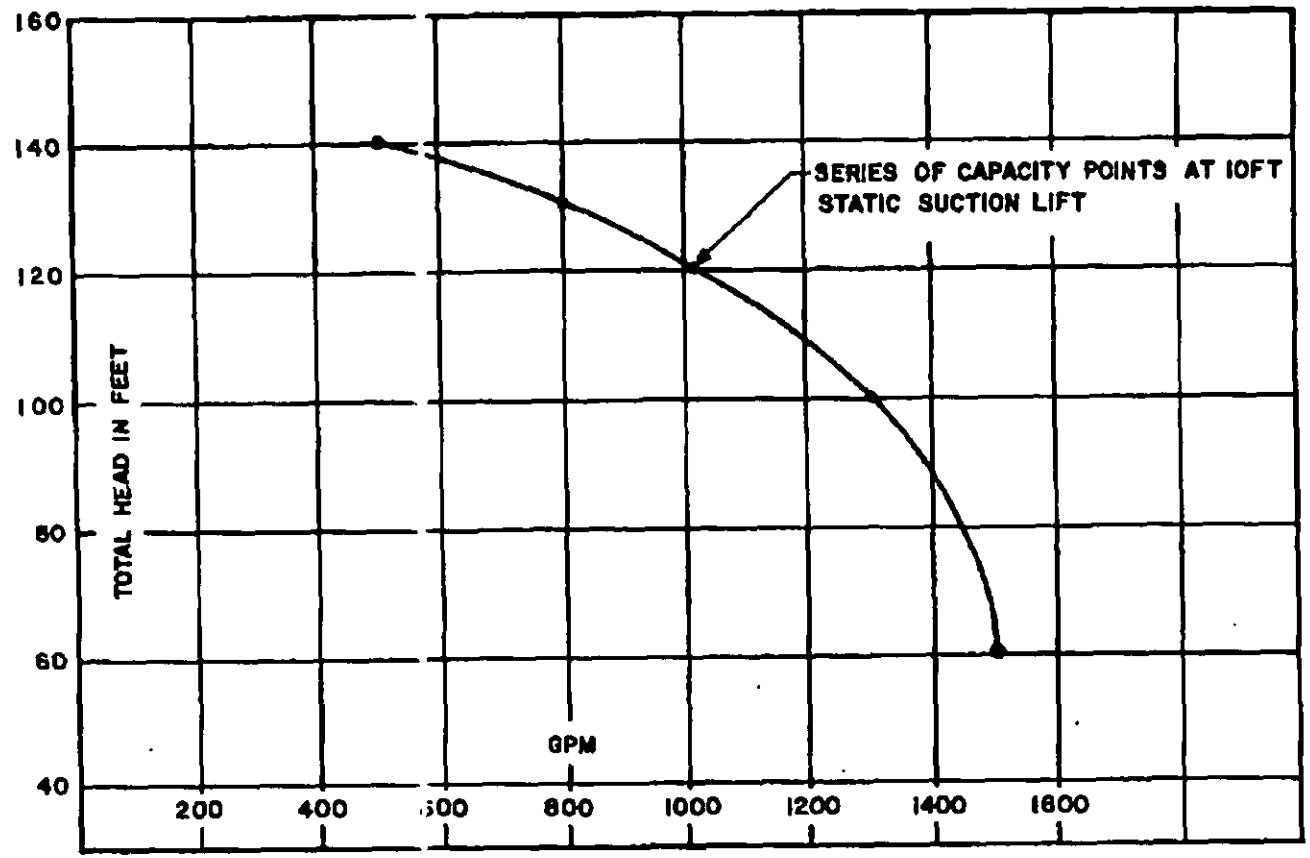


FIGURE 2. Pump, size 6.

X-3047A

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

DECISION RISKS 20%
DISCRIMINATION RATIO 2.0:1

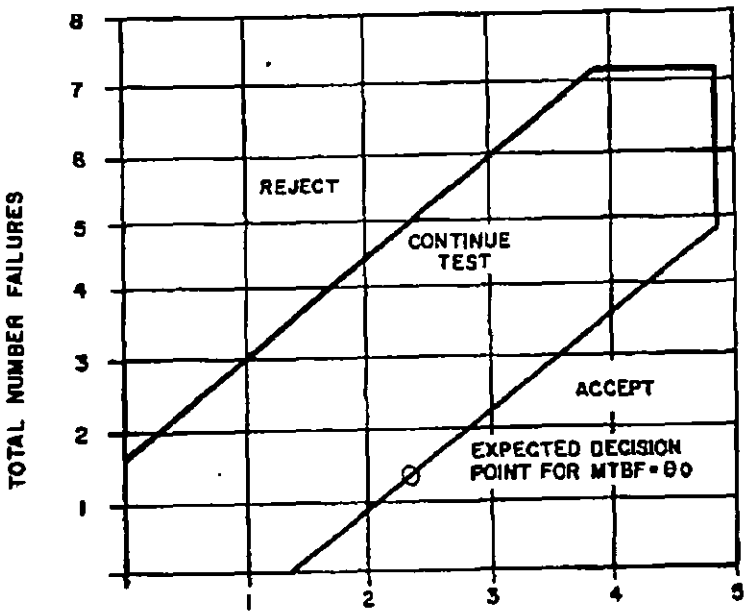

TOTAL TEST TIME (IN MULTIPLES OF SPECIFIED MTBF)

NO. OF FAILURES	TOTAL TEST TIME * REJECT (EQUAL OR LESS)	ACCEPT EQUAL OR MORE
0	N/A	1.40
1	N/A	2.09
2	.35	2.79
3	1.04	3.48
4	1.73	4.17
5	2.43	4.87
6	3.12	4.87
7	3.81	4.87
8	4.87	N/A

* TOTAL TEST TIME IS TOTAL UNIT HOURS OF "EQUIPMENT ON" TIME AND IS EXPRESSED IN MULTIPLES OF THE SPECIFIED MTBF.

FIGURE 3. Accept-reject criteria.

X-3499

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:57Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

RECOMMEND A CHANGE:	1. DOCUMENT NUMBER MIL-P-103606	2. DOCUMENT DATE (YYMMDD) 920226

3. DOCUMENT TITLE
Pumping Units, Centrifugal: 4-Inch and 6-Inch, Diesel-Engine-Driven, for Water

4. NATURE OF CHANGE (Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME (Last, First, Middle Initial)	b. ORGANIZATION	
c. ADDRESS (Include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (If applicable) (2) AUTOVON	7. DATE SUBMITTED

8. PREPARING ACTIVITY

a. NAME Betty Taylor	b. TELEPHONE (Include Area Code) (1) Commercial (703) 704-3466 (2) AUTOVON 654-3466
c. ADDRESS (Include Zip Code) US Army Belvoir RDE Center ATTN: SATBE-TSE Fort Belvoir, VA 22060-5606	IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT: Defense Quality and Standardization Office 5203 Leesburg Pike, Suite 1403, Falls Church, VA 22041-3466 Telephone (703) 756-2340 AUTOVON 289-2340

Source: https://assist.dla.mil -- Downloaded: 202640-17T13:57Z
Check the source to verify that this is the current version before use.