
MIL-R-2726/70B(SH)
3 July 1986
SUPERSEDING
MIL-R-2726/70A(SHIPS)
20 November 1970

MILITARY SPECIFICATION SHEET

RECEPTACLE, ELECTRICAL, TOTALLY ENCLOSED, 15-AMPERE, 125-VOLT, 400-HERTZ, BLADED TYPE, SINGLE PHASE, GROUNDED (SYMBOL NO. 1100)

(B) This specification is approved for use within the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

(B) The requirements for acquiring the receptacle described herein shall consist of this specification and the latest issue of MIL-R-2726.

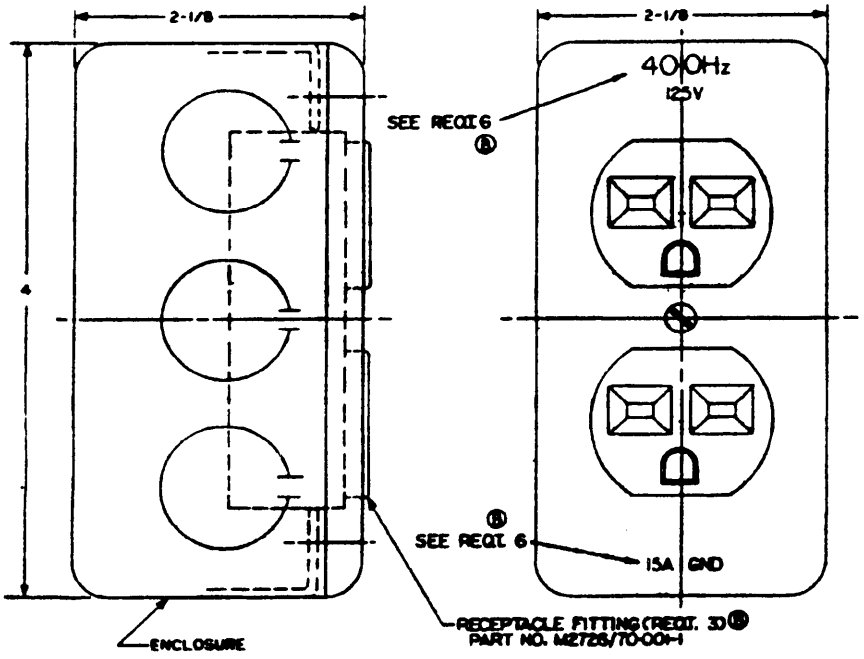

SH 9657A

NOTE:

1. Dimensions are in inches. Unless otherwise specified, tolerances are ± 1/64 inch.

FIGURE 1. Dimensions and configuration.

(B) denotes changes.

AMSC N/A FSC 5935

DISTRIBUTION STATEMENT A Approved for public release; distribution unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. Dimensions and configuration: See figure 1.
2. H.I. shock: Disengagement of the test plug from the receptacle under H.I. shock shall not be considered as a failure.
3. (B) Receptacle fitting: Shall be in accordance with W-C-596/16, part number W-C-596/16-1. The ground contact and mounting strap shall be nickel-plated.
4. (B) The receptacle enclosure shall be of steel and shall be in accordance with W-J-800. The box knockouts shall be conventional or reverse, and shall meet the knockout force specified in table I below. Failure to withstand this force shall be cause for rejection.
5. (B) Mating plug: Shall be in accordance with W-C-596/17, part number W-C-596/17-1 (not furnished).
6. Marking: Letters shall be stamped 1/4 inch high, and shall be filled with red paint.
7. Intended use: Below deck on shipboard 400-hertz (Hz) power systems to prevent 60-Hz equipment from being plugged into 400-Hz outlet.
8. Part numbers: M2726/70-001 - complete receptacle.
   M2726/70-001-1 - receptacle fitting.
9. (B) Electrical rating: 15-ampere, 125-volt, alternating current, 400-Hz.

(B) QUALITY ASSURANCE:

Quality assurance shall be as specified in MIL-R-2726 and table I herein. The first article and quality conformance inspections shall consist of the inspections as specified in table I, in the order shown.

TABLE I. First article and quality conformance inspection.

Inspection	Requirement	Test method	First article	Quality conformance
Examination	3.1, 3.3, 3.4, 3.5, 3.6 and 3.7	4.6.1	X	X
Endurance	3.5.5	4.7.5	X	
Ground contact resistance	3.5.3.3	4.7.3.3	X	X
Vibration	3.5.9	4.7.9	X	
Shock	3.5.10	4.7.10	X	
Salt spray	3.5.11	4.7.11	X	
Knockout force	3.5.19	4.7.19	X	

Preparing activity:
Navy - SH
(Project 5935-N255-71)

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.