MIL-R-2726/71B(SH)
3 July 1986
SUPERSEDING
MIL-R-2726/71A(SHIPS)
30 October 1970

MILITARY SPECIFICATION SHEET

RECEPTACLE, ELECTRICAL, WATERTIGHT, 15-AMPERE, 125-VOLT, 400-HERTZ, BLADED TYPE, SINGLE PHASE, GROUNDED (SYMBOL NO. 1101)


(B) This specification is approved for use within the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

(B) The requirements for acquiring the receptacle described herein shall consist of this specification and the latest issue of MIL-R-2726.

(B) denotes changes.

AMSC N/A FSC 5935
DISTRIBUTION STATEMENT A Approved for public release; distribution unlimited

Source: https://assist.dla.mil -- Downloaded: 202610-16T15:37Z
Check the source to verify that this is the current version before use.

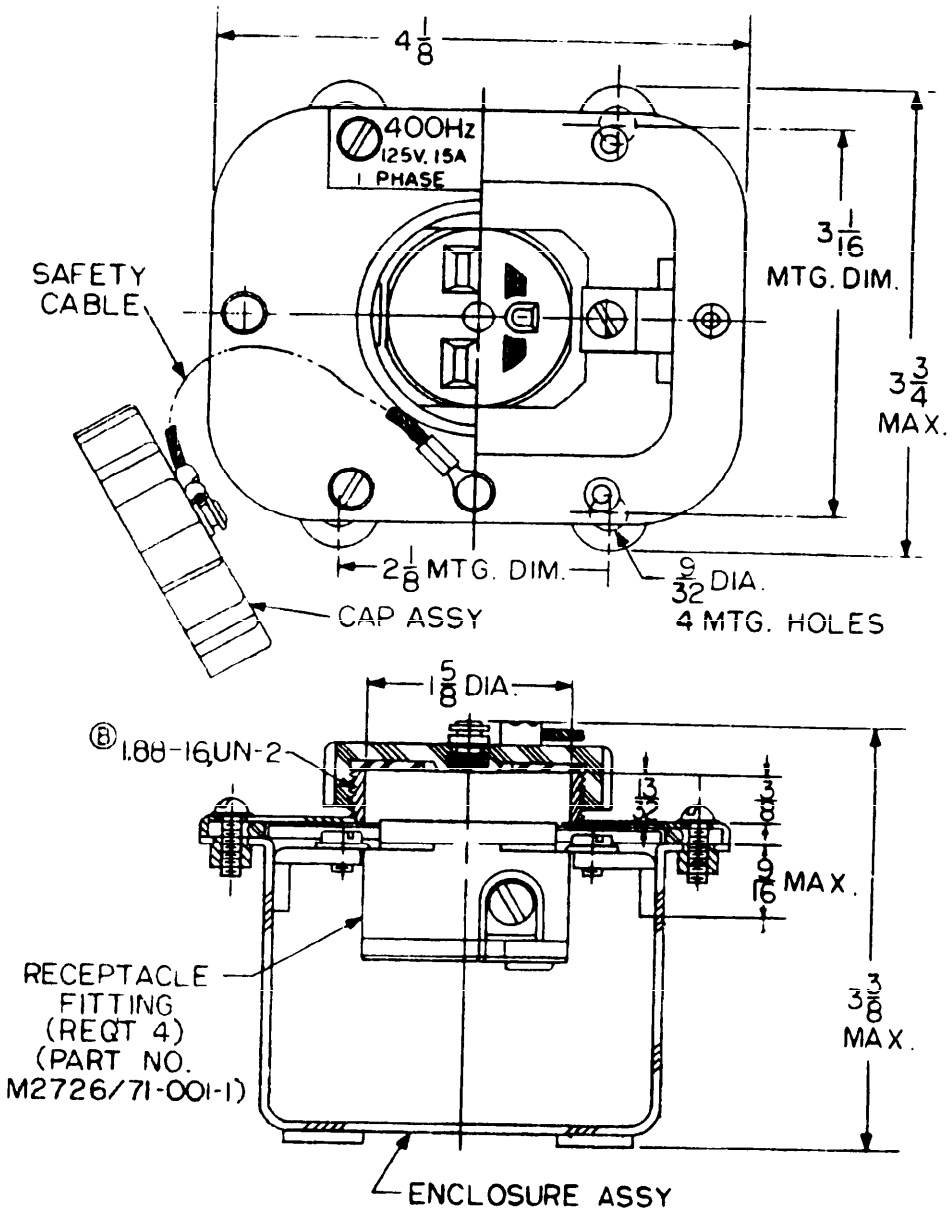

SH 9656A

NOTE:

1. Dimensions are in inches. Unless otherwise specified, tolerances are ± 1/64 inch.

FIGURE 1. Dimensions and configuration.

Source: https://assist.dla.mil -- Downloaded: 202610-16T15:37Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. Dimensions and configuration: See figure 1.
2. Effectiveness of enclosure: Watertight in accordance with MIL-STD-108.
3. (B) Receptacle fitting: Shall be in accordance with W-C-596/15, part number W-C-596/15-1. Ground contact of receptacle shall be nickel-plated.
4. (B) Enclosure assembly: MIL-E-24142/9, part number M24142/9-001.
5. (B) Mating plug: Shall be in accordance with W-C-596/17, part number W-C-596/17-1 (not furnished).
6. Intended use: On shipboard 400-hertz (Hz) power-systems, to prevent 60-Hz equipment from being plugged into 400-Hz power outlet.
7. Part numbers: M2726/71-001 - complete receptacle.
   M2726/71-001-1 - receptacle fitting.
8. (B) Cap assembly: Material shall be plastic or brass.
9. (B) Electrical rating: 15-ampere, 125-volt, alternating current, 400-Hz.

(B) QUALITY ASSURANCE:

Quality assurance shall be as specified in MIL-R-2726 and table I herein. The first article and quality conformance inspections shall consist of the inspections as specified in table I, in the order shown.

TABLE I. First article and quality conformance inspection.

Inspection	Requirement	Test method	First article	Quality conformance
Examination	3.1, 3.3, 3.4, 3.5, 3.6 and 3.7	4.6.1	X	X
Endurance	3.5.5	4.7.5	X	
Ground contact resistance	3.5.3.3	4.7.3.3	X	X
Vibration	3.5.9	4.7.9	X	
Shock	3.5.10	4.7.10	X	
Salt spray	3.5.11	4.7.11	X	
Effectiveness of enclosure	3.5.4	4.7.4	X	X

Preparing activity:
Navy - SH
(Project 5935-N255-72)

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:37Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:37Z
Check the source to verify that this is the current version before use.