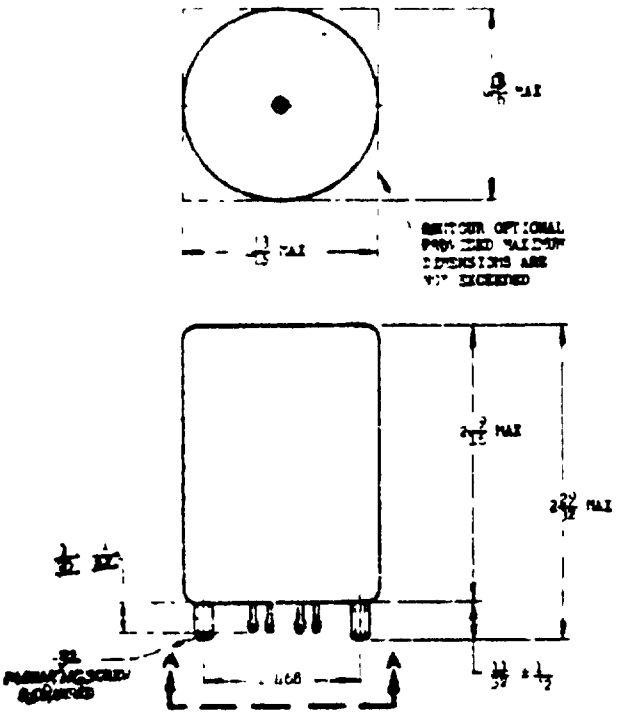

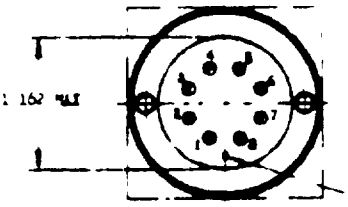

VIEW A-A

RED DOT FOR LOCATING TERMINALS TERMINAL NUMBERS NEED NOT APPEAR ON RELAY HEADER

PROVIDED THERE IS AFFIXED TO THE RELAY A SUITABLE LEGIBLE CIRCUIT DIAGRAM THAT IDENTIFIES EACH TERMINAL LOCATION SPECIFIED HEREON

DETAIL REQUIREMENTS

(A)	MAXIMUM OPERATING VOLTAGE	29 VOLTS
(B)	PICKUP VOLTAGE	18 VOLTS
(C)	DROPOUT VOLTAGE	VOLTS +0, -5.5
(D)	RATED LOAD (PER POLE	

	NORMALLY OPEN	NORMALLY CLOSED
RESISTIVE (A-C 400-CYCLE 115 VOLTS)	10 AMP	10 AMP
RESISTIVE (DC)	10 AMP	10 AMP
INDUCTIVE	10 AMP	10 AMP
MOTOR	6 AMP	5 AMP

(E)	COIL CURRENT	0.15 AMP MAX
(F)	MINIMUM OPERATING PERIOD	3 HOURS
(G)	MINIMUM OPERATING CYCLES	50,000
(H)	MAXIMUM WEIGHT	0.4 POUND
(I)	RATED DUTY	CONTINUOUS
(J)	NOMINAL COIL VOLTAGES	28 VOLTS



CIRCUIT

C INACTIVE FOR DESIGN AFTER 24 FEBRUARY 1960
NO SUPERSEDING STANDARD

ALT PART NO
~~AN3307~~
AN3307-2

(4) USE ONLY IN DESIGN FOR CONTRACTS IN EFFECT ON DATE PRIOR TO ABOVE DATE AND FOR REPLACEMENT OF IDENTICAL ITEMS IN EXISTING AERONAUTICAL WEAPONS AND SUPPORT SYSTEMS PER SIMILAR ITEMS, SEE MIL-STD.

1. DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED, TOLERANCES: FRACTIONS ±1/64, DECIMALS ±.005.

2. OVERLOAD, RUPTURE AND CONTACT DROP TESTS OF SPECIFICATION MIL-R-6106 ARE NOT APPLICABLE TO PART NUMBER AN3307-1.

3. PART NUMBER AN3307-1 INACTIVE FOR DESIGN AFTER 10 APRIL 1956
FOR DEFINITION AND APPLICATION OF DRAWING STATUS NOTES, SEE AMA BULLETIN NO. 337

4. PART NUMBER AN3307-2 DENOTES RELAY WITH MINIMUM CURRENT RATING ESTABLISHED IN PROCUREMENT SPECIFICATION MIL-R-6106.

PROCUREMENT SPECIFICATION	AIR FORCE-NAVY AERONAUTICAL STANDARD	AN3307
MIL-R-6106	RELAY, 10 AMP, 2PDT, SEALED, PANEL MOUNTING, CLASS O	

APPROVED 21 Apr 53 (1) REVISED (1) 17 Nov 54 (1) 17 Apr 57 (1) 1 Feb 58

SUPERSEDES USAF DRAWING 50B6187

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T14:19Z
Check the source to verify that this is the current version before use.