DATA ITEM DESCRIPTION

Form Approved
OMB No. 0704-0188

2 TITLE Boiler Inspection Report	1 IDENTIFICATION NUMBER DI-MISC-80382

3 DESCRIPTION/PURPOSE

3.1 The Boiler Inspection Report is used to document the inspector's observations and recommendations on the condition, operation, modification and repair of boilers inspected.

3.2 The report is used as a receiving document by the government showing that the inspection has been accomplished.

4 APPROVAL DATE (YYMMDD)	5 OFFICE OF PRIMARY RESPONSIBILITY (OPR)	6a DTIC REQUIRED	6b GIDEP REQUIRED
870708	F/AFLC-DEMU		

7 APPLICATION/INTERRELATIONSHIP

7.1 This Data Item Description (DID) contains the format and content preparation instructions for the data product generated by the specific and discrete task requirement as delineated in the contract.

7.2 This DID is applicable to all Air Force contracts for inspection of boilers.

8 APPROVAL LIMITATION	9a APPLICABLE FORMS	9b AMSC NUMBER
		F4147

10 PREPARATION INSTRUCTIONS

10.1 Format. An example of the format for this report is shown in Figure 1.

10.2 Content. The report shall contain the following:

10.2.1 Identification.

a. Installation. Name of base or site.
b. Type of Plant. Function of plant (heating or air conditioning).
c. Point of Contact. Name of person to contact at the base concerning the inspection.
d. Commercial Telephone Number. The telephone number of the point of contact.
e. Plant or Building Number. Identification number of plant where boiler is located.
f. Type of Boiler. Steam or high temperature hot water.
g. USAF Number. Boiler number within the plant.
h. N.B. Number. The National Board Number of the boiler.
i. MFR Rating or Capacity. Manufacturers' rating or capacity in boiler horse power (BHP) or BTU per hour.
j. Boiler Size (l x dia or l x w x h). Length times the diameter or length times the width times the height of the boiler.
k. Manufactured By. The manufacturer of the boiler.
l. Year Built. The year the boiler was built.
m. Year Installed. The year boiler was installed.
n. Firing Equipment. Type of burner or firing method.
o. Fuel. Primary type of fuel burned in boiler.
p. Design Working Pressure. The design working pressure of the boiler.
q. Pressure Allowed. The maximum allowable working pressure of boiler.
r. Safety Valve Setting. The setting of the safety valve on the boiler.

(Continued on Page 2)

11 DISTRIBUTION STATEMENT

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: [illegible]-10-26T10:36Z
Check the source to verify that this is the current version before use.

10. PREPARATION INSTRUCTIONS (continued)

s. Pressure observed. The operating steam pressure or hydrostatic test pressure observed during inspection.

10.2.2 Repairs made since last inspection. Statement by the base engineers representative on repairs made since last inspection.

10.2.3 Internal inspection (Types A and B only). Describe internal inspection fully with observations on scale, grease, oil, or other deposits, corrosion, pitting, grooving, cracks or laminations; any evidence of overheating, such as bulging or warping; any broken or loose rivets or stays.

10.2.4 External Inspection (Types A, B, C, and D). Describe external inspection fully with observations on condition of seams, tube ends, pipe connections; any evidence of corrosion, leakage, erosion, overheating, soot or other descriptive accumulations.

10.2.4.1 Settings, linings, baffles and boiler supports. Describe condition of the above parts fully.

10.2.5 Inspection of safety devices.

10.2.5.1 Safety Valves.

a. Size (number and diameter). Record the number of safety valves and their diameter.

b. Set at (lbs). Pressure setting(s) of safety valve(s).

c. Condition and how tested. Description of the valve condition and method of test.

10.2.5.2 Other appliances (water columns, gage glasses, gage cocks, blow-off pipe, and valve or cocks, and feed pipes). Describe the condition of the other appliances listed above.

10.2.6 Statement of Inspector.

a. Was boiler prepared for thorough examination? Check yes or no. If no, give details in remarks and recommendations section.

b. Was boiler entered for the inspection? If no, explain reason in remarks section.

10.2.7 Remarks and Recommendations of Inspector. List deficiencies to be corrected and repairs to be made on boiler inspected.

10.2.7.1 Name, grade, and title of inspector (please type).

10.2.7.2 Signature of inspector.

10.2.8 Action taken on recommendations. Describe the actions taken on the recommendations made by the inspector.

10.2.8.1 Name, grade, and title of officer in charge (please type).

10.2.8.2 Signature of officer in charge.

10. PREPARATION INSTRUCTIONS (Continued)

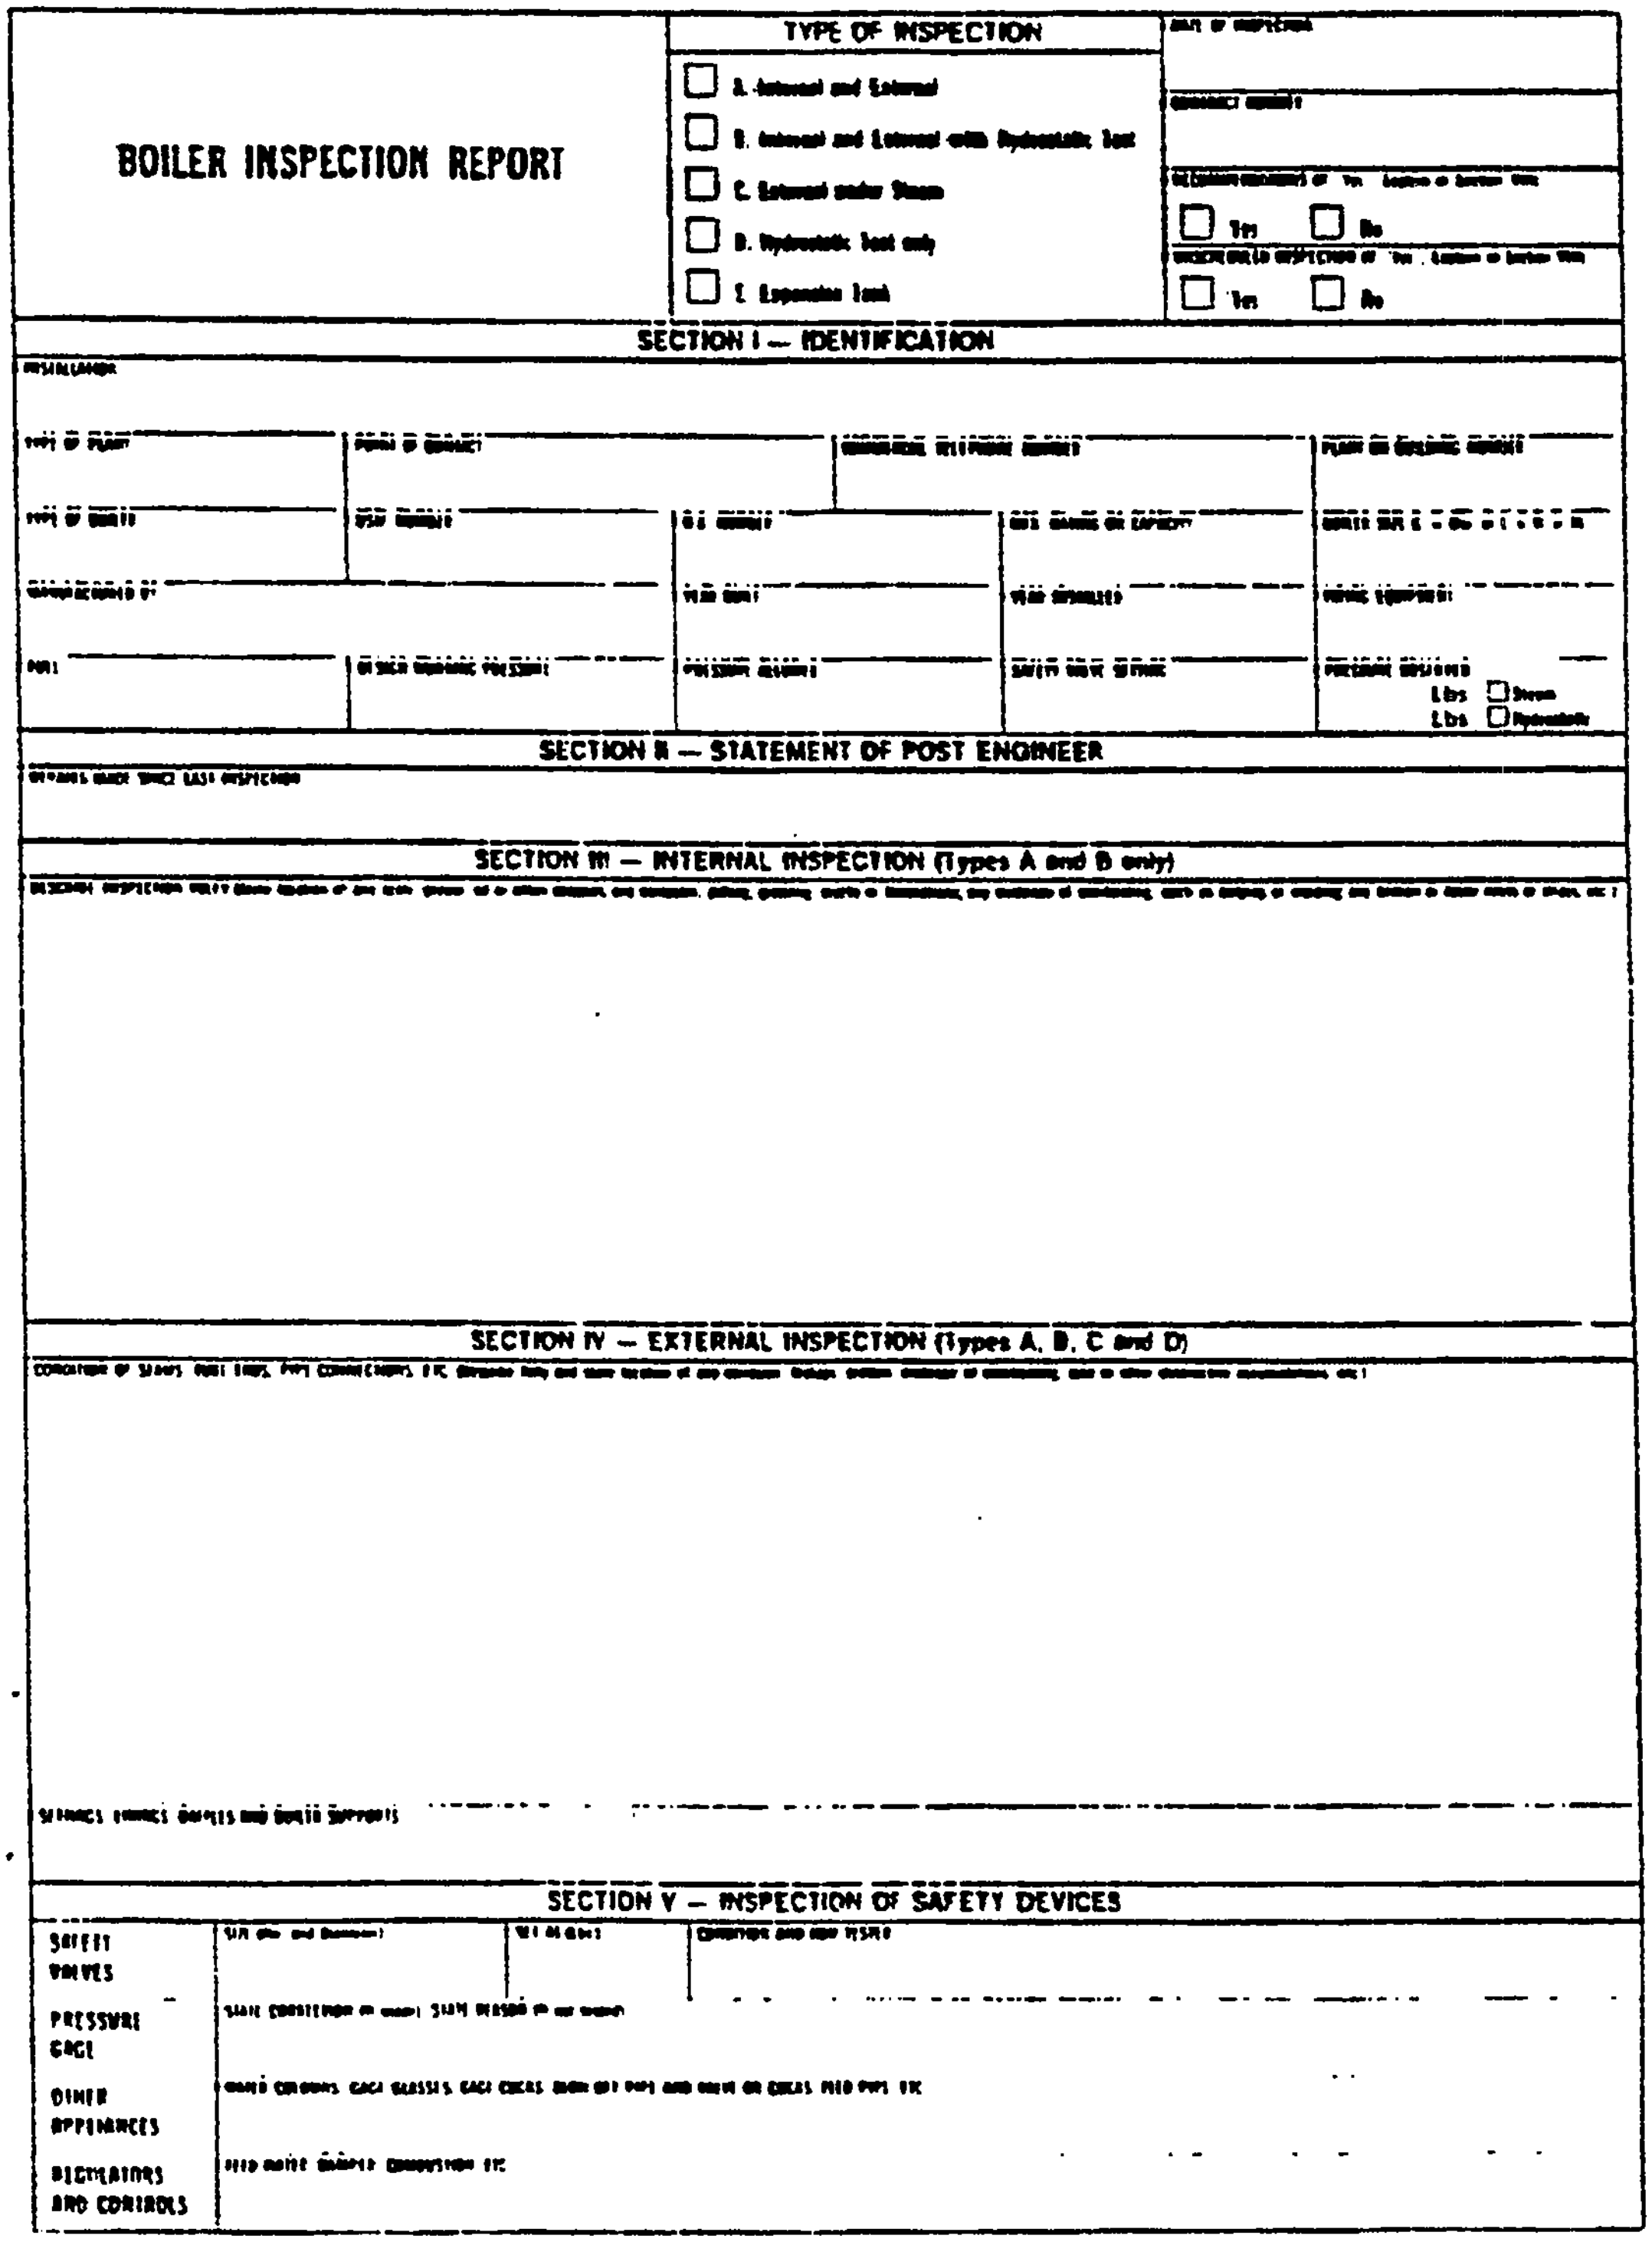

BOILER INSPECTION REPORT

TYPE OF INSPECTION

☐ A. Internal and External
☐ B. Internal and External with Hydrostatic Test
☐ C. External under Steam
☐ D. Hydrostatic Test only
☐ E. Expansion Tank

☐ Yes ☐ No
☐ Yes ☐ No

SECTION I — IDENTIFICATION

Lbs ☐ Steam
Lbs ☐ Hydrostatic

SECTION II — STATEMENT OF POST ENGINEER

SECTION III — INTERNAL INSPECTION (Types A and B only)

SECTION IV — EXTERNAL INSPECTION (Types A, B, C and D)

SECTION V — INSPECTION OF SAFETY DEVICES

SAFETY VALVES
PRESSURE GAGE
OTHER APPLIANCES
REGULATORS AND CONTROLS

FIGURE 1. Sample Boiler Inspection Report (Sheet 1 of 2)

10. PREPARATION INSTRUCTIONS (Continued)

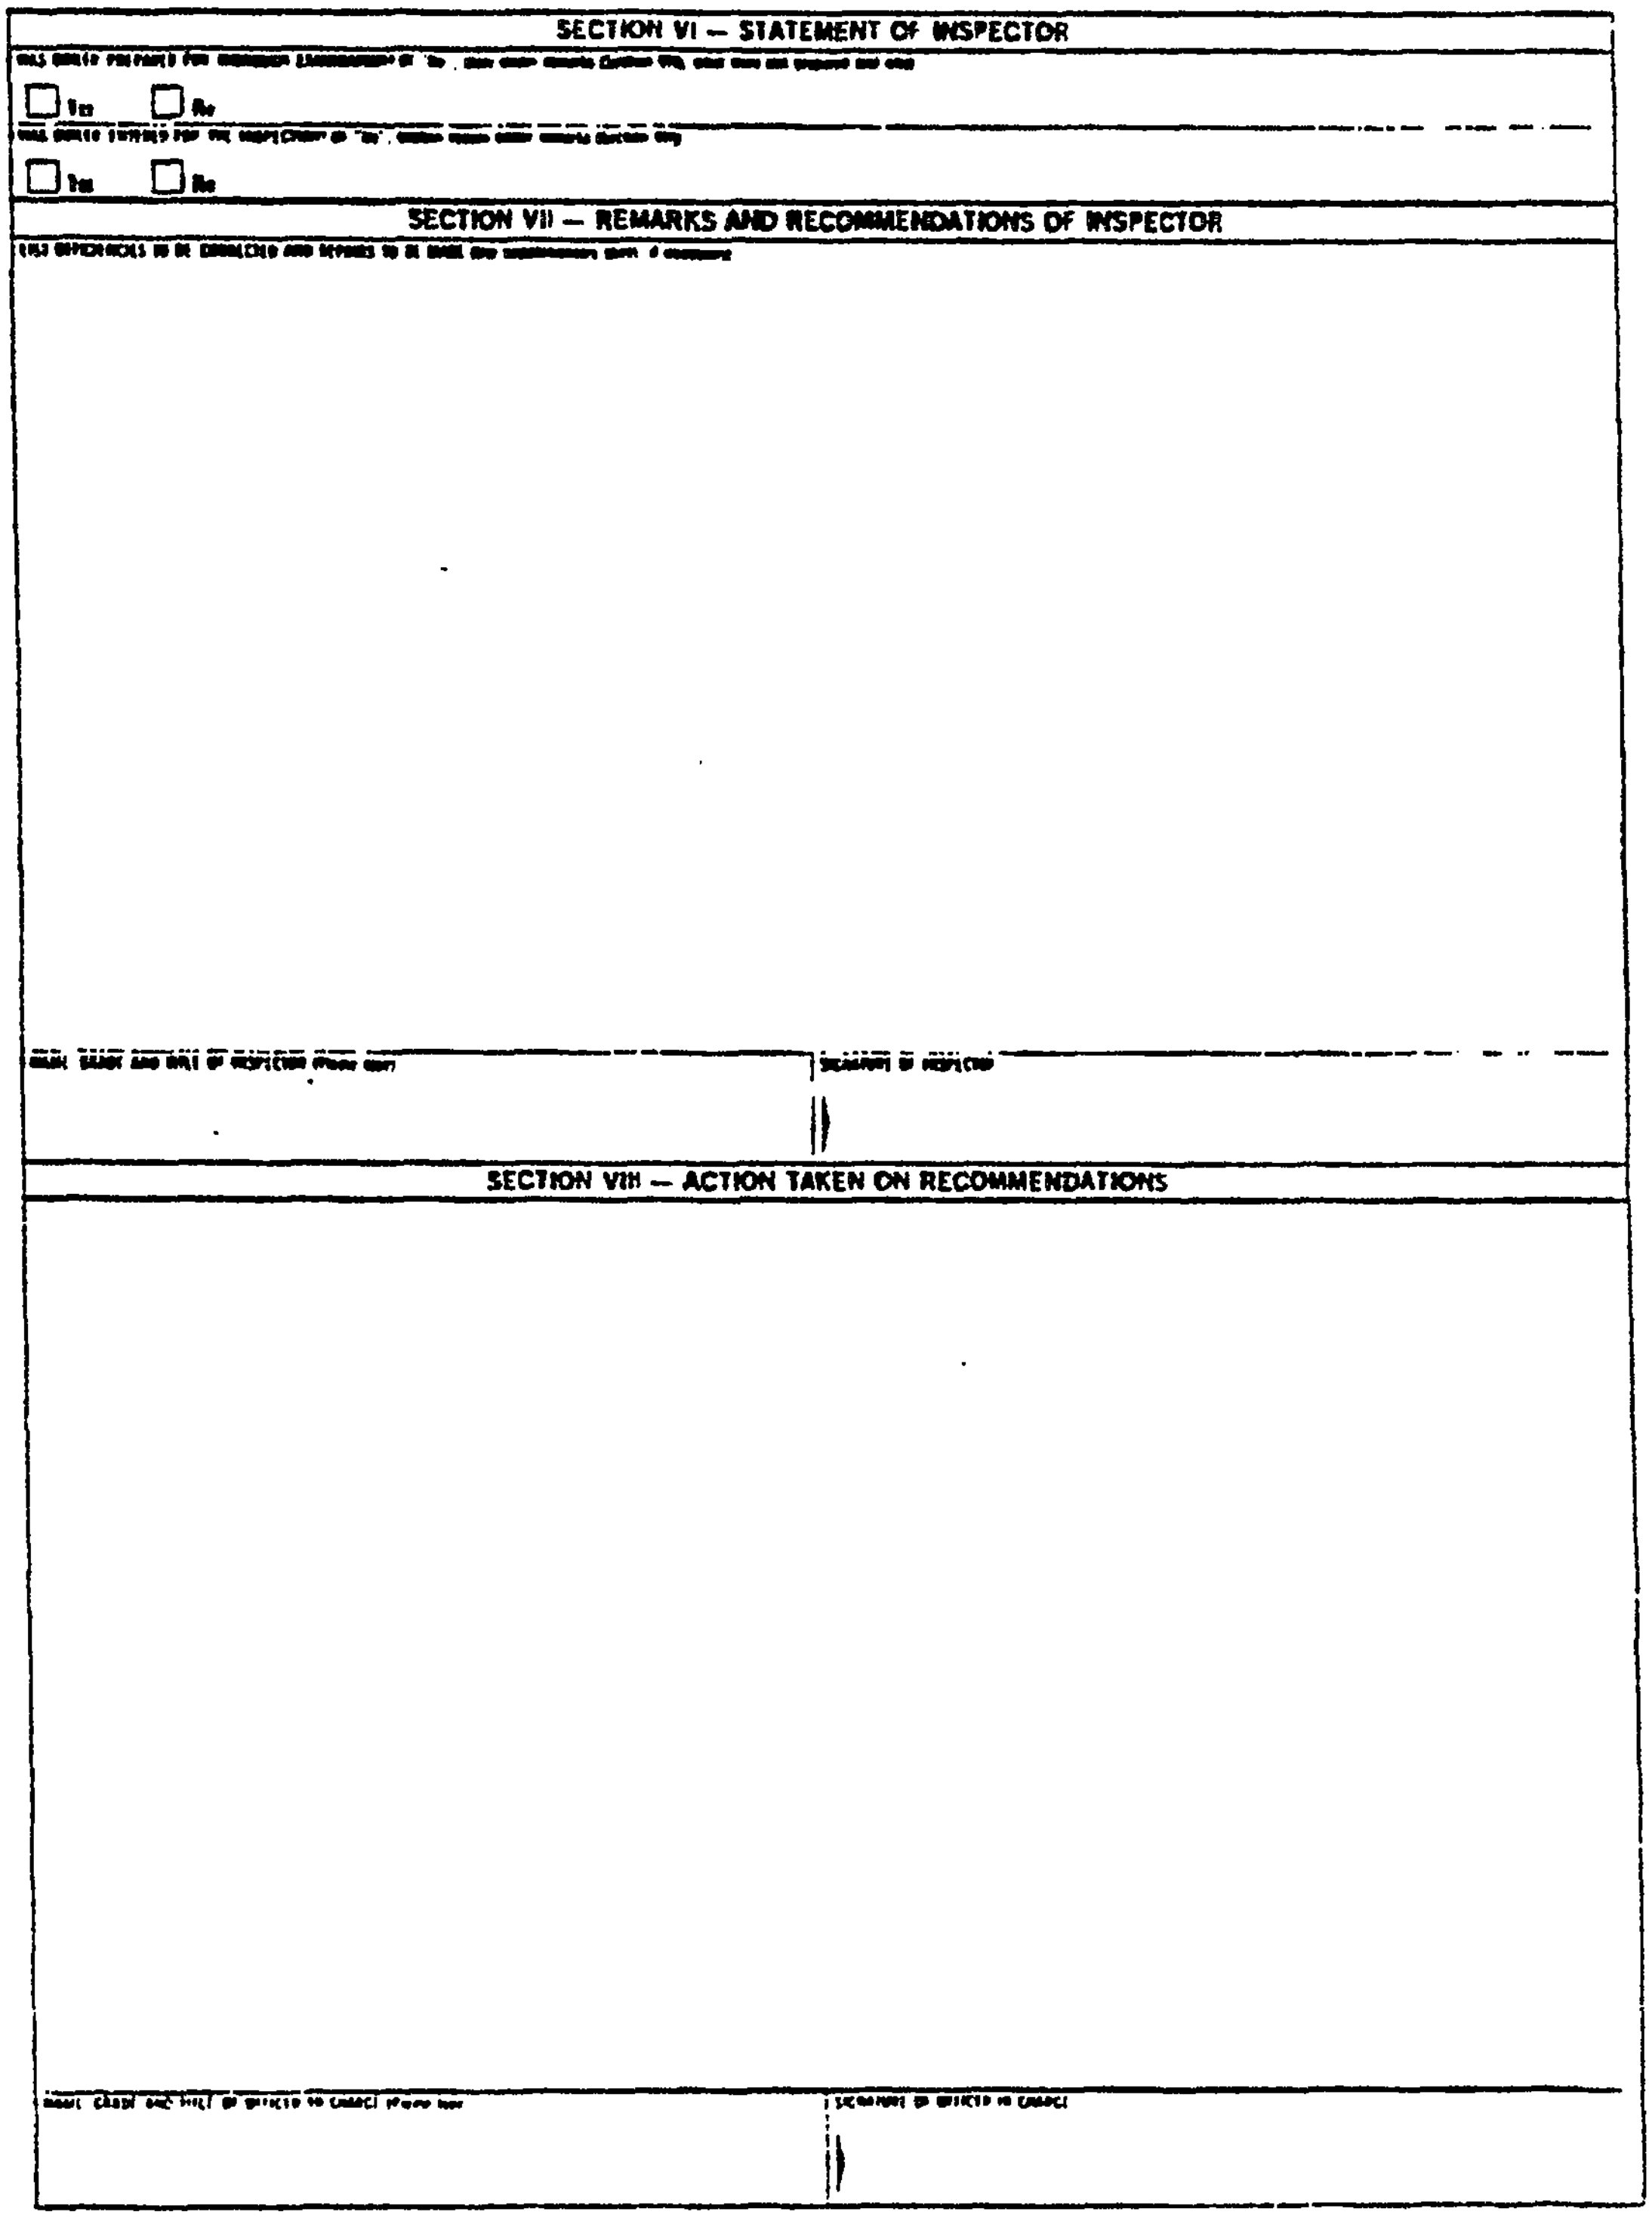

SECTION VI — STATEMENT OF INSPECTOR

[illegible]

☐ Yes ☐ No

[illegible]

☐ Yes ☐ No

SECTION VII — REMARKS AND RECOMMENDATIONS OF INSPECTOR

[illegible]

[illegible]

[illegible]

SECTION VIII — ACTION TAKEN ON RECOMMENDATIONS

[illegible]

[illegible]

FIGURE 1. Sample Boiler Inspection Report (Sheet 2 of 2)