INCH-POUND
A-A-59796
7 MAY 2007

COMMERCIAL ITEM DESCRIPTION

AIR CONDITIONERS, WINDOW, WALL UNIT

The General Services Administration authorized the use of this commercial item description in lieu of OO-A-372F.

1. SCOPE. This commercial item description covers the requirements for air conditioners designed for mounting in a window, or through a wall, and provide free delivery of conditioned air to an enclosed space. It includes the cooling, dehumidifying, circulating, filtering and ventilation of the air.

2. CLASSIFICATION. The air conditioner shall conform to the following types:

2.1 Type A - Window mounted type
Type B - Through the wall mounted type

3. SALIENT CHARACTERISTICS.

3.1 Description. Window or through the wall mounted type shall be the following sizes and requirements as specified in Table I.

Table I. Sizes and requirements.

Nameplate rating in BTU/HR *	Voltage rating in 60 HZ	Air Direction Min.
6,000	115	2 way
8,000	115	4 way
10,000	230	4 way
12,000	230	4 way
14,500	230	4 way
18,000	230	4 way
23,500	230	4 way

* Min. BTU/HR value at operating voltage 115 or 230 V.

Comments, suggestions, or questions on this document should be addressed to Defense Supply Center Philadelphia, ATTN: DSCP-NASA, 700 Robbins Avenue, Philadelphia, PA 19111-5096 or email to dscpg&inspecomments@dla.mil. Since contact information can change, you may want to verify the currency of this address information using the ASSIST Online database at http://assist.daps.dla.mil.

AMSC N/A FSC 4120

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:27Z
Check the source to verify that this is the current version before use.

3.2 Certification. The contractor shall certify that the air conditioner furnished have been tested and conformed to UL 484, UL Standard for Safety Room Air Conditioners. Units furnished shall meet the energy efficiency specifications set by the Department of Energy's Federal Energy Management Program (FEMP) or shall be "ENERGY STAR®" qualified.

3.3 Design and construction. The air conditioner shall consist of air circulating, refrigeration, and electrical equipment assembled within an outer case cabinet. The circulating fan motor shall have two or more speeds. The air conditioner shall be designed for, and provided with, all mounting devices necessary to its installation.

3.4 Outer case cabinet. The outer case cabinet shall include grilles and insulation where required. It shall be of a design and style suitable for installation in an office space. The inlet and outlet grille color shall harmonize with the cabinet color. The outlet grilles shall be furnished with controls for air flow direction (see Table I).

3.5 Chassis. The chassis shall support and maintain alignment of the machinery and component parts and shall be slide-out type for easy cleaning. The outer case cabinet and chassis shall be insulated to prevent dripping and moisture run off, and reduces noise transmission.

3.6 Mounting. All mounting hardware shall be made of corrosion resistant material or protected by a corrosion resistant finish. Sealing gaskets shall prevent outside air and moisture from leaking into the room.

3.7 Dimension. Unless otherwise specified, overall dimension of the air conditioner shall be the commercial standard dimensions for the nameplate rating.

3.8 Filter. Recirculated air shall be filtered before entering any air conditioning coil or room. Air filter shall be replaceable and commercially available.

3.9 Heating capacity. When specified (see 7.1), the unit shall have a heating capacity not less than 50 percent of the BTU's per hour cooling capacity. When heating is specified, an adjustable thermostat shall be provided to automatically control the temperature from 60 to 80 degrees F within plus or minus 4 degrees F.

3.10. Workmanship. All components and assemblies of the air conditioner shall be free from dirt or other extraneous materials, burrs, silvers, rough die, tool and grind marks, dents and cracks. Castings, molded parts and stampings, if used, shall be free of sand, fins, pits, blow holes and sprues. The surfaces of parts to be welded or brazed shall be free from rust, scale, paint, grease and other foreign matter. All scale and flux shall be removed from the finished weld area and welds shall be smooth and free of cracks, burn holes, undercuts or incomplete fusion. Threaded fasteners shall not be missing, broken, cracked or stripped.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:27Z
Check the source to verify that this is the current version before use.

4. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

5. PRODUCT CONFORMANCE. The products provided shall meet the salient characteristics of this commercial item description, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The government reserves the right to require proof of such conformance.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 Part or Identification Number (PIN). The following PIN procedure is used for government purposes and does not constitute a requirement for the contractor.

This example describes a part numbering system for CID A-A-59796:

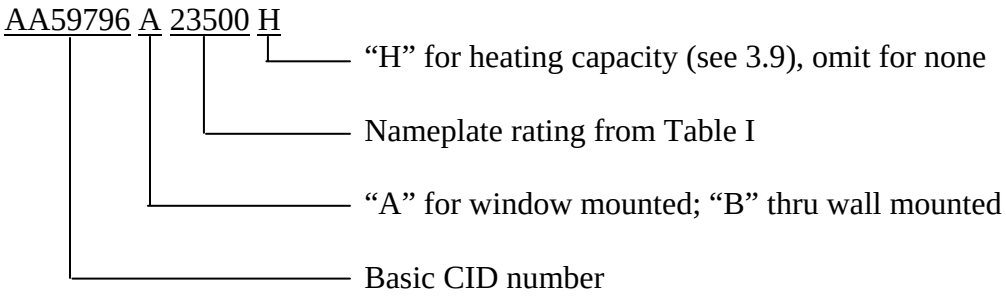

7.2 Source of documents.

7.2.1 FAR. The Federal Acquisition Regulation may be obtained from the Regulatory Secretariat, 1800 F Street NW, Washington, DC 20405 or online at http://www.acqnet.gov.

7.2.2 UL. UL standards are available online at www.ul.com or from COMM 2000, 1414 Brook Drive, Downers Grove, IL 60515.

7.3 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID's PIN.
b. Product conformance provision.
c. Quantity required.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:27Z
Check the source to verify that this is the current version before use.

7.4 Key words:

BTU
Cooling fan
Cooling capacity
Energy efficiency ratio (EER)
Heating capacity

Custodians:
Army – GL
Navy – YD
Air Force – 99

Review activity:
Navy - MC

Preparing activity:
DLA – IS

(Project 4120-2007-001)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:27Z
Check the source to verify that this is the current version before use.