MIL-F-15160/76B(SHIPS)
16 June 1969
SUPERSEDING
MIL-F-15160/76A(SHIPS)
7 June 1967

MILITARY SPECIFICATION SHEET

FUSES, STYLE F76

The complete requirements for procuring style F76 fuses described herein shall consist of this document and the latest issue of Specification MIL-F-15160.

1. SCOPE

1.1 This specification covers the detailed requirements for fuses style F76.

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issue in effect on date of invitation for bids, or request for proposal, form a part of this specification to the extent specified herein:

SPECIFICATIONS

MILITARY
MIL-F-15160 - Fuses; Instrument, Power, and Telephone.

(Copies of specifications, standards, drawings, and publications required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

3. REQUIREMENTS

3.1 General requirements. Fuses shall be in accordance with MIL-F-15160, and as specified herein. The electrical and physical requirements shall be as shown in figure 1 and in tables I, II and III.

Ⓑ Table I - Physical requirements

Indicating fuse	
Case material	Fibre
Pin and ring contact Ferrules Spring	Brass: Silver plated Material: brass Finish: Nickel or bright alloy plate Phosphor bronze
Terminal strength	2 pound-inch-torque

Table II - Electrical requirements

Characteristic A	5 amperes or less - 125 volts max. 20 amperes or less - 32 volts max.	
	Percent nominal rating	Normal blowing time
Overload blowing	135	0-1 hour
Short circuit	10,000 amperes at rated voltage DC	

Ⓑ denotes changes.

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:50Z
Check the source to verify that this is the current version before use.

(B)

Table III - Style, characteristic, current and voltage ratings.

Type designation			
Style	Characteristic	Voltage	Current
F76	A	125V	3/4 A
F76	A	125V	1 A
F76	A	125V	1-1/2 A
F76	A	125V	2 A
F76	A	125V	3 A
F76	A	125V	4 A
F76	A	125V	5 A
F76	A	32V	6 A
F76	A	32V	8 A
F76	A	32V	10 A
F76	A	32V	12 A
F76	A	32V	15 A
F76	A	32V	20 A

4. QUALITY ASSURANCE PROVISIONS

4.1 Sampling and inspection. Sampling and inspection shall be in accordance with MIL-F-15160.

4.2 Qualification. Qualification specimens required:

(a) 24 samples maximum current rating of each voltage and design.
(b) 24 samples minimum current rating of each voltage and design.

5. PREPARATION FOR DELIVERY

5.1 Preparation for delivery shall be in accordance with MIL-F-15160.

5.1.1 The standard unit package is 5 pieces.

6. NOTES

6.1 The notes specified in MIL-F-15160 are applicable to this specification.

6.2 Ordering data required by MIL-F-15160 shall be included in all procurement documents.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:50Z
Check the source to verify that this is the current version before use.

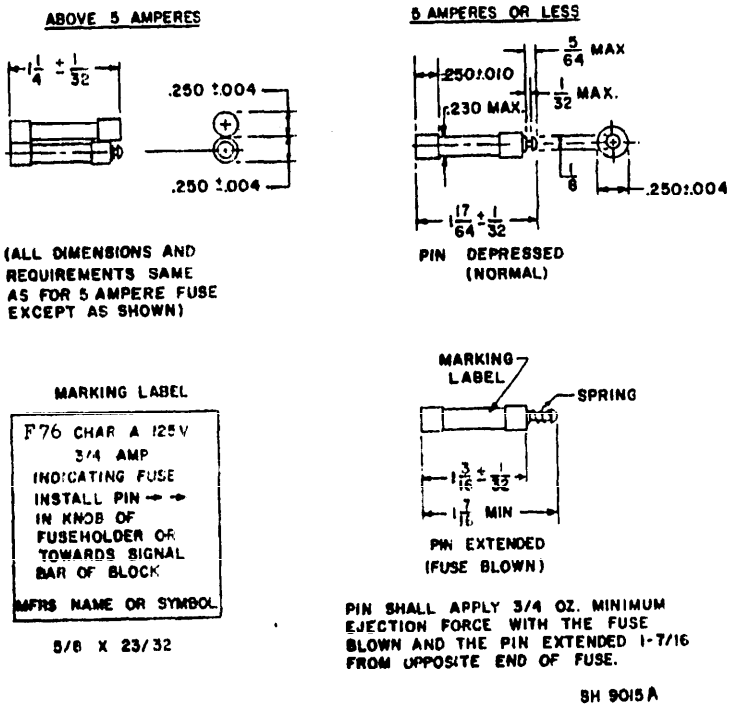


Figure 1 - Type F76 fuse.

Preparing activity:
Navy - SH
(Project 5920-N142-2)

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:50Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:50Z
Check the source to verify that this is the current version before use.