
MILITARY SPECIFICATION SHEET

FUSES, CARTRIDGE, INSTRUMENT POWER AND TELEPHONE (NONINDICATING), STYLE F82

This specification sheet is approved for use by all Departments and Agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation MIL-F-15160

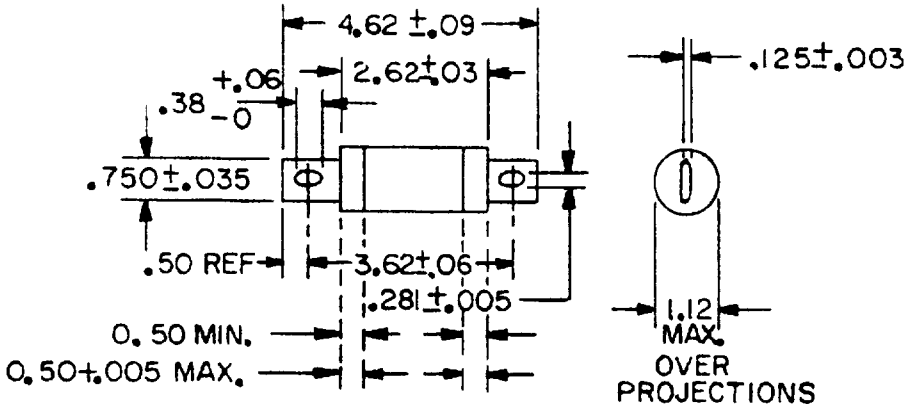

INCHES	MM	INCHES	MM
0.003	0.08	0.50	12.70
0.005	0.13	0.750	19.05
0.03	0.76	1.00	25.40
0.035	0.89	1.12	28.45
0.06	1.52	2.62	66.55
0.09	2.29	3.62	91.95
0.125	3.18	4.62	117.35
0.281	7.14		

FIGURE 1 Style F82.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest 0.01mm) are given for general information only and are based upon 1 inch = 25.4mm
3 The end of the ferrule shall be flat with not greater than 0.015 inch (0.38mm) concavity

FIGURE 1 Style F82 - Continued

TABLE I Electrical requirements.

Voltage rating	600 ac
Overload test 1/	
135%	0-2 hour
500%	10-30 seconds
Short circuit test at 600 Vac	10,000A (P F 50% or less) 200,000A (P F 20% or less)

1/ Overload is as shown as a percentage of the current rating of the fuse

REQUIREMENTS
Design and Construction See figure 1
Physical
Material
Case Glass melamine
Knife blade Copper
Ferrule Brass
Finish Nickel, bright alloy or bright dipped Silver plated when specified
Shock Method 207 of MIL-STD-202, H I shock
Vibration Method 204 of MIL-STD-202, test condition A (except 5g, 500 Hz)
Terminal strength Method 211 of MIL-STD-202, pound-inch of torque
Electrical Electrical requirements shall be as specified in table I
Type designation The type designation shall be as specified in table II
Qualification Required

TABLE II Type designation 1/

Style	Characteristics	Rated Voltage	Rated Current
F82	B	600V	70A
F82	B	600V	80A
F82	B	600V	90A
F82	B	600V	100A

1/ For silver plated terminals, the designator "S" is added after the current rating

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.

QUALITY ASSURANCE PROVISIONS

Qualification inspections The number of qualification samples required shall be

(a) 24 samples of the maximum current rating of each voltage and design
(b) 24 samples of the minimum current rating of each voltage and design

PACKAGING

Preservation. Preservation shall be in accordance with the level specified in MIL-F-15160 The quantity per unit (interior) pack shall be 5 fuses

Custodians
Army - ER
Navy - SH
Air Force - 85

Review Activities
Army - MI, AR
Navy - AS, OS, MC YD, EC
Air Force - 17, 80, 99

User Activities
Army - ME, AT
Navy - MC, CG
Air Force - 19

Preparing activity
Navy - SH
(Project 5920-0467)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.