INCH-POUND
MIL-PRF-15160/82A
12 October 1999
SUPERSEDING
MIL-PRF-15160/82
3 March 1993

PERFORMANCE SPECIFICATION SHEET

FUSES, CARTRIDGE, INSTRUMENT, POWER AND TELEPHONE (NONINDICATING), STYLE F82

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification and MIL-PRF-15160.

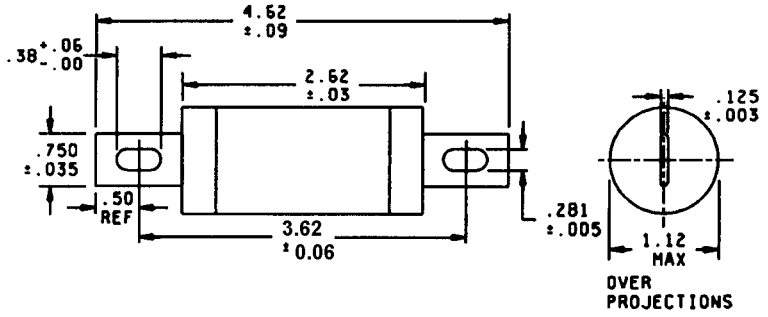

Inches	mm	Inches	mm	Inches	mm
0.003	.08	0.09	2.29	1.00	25.40
0.005	.13	0.125	3.18	1.12	28.45
0.03	.76	0.281	7.14	2.62	66.55
0.035	.89	0.50	12.70	3.62	91.95
0.06	1.52	0.750	19.05	4.62	117.35

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. The end of the ferrule shall be flat with not greater than 0.015 inch (0.38 mm) concavity.

FIGURE 1. Style F82.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Case: Glass melamine.

Knife blade: Copper.

Ferrule: Brass.

Finish: Nickel, bright alloy or bright dipped. Silver plated when specified.

Shock: Method 207 of MIL-STD-202, HI shock.

Vibration: Method 204 of MIL-STD-202, test condition A (except 5g peak).

Terminal strength: Method 211 of MIL-STD-202, inch-pound of torque.

Electrical: Electrical requirements shall be as specified in table I.

TABLE I. Electrical requirements.

Voltage rating	600 V ac
Overload test 1/	
135%	0 – 2 hour
500%	10 – 30 seconds
Short circuit test at 600 V ac	10,000A (P.F. 50% or less) 200,000A (P.F. 20% or less)

1/ Overload is as shown as a percentage of the current rating of the fuse.

Type designation: Type designation shall be as specified in table II.

TABLE II. Type designation and electrical rating. 1/

Style	Characteristic	Maximum Voltage	Current
F82	B	600V	70A
F82	B	600V	80A
F82	B	600V	90A
F82	B	600V	100A

1/ For silver plated terminals, the designator “S” is added after the current rating.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.

VERIFICATION:

Qualification inspections: The number of qualification samples required shall be:

a. 24 samples maximum current rating of each voltage and design.

b. 24 samples minimum current rating of each voltage and design.

NOTE: If labels are used, five additional samples of any rating are required.

Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Custodians:
Army - CR
Navy - SH
Air Force - 11
DLA - CC

Review activities:
Army - AR, AT, CR4, MI
Navy - AS, CG, EC, MC, OS, YD2
Air Force - 19, 80, 99

Preparing activity:
DLA - CC

(Project 5920-0607-14)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:51Z
Check the source to verify that this is the current version before use.