MIL-F-18113D
6 February 1984
SUPERSEDING
MIL-F-18113C
29 FEBRUARY 1975

MILITARY SPECIFICATION

FEEDERS, BOILER WATER TREATMENT, BY-PASS AND COMPOUND RECEIVER TYPES

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers pressure-type chemical solution feeders for treatment of boiler feed water or raw makeup water.

1.2 Classification. The chemical feeders shall be of the following types and styles as specified (see 6.2.1):

Type I - Automatic proportioning feeder.
Type II - Shot-type feeder (manual, intermittent feed).

Style A - For use with pressure systems up to 200 pounds force per square inch gage (psig) maximum.
Style B - For use with pressure systems up to 500 psig maximum.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. Unless otherwise specified (see 6.2.1), the following specifications and standards of the issue listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation, form a part of this specification to the extent specified herein.

SPECIFICATIONS

FEDERAL

PPP-B-636 - Boxes, Shipping, Fiberboard.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commanding Officer (Code 156), Naval Construction Battalion Center, Port Hueneme, CA 93043, by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or letter.

FSC 4410

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

MILITARY

MIL-V-3 - Valves, Fittings, and Flanges (Except for Systems Indicated Herein), Packaging of.
MIL-P-116 - Preservation, Methods of.
MIL-T-22085 - Tape, Adhesive, Preservation and Sealing.

STANDARDS

MILITARY

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.
MIL-STD-889 - Dissimilar Metals.
MIL-STD-794 - Parts and Equipment, Procedures for Packaging of.
MIL-STD-1186 - Cushioning, Anchoring, Bracing, Blocking, and Waterproofing, with Appropriate Test Methods.

(Copies of specifications, standards, handbooks, drawings, and publications required by manufacturers in connection with specific acquisition functions should be obtained from the contracting activity or as directed by the contracting officer.)

2.2 Other publications. The following document forms a part of this specification to the extent specified herein. The issues of the documents which are indicated as DoD adopted shall be the issue listed in the current DoDISS and the supplement thereto, if applicable.

AMERICAN NATIONAL STANDARDS INSTITUTE, INC. (ANSI)

ANSI B36.10 - Welded and Seamless Wrought-Steel Pipe.

(Application for copies should be addressed to the American National Standards Institute, 1430 Broadway, New York, NY 10018.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

2.3 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein, the text of this specification shall take precedence.

3. REQUIREMENTS

3.1 Description. The feeders shall consist primarily of a reservoir, by-pass or shut-off valves, air-cock valve, globe valve (when required), fittings, and piping.

3.2 First article. When specified (see 6.2.1), the contractor shall furnish a feeder for first article inspection and approval (see 4.2.1 and 6.3).

Source: https://assist.dla.mil -- Downloaded: 202610-18T10:59Z
Check the source to verify that this is the current version before use.

3.3 Materials. Materials used shall be free from defects which would adversely affect the performance or maintainability of individual components or of the overall assembly. Materials not specified herein shall be of the same quality used for the intended purpose in commercial practice. Unless otherwise specified herein, all equipment, material, and articles incorporated in the work covered by this specification are to be new and fabricated using materials produced from recovered materials to the maximum extent possible without jeopardizing the intended use. The term "recovered materials" means materials which have been collected or recovered from solid waste and reprocessed to become a source of raw materials, as opposed to virgin raw materials. None of the above shall be interpreted to mean that the use of used or rebuilt products are allowed under this specification.

3.3.1 Dissimilar materials. Intimate contact of dissimilar metals, as defined in MIL-STD-889, which can be expected to cause galvantic corrosion shall have an interposing insulating material provided to minimize the corrosive effect. The insulating material shall be suitable for operation at pressures up to 500 psig and temperatures up to 250 degrees Fahrenheit (°F).

3.4 Interchangeability. All units of the same classification furnished with similar options under a specific contract shall be identical to the extent necessary to insure interchangeability of component parts, assemblies, accessories, and spare parts.

3.5 Design. Feeders shall be designed to inject chemical solutions into boiler feedwater piping. Feeder designs shall be of two types, type I shall be an automatic proportioning unit and type II shall be a shot-type (manual intermittent feed) unit. The design shall be suitable for operation at temperatures up to 250 °F.

3.5.1 Type I. The type I automatic proportioning feeder is designed for operation on a pressure differential created across an orifice, a pump, or lift check valve thereby producing a proportional feed of chemical solution. The feeder shall incorporate design requirements such that the feeder may be shut off from its feed-water piping while the pressure feed tank is being filled with the treatment solution. Each tank shall be equipped for drainage to a waste receptacle. An air-cock, for venting accumulated air, shall be provided for each pressure tank. A valve shall be provided on the inlet side of the feeder to adjust the chemical solution rate of flow. Unless otherwise specified, (see 6.2.1), the design shall incorporate a gage glass to indicate the quantity of chemical solution in the feeder. All the chemical piping, valves, and fittings used in the feeding of alum solution shall be of brass, copper, or copper alloy. Unless otherwise specified, (see 6.2.1), type I feeders shall be designed with a quick opening 3.5 inch minimum access on the top of the tank. When an access of less than 3.5 inches is provided, the design shall incorporate a funnel and associated valve to facilitate the filling operation. The minimum effective capacity of type I feeders shall be as specified, (see 6.2.1). Typical sizes for type I feeders are; 1 gallon, 2 to 2.5 gallon, 5 to 6 gallon, and 10 to 12.5 gallon. Type I feeders may be designed for either floor mounting or mounting to the existing boiler feedwater piping as specified (see 6.2.1). Capacity of units designed to mount to the existing feedwater piping shall not exceed 2.5 gallon. Typical design, construction, and connections for type I feeders is shown by figure I.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

3.5.1.1 Type I style A. The type I style A proportional feeder shall be designed to operate at a maximum pressure of 200 psig.

3.5.1.2 Type I style B. The type I style B feeder shall be designed to operate at a maximum pressure of 500 psig.

3.5.2 Type II. The type II feeder shall be so designed that a measured amount of chemical solution can be manually introduced into the feeder receiver and subsequently transferred to the boiler feedwater piping. The feeder shall incorporate design requirements such that the feeder may be shut off from its feed-water piping while the pressure feed tank is being filled with the treatment solution. Each tank shall be equipped for drainage to a waste receptacle. An air-vent, for venting accumulated air, shall be provided for each pressure tank. Unless otherwise specified, (see 6.2.1), the design shall incorporate a gage glass to indicate the quantity of chemical solution in the feeder. All chemical piping, valves, and fittings used in the feeding of alum solution shall be of brass, copper, or copper alloy. Unless otherwise specified, (see 6.2.1), type II feeders shall be designed with a quick opening 3.5 inch minimum access on the top of the tank. When an access of less than 3.5 inches is provided, the design shall incorporate a funnel and associated valve to facilitate the filling operation. The minimum effective capacity of type II feeders shall be as specified, (see 6.2.1). Typical sizes for type II feeders are; 1 gallon, 2 to 2.5 gallon, 5 to 6 gallon, and 10 to 12.5 gallon. Type II feeders may be designed for either floor mounting or mounting to the existing boiler feedwater piping as specified (see 6.2.1). Capacity of units designed to mount to the existing feedwater piping shall not exceed 2.5 gallon. Typical design, construction, and connections for type II feeders is shown by figure II.

3.5.2.1 Type II style A. The type II style A shot-type feeder is designed to operate at a maximum pressure of 200 psig.

3.5.2.2 Type II style B. The type II style B shot-type feeder is designed to operate at a maximum pressure of 500 psig.

3.6 Performance.

3.6.1 Type I. The type I automatic proportioning feeder, per charge of chemical solution, shall be capable of discharging the entire contents of the feeder when the quantity of water specified (see 6.2.1), is passed through the feed water piping at a differential pressure across the feeder as specified (see 6.2.1).

3.6.2 Type II. The type II shot-type manual feeder, per charge of chemical solution, shall be capable of discharging the entire contents of the receiver when a quantity of water equivalent to twice the volume of the feeder is passed through the feed water piping.

3.7 Construction.

3.7.1 Receiver. Physical configuration of the receiver for type I feeders shall be in accordance with figure 1. Physical configuration of the receiver for type II feeders shall be in accordance with figure II. Unless otherwise specified, (see 6.2.1), the body of type I and type II feeder receivers shall

Source: https://assist.dla.mil -- Downloaded: 202610-18T10:59Z
Check the source to verify that this is the current version before use.

be a section of schedule 80 seamless, carbon steel pipe in accordance with ANSI B36.10. The ends shall either be threaded and fitted with threaded flanges or shall be of a welded construction. The ends, when installed or assembled, shall be capable of sustaining the operating pressure specified at feedwater temperatures up to 250 °F (see 6.2.1). The receiver shall be drilled and tapped where applicable, to accommodate the feed, filling, drain, and vent connections, and the body shall be drilled and tapped to accommodate the gage glass fittings.

3.8 Feeder components.

3.8.1 Gage glass. The gage glass shall be furnished with shut-off cocks at top and bottom, and shall be designed to withstand the operating pressure specified for the receiver.

3.8.2 Funnel. The funnel required for type I and type II feeders shall be fabricated from sheet copper having a minimum thickness of .060 inches.

3.8.3 Valves, fitting, and piping. Unless otherwise specified, (see 6.2.1), the valves, fittings, and piping shall be a minimum of 3/4 inch National Pipe Size (see figure I). All valves fittings and piping shall be of a type and material suitable for the operating pressure and temperature specified.

3.8.4 Union. Each feeder shall be furnished with unions on both the inlet and outlet connections. The size of the unions shall correspond to the inlet and outlet pipe size of the feeder.

3.9 Treatment and painting. Unless otherwise specified (see 6.2.1), the feeder shall be treated and painted in accordance with the manufacturer's standard practice. All external surfaces of the feeder other than corrosion-resisting steel shall be protected against corrosion and present a neat appearance.

3.10 Identification marking. Identification shall be permanently and legibly marked directly on the feeder or on a corrosion-resisting metal plate securely attached to the feeder at the source of manufacturer. Identification shall include the manufacturer's model and serial number, name, date of manufacture, size, and pressure rating.

3.11 Instruction Plates. The feeder shall be equipped with instruction plates suitably located, describing any special or important procedures to be followed in operating and servicing the equipment. Plates shall be of a material which will last and remain legible for the life of the equipment, and shall be securely affixed to the feeder receiver.

3.12 Workmanship. The quality of workmanship shall be such as to produce feeders that are in accordance with the requirements of this specification and standards prevailing among manufacturers normally producing this equipment.

3.12.1 Steel fabrication. The steel used in fabrication shall be free from kinks, sharp bends, and other conditions which would be deleterious to the finished product. Manufacturing processes shall not reduce the strength

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

of the steel to a value less than intended by the design. Manufacturing processes shall be done neatly and accurately. All bends shall be made by controlled means to insure uniformity of size and shape.

3.12.2 Welding. Welding procedures shall be in accordance with a nationally recognized welding code. The surface of parts to be welded shall be free from rust, scale, paint, grease, or other foreign matter. Welds shall be of sufficient size and shape to develop the full strength of the parts connected by the welds. Welds shall transmit stress without permanent deformation or failure when the parts connected by the weld are subjected to proof and service loadings.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Component and material inspection. Components and materials shall be inspected in accordance with all the requirements specified herein and in applicable referenced documents.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.2.1).
b. Quality conformance inspection (see 4.2.2).
c. On-site testing (see 4.2.3).

4.2.1 First article inspection. The first article inspection shall be performed on one feeder when a first article is required (see 3.2 and 6.2.1). This inspection shall include the examination of 4.4, and the tests of 4.5. The first article may be either a first production item or a standard production item from the supplier's current inventory provided the item meets the requirements of the specification and is representative of the design, construction, and manufacturing technique applicable to the remaining items to be furnished under the contract.

4.2.2 Quality conformance inspection. The quality conformance inspection shall include the examination of 4.4, the test of 4.5.1, 4.5.2, and the packaging inspection of 4.6. This inspection shall be performed on the samples selected in accordance with 4.3.

4.2.3 On-site testing. When specified (see 6.2.1), testing shall be performed on the units at the site after installation. This testing shall be in addition to quality conformance inspection performed at the factory, and shall be supplemental to the first article inspection, if such inspection is specified. On-site testing shall include the test of 4.5 to verify compliance

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

with the performance requirements of this specification. On-site testing shall be performed either by the feeder manufacturer or by the installing contractor, as specified (see 6.2.1). The manufacturer shall have the privilege of representation at tests performed by others. When the manufacturer is responsible for on-site test, the detailed requirements and schedule for the test program will be as specified in the contract (see 6.2.1). In all cases, deficiencies revealed by on-site testing shall be corrected at the feeder manufacturer's expense, and any required retesting shall also be at the manufacturer's expense.

4.3 Sampling. Sampling and inspection procedures shall be in accordance with MIL-STD-105. All feeders offered for delivery at one time shall be considered a lot for the purpose of inspection. If an inspection lot is rejected, the contractor may rework it to correct the defects, or screen out the defective units, and resubmit for a complete reinspection. Resubmitted lots shall be reinspected. If the rejected lot was screened, reinspection shall be limited to the defect causing rejection. If the lot was reprocessed, reinspection shall be performed for all defects. Rejected lots shall be separate from new lots, and shall be clearly identified as reinspected lots.

4.3.1 Sampling for examination. Examination shall be based on inspection level II and an acceptable quality level (AQL) of 1.5 percent defective for major defects and 6.5 percent for minor defects.

4.3.2 Sampling for tests. Tests shall be based on inspection level S-2 and an AQL of 2.5 percent defective.

4.4 Examination Each feeder selected shall be examined for defects listed in table I.

TABLE I. Classification of defects.

Classification	Defects	Requirement paragraph
Critical:	None defined.	
Major:		
101	Material not as specified	3.3
102	Design not as specified.	3.5
103	Physical configuration not as specified.	3.7.1,
104	Component parts, assemblies, and accessories, not as specified.	3.8.1, 3.8.2 3.8.3, 3.8.4
105	Workmanship not as specified.	3.12
Minor:		
201	Treatment and painting not as specified.	3.9
202	Identification marking missing, incomplete or not legible.	3.10
203	Instruction plate missing, incomplete, or not legible.	3.11

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

4.5 Tests. Each sample selected in accordance with 4.3.2 (including the first article sample when required) shall be tested. Any unit failing to pass the tests of 4.5.1, 4.5.2, and 4.5.3, as applicable, shall be rejected. Tests shall be conducted as outlined in the referenced documents as herein specified.

4.5.1 Performance. Each feeder selected shall be tested for conformance to the applicable performance requirements of section 3. Nonconformance to the applicable performance requirements of section 3 shall constitute failure of the unit.

4.5.2 Hydrostatic. The pressure tanks shall be subjected to a hydrostatic test pressure equal to 1.5 times the specified operating pressure. Any evidence of leakage, sweating, or deformation shall be cause for rejection.

4.5.3 Operational. The feeders shall be tested within the full operating pressures, and flow requirements specified herein and in resulting contractual documents. Failure of the feeders to perform satisfactorily at the full operating limits specified shall be cause for rejection.

4.6 Packaging inspection. The preservation, packing, and marking of the item shall be inspected to verify conformance to the requirements of section 5.

5. PACKAGING

5.1 Preservation. Preservation shall be level A or commercial as specified (see 6.2.1).

5.1.1 Level A.

5.1.1.1 Methods of preservation. Cleaning processes, drying procedures, preservatives, and methods of preservation specified in the following paragraphs are listed in MIL-P-116 and shall conform to the requirements of MIL-P-116 and any applicable specifications.

5.1.1.2 Disassembly. Disassembly shall be the minimum necessary to protect parts subject to damage or loss, and to accomplish reduction in cube. Removed bolts, nuts, pins, screws and washers shall be reinstalled in mating parts and secured to prevent their loss.

5.1.1.3 Matchmarking. Parts removed and mating parts on the equipment and attachments shall be matchmarked to facilitate reassembly. Parts and accessories removed, and mating parts on the equipment, shall be identified with weatherproof tags attached to mating parts and locations. Markings shall be applied to the tags with a waterproof material.

5.1.1.4 Cleaning and drying. Prior to the application of preservative compounds or paint, surfaces shall be cleaned by process C-1 and dried by any applicable procedure of MIL-P-116.

5.1.1.5 Valves and fittings. Valves and fittings shall be preserved and packaged in accordance with the level A requirements of MIL-V-3.

5.1.1.6 Gage glasses. Gage glasses shall be packaged by method IC-2.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

5.1.1.7 Tanks and ferrous metal piping. Interior surfaces of the tanks and piping shall be coated with type P-21 preservative. Excess preservative shall be drained. Openings into the tank shall be sealed with caps, plugs, or with tape conforming to MIL-T-22085, type II.

5.1.1.8 Technical publications. Technical publications for each piece of equipment shall be preserved method IC-1 or IC-3.

5.1.1.9 Repair parts. The preservative application criteria and applicable methods of preservation of MIL-P-116 shall be used to preserve repair parts.

5.1.1.10 Consolidation. Tools, repair parts and publications for each feeder shall be consolidated in containers conforming to PPP-B-636, class weather-resistant. Contents shall be cushioned, blocked, and braced to prevent movement in accordance with MIL-STD-1186.

5.1.2 Commercial. The equipment shall be preserved in accordance with the contractor's standard practice in a manner to prevent deterioration and damage.

5.2 Packing. Packing shall be level A, B, or commercial as specified (see 6.2.1).

5.2.1 Levels A and B. Packing shall be in accordance with MIL-STD-794. Containers shall be selected from table I for the appropriate level. Only closed containers shall be selected.

5.2.2 Commercial. The equipment shall be prepared for shipment in a manner which will insure arrival at destination in a satisfactory condition. Preparation for delivery shall comply with applicable carrier rules and regulations.

5.3 Marking. Marking shall be in accordance with MIL-STD-129.

6. NOTES

6.1 Intended use. The automatic proportioning feeders covered by this specification are intended for feeding alum and alkali solutions into raw water piping ahead of filters or for feeding ordinary internal boiler water treatment solutions into the feed water piping. The capacity of the feeder selected should ordinarily be such that one charge of solution of the desired strength will suffice for 24 hours of operation. The shot-type feeders, covered by this specification are intended for injecting boiler water treatment solutions into the feed water piping in manually-controlled doses, and are ordinarily suitable for operating pressures up to 500 psig, and temperatures up to 250 °F.

6.1.1 Raw water treatment. For raw water treatment, a sediment tank or self-cleaning strainer shall be provided in the pipe leading to the high pressure side of the feeder.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

6.2 Ordering data.

6.2.1 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of this specification.
b. Type and style of feeder (see 1.2).
c. When compliance with reference specifications is not required (see 2.1.1).
d. When a first article sample is required for inspection and approval (see 3.2, 4.2.1, and 6.3).
e. When a gage glass is not required (see 3.5.1 and 3.5.2).
f. When the access to the feeder is to be other than as specified (see 3.5.1 and 3.5.2).
g. Minimum effective capacity of the feeder (see 3.5.1 and 3.5.2).
h. If the feeder is to be floor mounted or mounted to the existing feedwater piping (see 3.5.1 and 3.5.2).
i. Minimum quantity of feedwater flow required to transfer the entire contents of a type I feeder into the feed water piping and the feedwater pressure differential (see 3.6.1).
j. Material of receiver, if other than as specified (see 3.7.1).
k. Operating pressure of receiver (see 3.7.1).
l. Size of valves, fittings, and piping required (see 3.8.3).
m. Treatment and painting, if different (see 3.9).
n. When first article testing is required (see 4.2.1).
o. When on-site testing is required (see 4.2.3).
p. Who will perform on-site testing (see 4.2.3).
q. When detailed test requirements and schedule are required (see 4.2.3).
r. Level of preservation and level of packing required (see 5.1 and 5.2).

6.2.2 Data requirements. When this specification is used in an acquisition which incorporates a DD Form 1423, Contract Data Requirements List (CDRL), the data requirements identified below shall be developed as specified by an approved DD Form 1664, Data Item Description (DID), and delivered in accordance with the approved CDRL incorporated into the contract. When the provisions of paragraph 7-104.9(n) of the Defense Acquisition Regulations are invoked and the DD Form 1423 is not used, the data specified below shall be delivered by the contractor in accordance with the contract or purchase order requirements. Deliverable data required by this specification is cited in the following paragraphs:

Paragraph No.	Data requirements title	Applicable DID No.	Option
5.1.1.9	Publications, Commercial	DI-M-24006B	None

(DIDs related to this specification, and identified in section 6 will be approved and listed as such in DoD 5000.19L, Vol. II, Acquisition Management Systems and Data Requirements Control List. Copies of DIDs required by the contractors in connection with specific acquisition functions should be obtained from the Naval Publications and Forms Center or as directed by the contracting officer.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

6.3 First article. When a first article inspection is required, the item will be tested and should be a first production item or it may be a standard production item from the contractor's current inventory as specified in 4.2.1. The first article should consist of one complete feeder. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examination, test, and approval of the first article.

6.4 Changes from previous issue. Asterisks are not used in this revision to identify changes with respect to the previous issue, due to the extensiveness of the changes.

Custodians:

Navy - YD
Air Force - 99

User Activity:

Army - ME

Review Activity:


Air Force - 84

Preparing Activity:


Navy - YD

Project No. 4410-0054

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

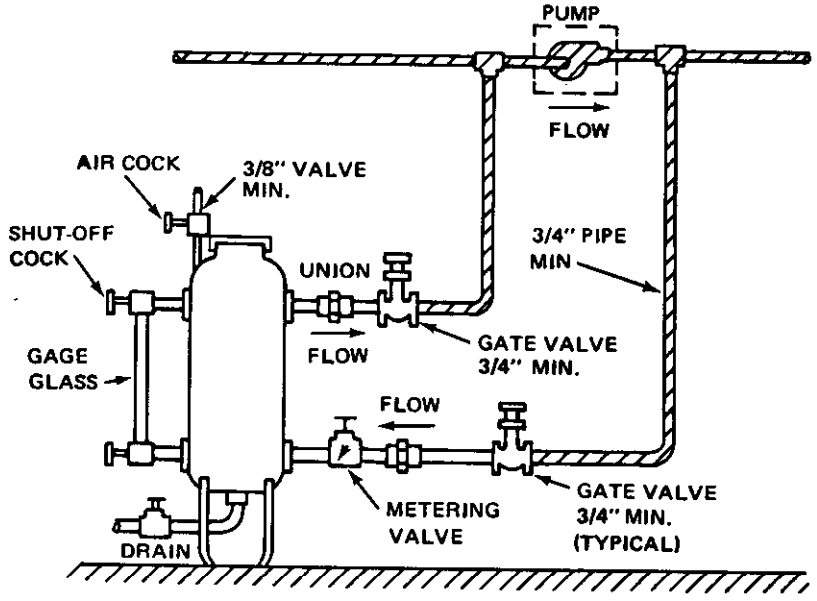

TYPE I STYLE A, (TYPICAL)

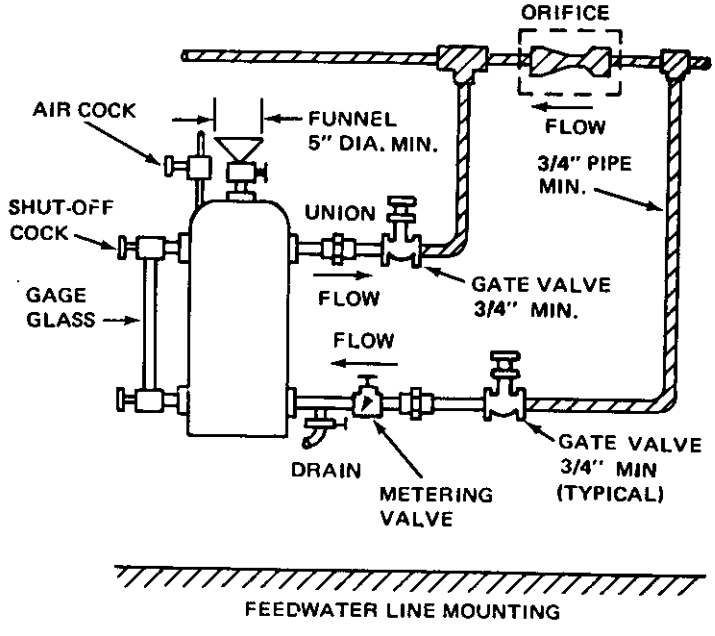


TYPE I STYLE B, (TYPICAL)


NOTE. PARTS SHOWN IN CROSS-HATCH NOT FURNISHED AS PART OF THE FEEDER.

FIGURE 1. TYPE I STYLE A AND STYLE B FEEDERS.

Source: https://assist.dla.mil -- Downloaded: 202610-18T10:59Z
Check the source to verify that this is the current version before use.

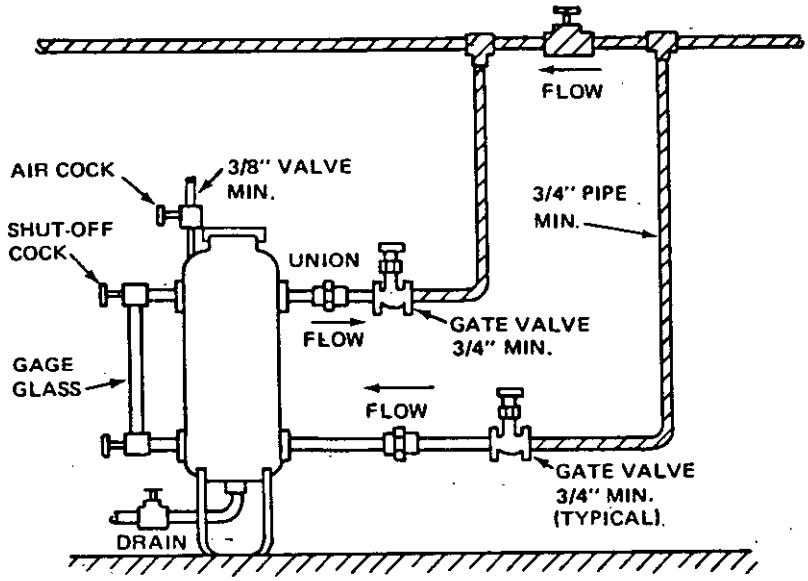

TYPE II STYLE A, (TYPICAL)

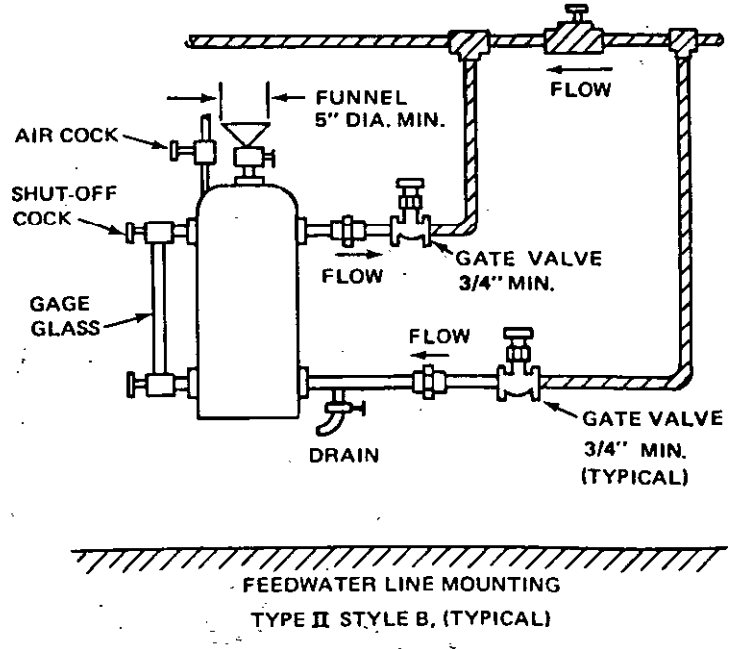

TYPE II STYLE B, (TYPICAL)

NOTE: PARTS SHOWN IN CROSS-HATCH NOT FURNISHED AS PART OF THE FEEDER.

FIGURE 2. TYPE II STYLE A AND STYLE B FEEDERS.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document*(s)* or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE NAVY
Commander
Naval Facilities Engineering Command
200 Stovall Street
Alexandria, VA 22332

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 12503 WASHINGTON D C.
POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE NAVY

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATES

Commanding Officer (156)
Naval Construction Battalion Center
Port Hueneme, CA 93043

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:59Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-F-18113D	FEEDERS, BOILER WATER TREATMENT, BY-PASS AND COMPOUND RECEIVER TYPES

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR
b. ADDRESS *(Street, City, State, ZIP Code)*	☐ USER
	☐ MANUFACTURER
	☐ OTHER *(Specify)*: _____

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

DD FORM 82 MAR 1426 PREVIOUS EDITION IS OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 202610-18T10:59Z
Check the source to verify that this is the current version before use.