MILITARY SPECIFICATION

GENERATOR SET, DIESEL ENGINE, TRAILER MOUNTED

60 KW, 400 HERTZ, PU-707 A/M

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 This specification covers a trailer-mounted generator set (hereinafter referred to as a power unit) designated PU-707 A/M. The power unit consists of a Department of Defense design, diesel-engine-driven, 60 kW, 400 Hertz generator set, various auxiliary equipment, brackets, and hardware mounted on a modified Government-furnished trailer chassis.

2. APPLICABLE DOCUMENTS

2.1 The following documents of the issue in effect on date of invitation for bids or request for proposal form a part of this specification to the extent specified herein:

SPECIFICATIONS

Federal

FF-N-105	- Nails, Brads, Staples and Spikes: Wire, Cut and Wrought.
NN-P-530	- Plywood, Flat Panel.
QQ-S-781	- Strapping, Steel, and Seals.
UU-T-81	- Tags, Shipping and Stock.
PPP-B-591	- Boxes, Fiberboard, Wood-Cleated.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

PPP-B-601	- Boxes, Wood, Cleated-Plywood.
PPP-B-636	- Boxes, Shipping, Fiberboard.
PPP-F-320	- Fiberboard; Corrugated and Solid, Sheet Stock (Container Grade), and Cut Shapes.
PPP-P-40	- Packaging and Packing of Hand Tools.
PPP-T-60	- Tape: Packaging, Waterproof.
PPP-T-97	- Tape, Pressure-Sensitive Adhesive, Filament Reinforced.

Military

MIL-P-116	- Preservation-Packaging, Methods of.
MIL-B-131	- Barrier Material, Water Vaporproof, Flexible, Heat-Sealable.
MIL-E-10062	- Engines: Preparation for Shipment and Storage of.
MIL-G-12803	- Gasket Material, Non-Metallic.
MIL-E-16298	- Electric Machines Having Rotating Parts and Associated Repair Parts: Packaging of.
MIL-C-45150	- Chassis, Trailer, 2-Wheel, Cart Type, 1/4- to 3-1/2-Ton.

STANDARDS

Military

MIL-STD-105	- Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	- Marking for Shipment and Storage.
MIL-STD-281	- Automobiles, Trucks, Truck-Tractors, Trailers and Trailer Dollies; Preservation and Packaging of.
MS16992	- Bolt (Screw), Lag, Hex Head, Gimlet Point.
MS27183	- Washer, Flat-Round, Steel, Cadmium Plated, General Purpose (In/MM).
MS35355	- Bolt, Machine, Square Head, Steel, Cadmium or Zinc Plated, UNC-2A.
MS51922	- Nut, Self-Locking, Hexagon-Prevailing Torque, General Purpose, 250° F, UNC-2B and UNF-2B.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

DRAWINGS

ME

TA13220E6332	- Generator Set, Diesel Engine, Trailer Mounted, 60 KW 400 Hz, PU-707A/M.

(Copies of specifications, standards, and drawings required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless otherwise indicated, the issue in effect on date of invitation for bids or request for proposal shall apply.

NATIONAL MOTOR FREIGHT TRAFFIC ASSOCIATION, INC., AGENT

National Motor Freight Classification.

(Application for copies should be addressed to the American Trucking Associations, Inc., ATTN: Order Section, 1616 P Street, NW, Washington DC 20036.)

UNIFORM CLASSIFICATION COMMITTEE, AGENT

Uniform Freight Classification.

(Application for copies should be addressed to the Uniform Classification Committee, ATTN: Tariff Publishing Officer, Room 1106, 222 South Riverside Plaza, Chicago, IL 60606.)

U. S. DEPARTMENT OF COMMERCE

Product Standard

PS1 - Softwood Plywood; Construction and Industrial.
PS51 - Hardwood and Decorative Plywood.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

(Application for copies should be addressed to the Superintendent of Documents, Government Printing Office, Washington, DC 20402.)

3. REQUIREMENTS

3.1 Description. The PU-707 A/M shall be in accordance with Top Assembly TA13220E6332 and as specified herein.

3.1.1 Drawings. The drawings forming a part of this specification are end product drawings. No deviation from the prescribed dimensions or tolerances is permissible without prior approval of the contracting officer. Any data (e.g. shop drawings, layouts, flow sheets, processing procedures, etc.) prepared by the supplier or obtained from a vendor to support fabrication and manufacture of the production item shall be made available, upon request, for inspection by the contracting officer or his designated representative.

3.2 First article (preproduction model). The supplier shall furnish one power unit for examination within the time frame specified (see 6.2) to prove prior to starting production that his production methods will produce power units that comply with the requirements of this specification. Examinations shall be as specified in Section 4 and shall be subject to surveillance and approval by the Government (see 6.3).

3.3 Material. Material shall be as specified herein and on the applicable drawings. Materials not specified shall be selected by the supplier and shall be subject to all provisions of this specification.

3.4 Government-furnished property. The following property in the quantities indicated will be furnished by the Government (see 6.4):

Item No.	Description	Identification	Quantity for each PU-707 A/M
1	Chassis, trailer, 2-1/2 ton, 2 wheel, Model M200A1	MIL-C-45150	1
2	Generator Set, diesel-engine-driven 60kW, 400 Hertz DOD Model MEP-115A	NSN 6115-00-118-1253	1

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

3.5 Workmanship. Workmanship shall be of a quality to assure that the power units are free from defects resulting from defective material, incorrect manufacturing or assembly practices, incorrect treatment and painting, incomplete welds, rust, cracks, and other defects that could impair its operation or serviceability.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or order, the supplier may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Disassembly inspection. Failure of the examination by the pre-production model shall be cause for disassembly in the presence of a Government representative of the preproduction model to the extent necessary to determine the cause of the failure. Each disassembled part shall be examined in detail for compliance with this specification and referenced drawings in regard to materials, dimensions, tolerances, and workmanship. Parts not complying with such requirements shall be rejected. Reassembly with accepted parts and retesting shall be the responsibility of the supplier. Government-furnished property shall be excluded from the requirements of this paragraph.

4.1.2 Component and material inspection. The supplier is responsible for insuring that components and materials used are manufactured, examined, and tested in accordance with referenced specifications and standards.

4.2 Classification of inspections. Inspections shall be classified as follows:

(a) Preproduction inspection (see 4.3).
(b) Quality conformance inspection (see 4.4).
(c) Inspection of preparation for delivery (see 4.6).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

4.3 Preproduction inspection.

4.3.1 Examination. The preproduction power unit shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection or shall be cause for performing the inspection specified in 4.1.1.

4.4 Quality conformance inspection.

4.4.1 Examination. Each power unit shall be examined for the defects specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.5 Inspection procedure.

4.5.1 Examination. The power units shall be examined for the following defects:

101. Treatment and painting not as specified.
102. Dimensions not as shown on drawings.
103. Components missing or not as specified.
104. Assembly not as shown on the drawings.
105. Workmanship not as specified.

4.6 Inspection of preparation for delivery.

4.6.1 Preproduction pack inspection. The preproduction pack shall be examined for the defects specified in 4.6.2.3. Presence of one or more defects shall be cause for rejection.

4.6.2 Quality conformance inspection of pack.

4.6.2.1 Unit of product. For the purpose of inspection, a completed pack prepared for shipment shall be considered a unit of product.

4.6.2.2 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.6.2.3 Examination. Samples selected in accordance with 4.6.2.2 shall be examined for the following defects. AQL shall be 2.5 percent defective.

106. Materials, containers or procedures not as specified. Each incorrect material, container or procedure shall constitute one defect.
107. Generator set not preserved as specified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

108. Fire extinguisher not removed and packaged as specified.
109. Ground cable not disconnected and secured and the cable and terminals not matchmarked as specified.
110. Repair parts and maintenance tools not preserved as specified.
111. Trailer chassis components not preserved as specified.
112. Hammer not removed from the bracket and secured as specified.
113. Packing not as specified.
114. Depreservation guides not prepared and attached to the power unit as specified.
115. Technical publications not preserved and secured as specified.
116. Marking illegible, incomplete, incorrect or missing.

5. PREPARATION FOR DELIVERY

5.1 Preproduction pack. The supplier shall furnish a preproduction pack for examination within the time frame specified (see 6.2) to prove prior to starting production packaging and packing that the applied preservation, packaging, packing, and marking comply with the preparation for delivery requirements of this specification. Examination shall be as specified in Section 4 and shall be subject to surveillance and approval by the Government (see 6.5). The preproduction pack may be accomplished utilizing either the preproduction model power unit or a production power unit. If the preproduction model power unit is utilized, any preservation, packaging, and packing shall be removed by the supplier at no expense to the Government, when requested by the Government to facilitate comparison between the preproduction model power unit and production power units. Government-furnished equipment (GFE) shall be preserved, packaged, and packed as specified herein, regardless of the preservation, packaging, and packing provided at time of receipt by the manufacturer.

5.2 Preservation and packaging. Preservation and packaging shall be Level A, B or C as specified (see 6.2). Packaging of power units and components shall be in accordance with Table I, Figures 1 and 2, and as specified herein.

5.2.1 Level A.

5.2.1.1 Generator set. The generator set shall be preserved in accordance with MIL-P-116, Method IIa. The generator set shall be secured directly through the barrier material to the trailer chassis, using the required mounting bolts. The humidity indicator and inspection port shall be installed on an end or side in a location convenient for inspection of the humidity indicator. Before inclosing the generator in the Method IIa barrier, the following preservation and packaging shall be accomplished.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

5.2.1.1.1 Engine. The engine and engine accessories shall be preserved in accordance with MIL-E-10062, Level A, Type II, Method II. Drivebelts shall be relieved from tension and tagged and battery cables shall be disconnected and secured as specified therein.

5.2.1.1.2 Fire extinguisher. The fire extinguisher shall be removed from the bracket and packaged in a box conforming to PPP-B-636, Type CF, Variety SW, Grade 125, style optional and shall be secured within the confines of the generator set.

5.2.1.1.3 Hammer. The hammer shall be removed from the brackets and secured to the generator set with tape conforming to PPP-T-97, Type IV.

5.2.1.1.4 Ground cable. The ground cable shall be disconnected from the generator set and trailer chassis. The cable and terminals on the power unit shall be matchmarked with cloth tags conforming to UU-T-81, Type A to facilitate reinstallation of the cable. The cable shall be stowed within the confines of the generator set.

5.2.1.2 Ground rods and fuel drum adapter. The ground rods and fuel drum adapter shall be placed in the accessory box.

5.2.1.3 Repair parts. The preservation application criteria and applicable submethods of MIL-P-116 shall be used to preserve and package the repair parts.

5.2.1.4 Maintenance tools. Maintenance tools shall be preserved in accordance with PPP-P-40, Level A.

5.2.1.5 Technical publications. Technical publications shall be preserved in accordance with MIL-P-116, Method IC-1 and shall be secured to the generator set outside the Method II barrier.

5.2.1.6 Trailer chassis. The trailer chassis components shall be preserved in accordance with MIL-STD-281, Level A as specified for mobile vehicles.

5.2.2 Level B.

5.2.2.1 Generator set. The generator set shall be preserved in accordance with MIL-E-16298, Level A, using the alternate method specified for assembled machines. Before covering the generator set the following preservation and packaging shall be accomplished.

5.2.2.1.1 Engine. The engine and engine accessories shall be preserved in accordance with MIL-E-10062, Level A, Method 1.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:11Z
Check the source to verify that this is the currentversion before use.

5.2.2.1.2 Fire extinguisher and hammer. The fire extinguisher and hammer shall be packaged as specified for Level A.

5.2.2.1.3 Ground cable. The ground cable shall be disconnected, match marked and stowed as specified for Level A.

5.2.2.2 Ground rods and fuel drum adapter. The ground rods and fuel drum adapter shall be placed in the accessory box.

5.2.2.3 Repair parts, maintenance tools and technical publications. The repair parts, maintenance tools, and technical publications shall be preserved and packaged as specified for Level A.

5.2.2.4 Trailer chassis. The trailer chassis components shall be preserved in accordance with MIL-STD-281, Level B as specified for mobile vehicles.

5.2.3 Level C. Each complete power unit and supplemental equipment shall be preserved and packaged to afford adequate protection against deterioration, damage and pilferage during shipment and handling from the supply source to the initial destination. Unless otherwise specified (see 6.2), the engine fuel system, combustion chambers, valves, and cooling system shall be preserved in accordance with MIL-E-10062, Type 1, Method 1.

5.3 Packing. Packing shall be Level A, B, or C as specified (see 6.2).

5.3.1 Level A. Packing shall be in accordance with Table I and Figures 1 and 2 for Level A. Repair parts for each power unit shall be packed in a close-fitting box conforming to Grade B and shall be secured to the power unit in a manner that will not increase the cube or interfere with lifting of the unit. Strapping for securing the box shall be as specified in Table I. Maintenance tools shall be placed in the accessory box as space permits. When space is not available, the maintenance tools shall be placed and secured as specified herein for the repair parts.

5.3.2 Level B. Packing shall be in accordance with Table I and Figures 1 and 2 for Level B. Repair parts and maintenance tools shall be packed as specified in 5.3.1 for Level A except that boxes shall be Domestic Type.

5.3.3 Level C. Power units and supplement equipment preserved and packaged as specified in 5.2.3 shall be prepared for shipment in a manner to assure carrier acceptance and safe delivery to destination at lowest ratings in compliance with Uniform Freight Classification rules or National Motor Freight Classification rules. Wheels shall be free to rotate for mobile shipment.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

5.4 Marking. Marking shall be in accordance with MIL-STD-129.

5.5 Depreservation guides. Two copies of depreservation guides shall be prepared and placed in waterproof envelopes marked "Depreservation Guide". One copy shall be secured on the generator set, and a second copy shall be secured in a conspicuous location on the power unit. Unless otherwise specified (see 6.2), DA Form 2258 "Depreservation Guide for Vehicles and Equipment" shall be used (see 6.6).

6. NOTES

6.1 Intended use. The power unit is intended for use by the Armed Services to supply electrical power for military operations.

6.2 Ordering data. Procurement documents should specify the following:

(a) Title, number, and date of this specification.
(b) Time frame required for submission of the preproduction model (see 3.2).
(c) Time frame required for submission of the preproduction pack (see 5.1).
(d) Level of preservation and packaging and level of packing required (see 5.2 and 5.3). Level B preservation and packaging is intended to provide economical but limited protection and should be specified only when it has been determined the power unit will be held in covered storage.
(e) When other than DA Form 2258 is to be used (see 5.5).
(f) Engine preservation requirements when other than specified (see 5.2.3).

6.3 Preproduction model. Any changes or deviations of production power units from the approved preproduction model during production will be subject to the approval of the contracting officer. Approval of the preproduction model will not relieve the supplier of his obligation to furnish power units conforming to this specification.

6.4 Government-furnished property. The contracting officer should arrange to furnish the property specified in 3.4.

6.5 Preproduction pack. Any changes or deviations of production packs from the approved preproduction pack will be subject to the approval of the contracting officer. Approval of the preproduction pack will not relieve the supplier of his obligation to preserve, package, pack, and mark the power units in accordance with this specification.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:11Z
Check the source to verify that this is the currentversion before use.

6.6 Depreservation guide. The contracting officer should arrange to furnish the necessary copies of DA Form 2258, when requested by the supplier (see 5.5).

Custodian:

Army - ME

Preparing activity:

Army - ME

Project No. 6115-A356

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

TABLE I. PRESERVATION, PACKAGING AND PACKING MATERIAL

FIND NO.	IDENTIFICATION	DESCRIPTION	LEVEL	
			A	B
1	PPP-B-601, OVERSEAS TYPE, STYLE I, (NOTES 1 AND 5)	BOX, PLYWOOD 1/4 THICK	1	
1	PPP-B-591, CLASS II, STYLE A, (NOTES 1, 2 & 3)	BOX, FIBERBOARD		1
2	MIL-B-131, CLASS I	BARRIER, MATERIAL	AR	
3	PPP-F-320, TYPE SF, GRADE V 3S	FIBERBOARD, 1/2 THICK MINIMUM	AR	
4	MIL-G-12803, TYPE I, RUBBER BINDER 1-1/2 X 1-1/2 X 1/8	GASKET, 11/16 DIA HOLE IN CENTER	8	
5	WEDGE	LUMBER, SOFTWOOD	2	2
6	SPACER	LUMBER, SOFTWOOD 1X8 NOMINAL	2	
7	MS 27183-11, .312 ID X .734 OD X .065 THK	WASHER, PLAIN, CS, CAD. PL	12	8
8	MS 16992-505, 1/4-10, 2 LG	BOLT, LAG, HEX HD, GIMLET PT, STL, GALV	8	8
9	NN-P-530 (NOTE 4)	PLYWOOD, 3/8 THICK	1	
10	MS 35355-8, 1/4-20 UNC-2A, 3-1/2 LG	BOLT, SQ HD, STL, CAD. PL	4	
11	MS 51922-1, 1/4-20 UNC-2B	NUT, SELF LOCKING	4	
12	BLOCKING	LUMBER, SOFTWOOD, 2X4 NOMINAL	AR	
13	FF-N-105, TYPE II, STYLE 4,	NAIL, 4 d	AR	
14	PPP-T-60, TYPE IV	TAPE, PRESSURE-SENSITIVE	AR	AR
15	PPP-T-97, TYPE IV	TAPE, PRESSURE-SENSITIVE, 3/4 W	AR	AR
16	QQ-S-781, TYPE I, OR IV, FINISH B	STEEL STRAPPING, FLAT, .020 X 3/4	AR	
16	QQ-S-781, TYPE I, OR IV, FINISH A	STEEL STRAPPING, FLAT, .020 X 3/4		AR
17	PPP-B-636, TYPE CF, CLASS DOMESTIC, VARIETY SW, GRADE 125	BOX, FIBERBOARD	1	1

NOTES:
1. NO CONTENT WEIGHT, WITHOUT BOTTOM.
2. TOP TO BE INVERTED.
3. DIMENSIONAL LIMITATIONS OF SPECIFICATION WAIVED.
4. GROUP A, CONFORMING TO PS51 TYPE I, GRADE 3-4 OR GROUP B CONFORMING TO PS1, STANDARD SHEATHING WITH EXTERIOR GLUE.
5. TOP TO BE ONE PIECE, 1/2 INCH THICKNESS AND SHALL COMPLETELY COVER ALL EDGES.

DX-1354A

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

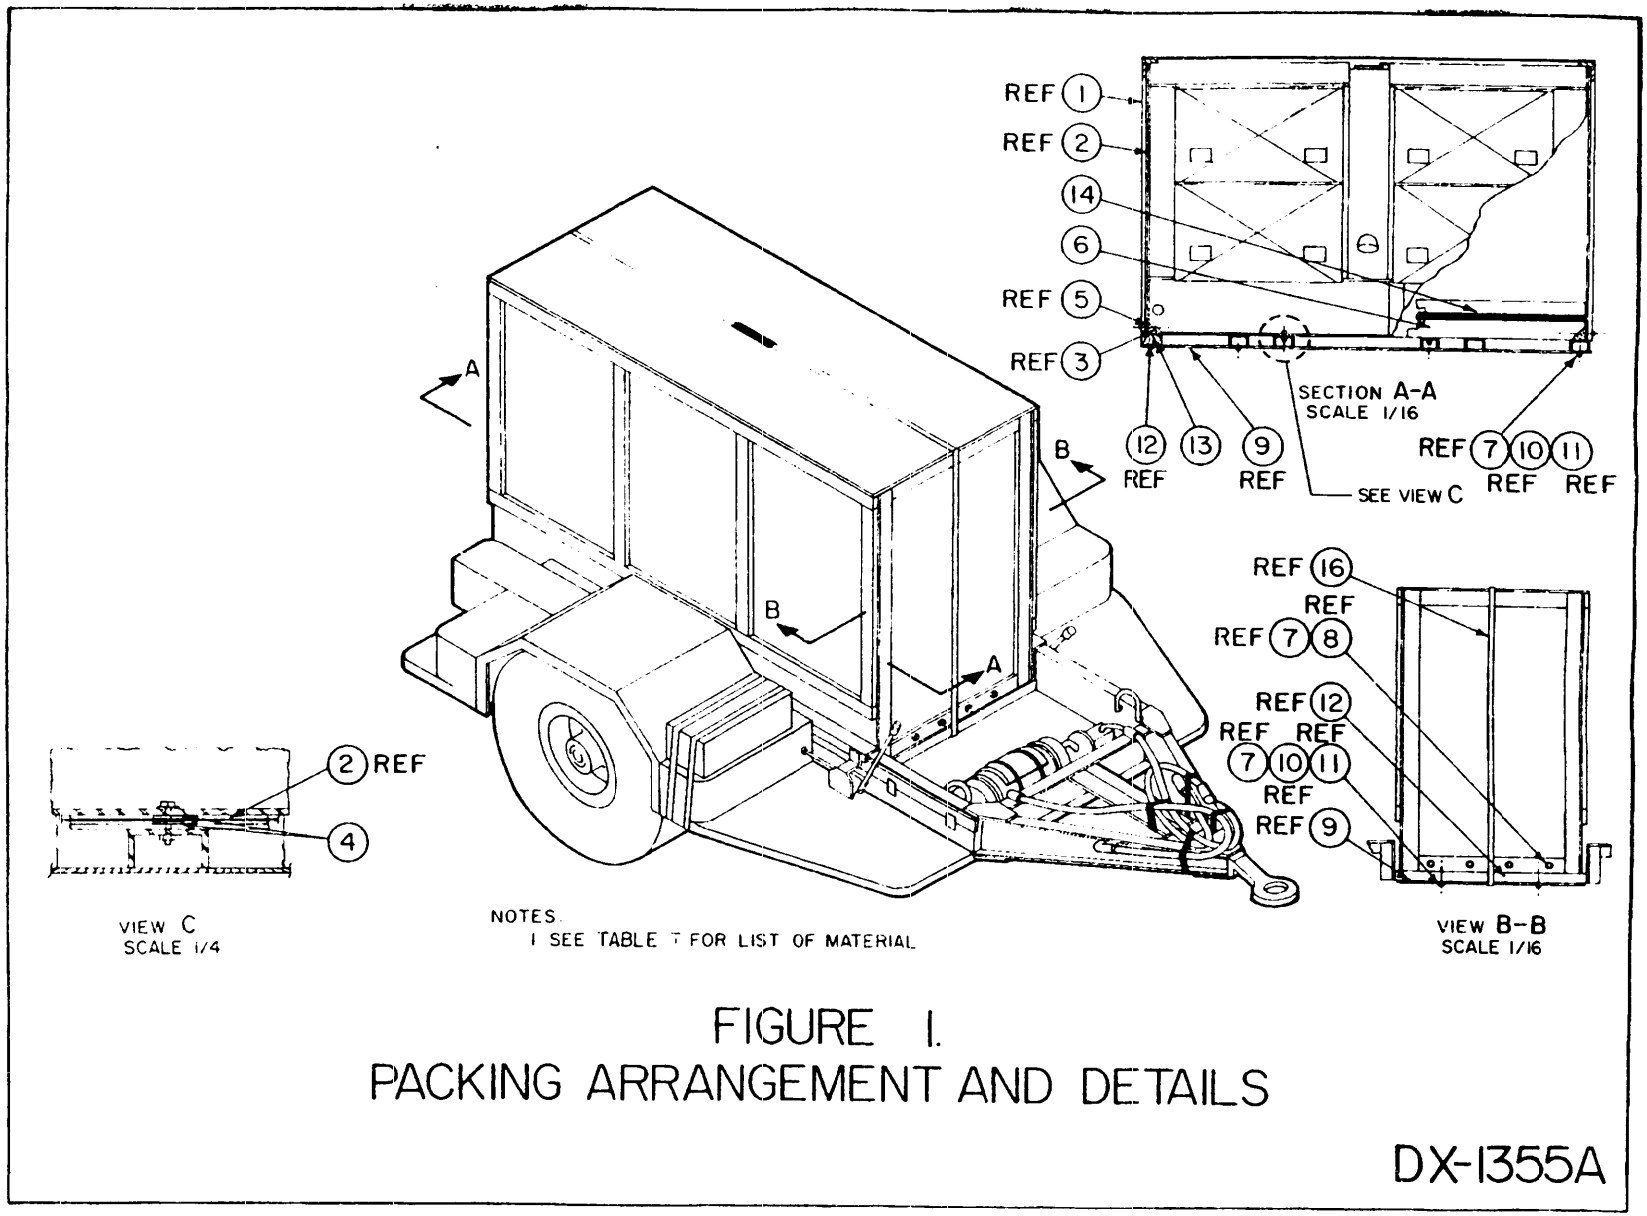


FIGURE 1.
PACKING ARRANGEMENT AND DETAILS

DX-1355A

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

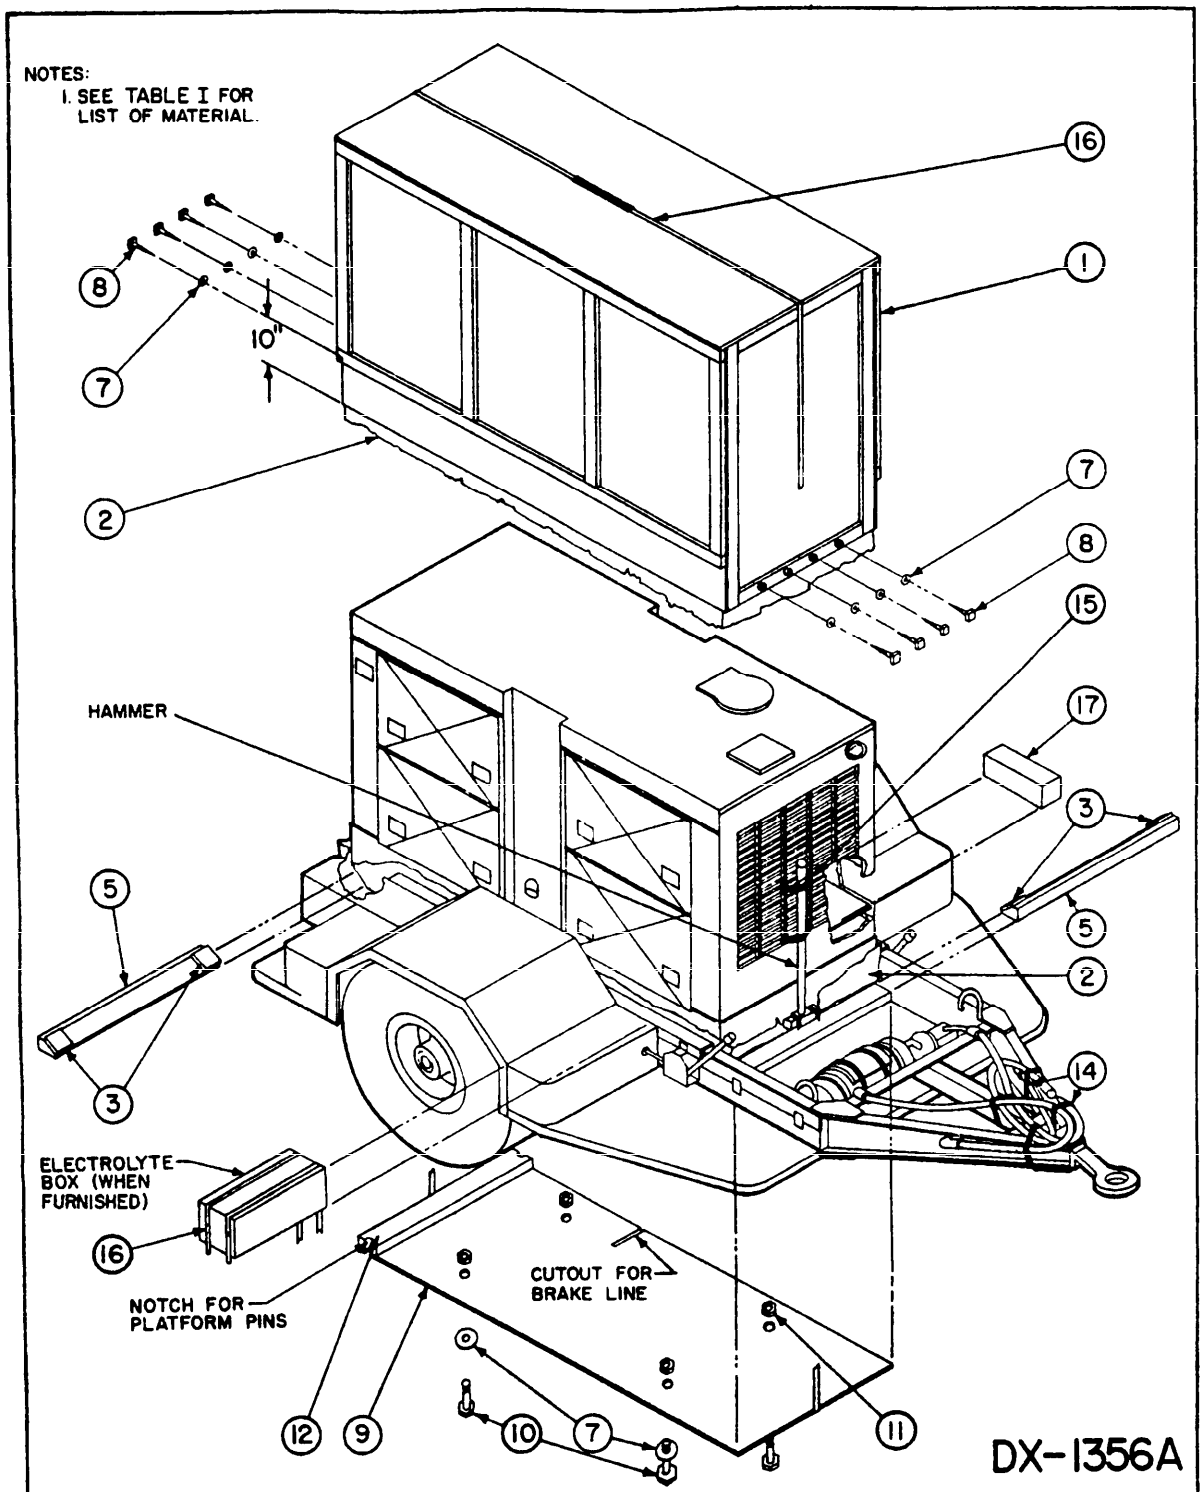


FIGURE 2. PACKAGING AND PACKING ASSEMBLY

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

OMB Approval
No. 22-R255

INSTRUCTIONS: The purpose of this form is to solicit beneficial comments which will help achieve procurement of suitable products at reasonable cost and minimum delay, or will otherwise enhance use of the document. DoD contractors, government activities, or manufacturers' vendors who are prospective suppliers of the product are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity.

DOCUMENT IDENTIFIER AND TITLE: MIL-G-52886(ME) GENERATOR SET, DIESEL ENGINE, TRAILER MOUNTED 60 KW, 400 HERTZ, PU-707 A/M

NAME OF ORGANIZATION AND ADDRESS

CONTRACT NUMBER

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2. COMMENTS ON ANY DOCUMENT REQUIREMENT CONSIDERED TOO RIGID

3. IS THE DOCUMENT RESTRICTIVE?

☐ YES ☐ NO *(If "Yes", in what way?)*

4. REMARKS

SUBMITTED BY *(Printed or typed name and address - Optional)*

TELEPHONE NO.

DATE

DD FORM 1 JAN 72 1426 REPLACES EDITION OF 1 JAN 66 WHICH MAY BE USED

15

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:11Z
Check the source to verify that this is the current version before use.

FOLD

POSTAGE AND FEES PAID
DEPARTMENT OF THE ARMY
DOD – 314

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

Commander
US Army Mobility Equipment Research and
Development Center
ATTN: AMXFB-DS
Fort Belvoir, VA 22060

FOLD

16

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:11Z
Check the source to verify that this is the current version before use.