
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, CLASS H, NONRENEWABLE, 250 VOLTS, 201-400 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1726.

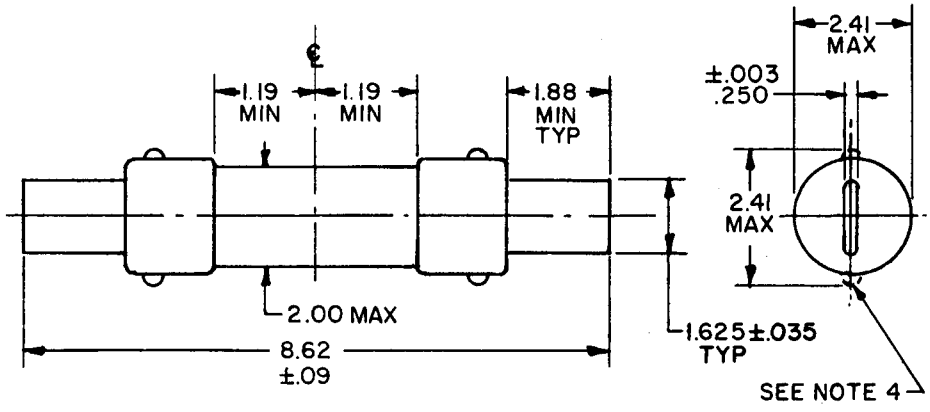

INCHES	MM
0.003	.08
.035	.89
.09	2.29
.250	6.35
1.19	30.23
1.625	41.28
1.88	47.75
2.00	50.80
2.41	61.21
8.62	218.95

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4mm.
3. Minimum acceptable thickness of tube wall .125 (3.18 mm).
4. Use of screw, pin, or rivet is optional.

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:34Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical - Nonrenewable.
Terminals - Knife blade.
Material - Copper or copper alloy.
Strength - 5 pound-inches torque between body and blades.

Body:
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:
Voltage - 250 volts or less.

Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50°C above ambient on the body and 65°C on the blades.

Overload interrupt:
Instantaneous - Shall interrupt within 2 hours at 135 percent of rated current and within 10 minutes at 200 percent of rated current.
Time delay - In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 10 seconds.

Short circuit interrupt - 10,000 amperes at 250 volts.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table.

Government part number	Current rating (amps)	Overload interrupt
WF1726/ 5-001	225	Instantaneous
002	250	↕
003	300	↕
004	350	↕
005	400	Instantaneous
006	225	Time delay
007	250	↕
008	300	↕
009	350	↕
010	400	Time delay

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:34Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 80

Review activities:

Army - EL, ME, MI, MU
Navy - SH, MC
Air Force - 80
DSA - ES
NS

User activities:

Army - AT, WC
Navy - AS, OS
Air Force - 11

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
DOT - FIS
GSA - FSS, PBO
NASA - JFK, MSF
HEW - NIH
USDA - AFS

(Project 5920-0328-5)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein.
cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:34Z
Check the source to verify that this is the current version before use.