
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, CLASS H, NONRENEWABLE, 600 VOLTS, 0-30 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1726.

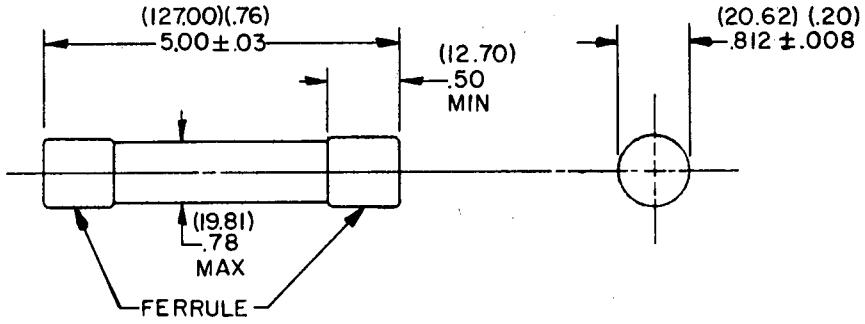

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Minimum acceptable thickness of tube wall .062(1.57 mm).
4. Minimum acceptable thickness of the ferrule sidewall .029(.74 mm).
5. Metric equivalents are in parentheses.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical - Nonrenewable.
Terminals - Ferrule type.
Material - Brass, copper, or copper alloy.
Strength - 5 pound-inches torque between body and ferrules.
Alignment - The inside diameter of tubular gage shall be not more than 0.823 inch.

Body:
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:
Voltage - 600 volts or less.

Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50° C above ambient on the body and the ferrules.

Overload interrupt:
Instantaneous - Shall interrupt within 1 hour at 135 percent of rated current and within 2 minutes at 200 percent of rated current.
Time delay - In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 10 seconds.
Motor start - Shall interrupt within 2 hours at 135 percent of rated current and within 8 minutes at 200 percent of rated current. These fuses shall be plainly marked, "FOR USE ON MOTOR CIRCUITS ONLY".

Short circuit interrupt - 10,000 amperes at 600 volts.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table.

Government part number	Current rating (amps)	Overload interrupt
WF1726/ 7-001	1	Instantaneous
002	3	↑
003	6	↑
004	10	↑
005	15	↑
006	20	↑
007	25	↑
008	30	Instantaneous
009	1	Time delay
010	3	↑
011	6	↑
012	10	↑
013	15	↑
014	20	↑
015	25	↑
016	30	Time delay

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

Government part number	Current rating (amps)	Overload interrupt
WF1726/ 7-017	1	Motor start
018	3	
019	6	
020	10	
021	15	
022	20	
023	25	
024	30	Motor start



MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 80

Review activities:

Army - EL, ME, MI, MU
Navy - SH, MC
Air Force - 80
DSA - ES
NS

User activities:

Army - AT, WC
Navy - AS, OS
Air Force - 11

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
DOT - FIS
GSA - FSS, PBO
NASA - JFK, MSF
HEW - NIH
USDA - AFS

(Project 5920-0328-7)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 10 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.