
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, CLASS H, NONRENEWABLE, 600 VOLTS, 31-60 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1726.

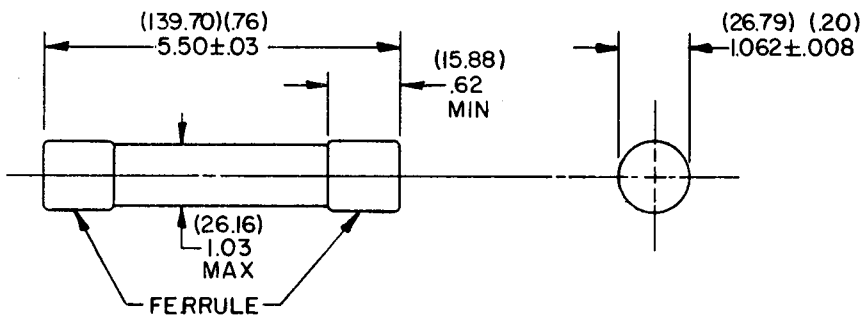

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Minimum acceptable thickness of tube wall .062(1.57 mm).
4. Minimum acceptable thickness of the ferrule sidewall .029(.74 mm).
5. Metric equivalents are in parentheses.

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 20260-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical - Nonrenewable.
Terminals - Ferrule type.
Material - Brass, copper, or copper alloy.
Strength - 5 pound-inches torque between body and ferrules.
Alignment - The inside diameter of tubular gage shall be not more than 1.073 inch.

Body:
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:
Voltage - 600 volts or less.

Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50° C above ambient on the body and the ferrules.

Overload interrupt:
Instantaneous - Shall interrupt within 1 hour at 135 percent of rated current and within 4 minutes at 200 percent of rated current.
Time delay - In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 10 seconds.
Motor start - Shall interrupt within 2 hours at 135 percent of rated current and within 8 minutes at 200 percent of rated current. These fuses shall be plainly marked, "FOR USE ON MOTOR CIRCUITS ONLY".

Short circuit interrupt - 10,000 amperes at 600 volts.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table.

Government part number	Current rating (amps)	Overload interrupt
WF1726/ 8-001	35	Instantaneous
002	40	↕
003	45	
004	50	
005	60	Instantaneous
006	35	Time delay
007	40	↕
008	45	
009	50	
010	60	Time delay
011	35	Motor start
012	40	↕
013	45	
014	50	
015	60	Motor start

Source: https://assist.dla.mil -- Downloaded: 20260-26T11:35Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 80

Review activities:

Army - EL, ME, MI, MU
Navy - SH, MC
Air Force - 80
DSA - ES
NS

User activities:

Army - AT, WC
Navy - AS, OS
Air Force - 11

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
DOT - FIS
GSA - FSS, PBO
NASA - JFK, MSF
HEW - NIH
USDA - AFS

(Project 5920-0328-8)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.