
FEDERAL SPECIFICATION SHEET

CONNECTOR, RECEPTACLE, ELECTRICAL, GENERAL PURPOSE, DUPLEX, GROUNDING, HOSPITAL GRADE, GROUND FAULT CIRCUIT INTERRUPTING, 2 POLE, 3 WIRE, 15 AMPERES, 125 VOLTS, 60 HERTZ

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for acquiring the connectors described herein shall consist of this specification and the latest issue of W-C-596.

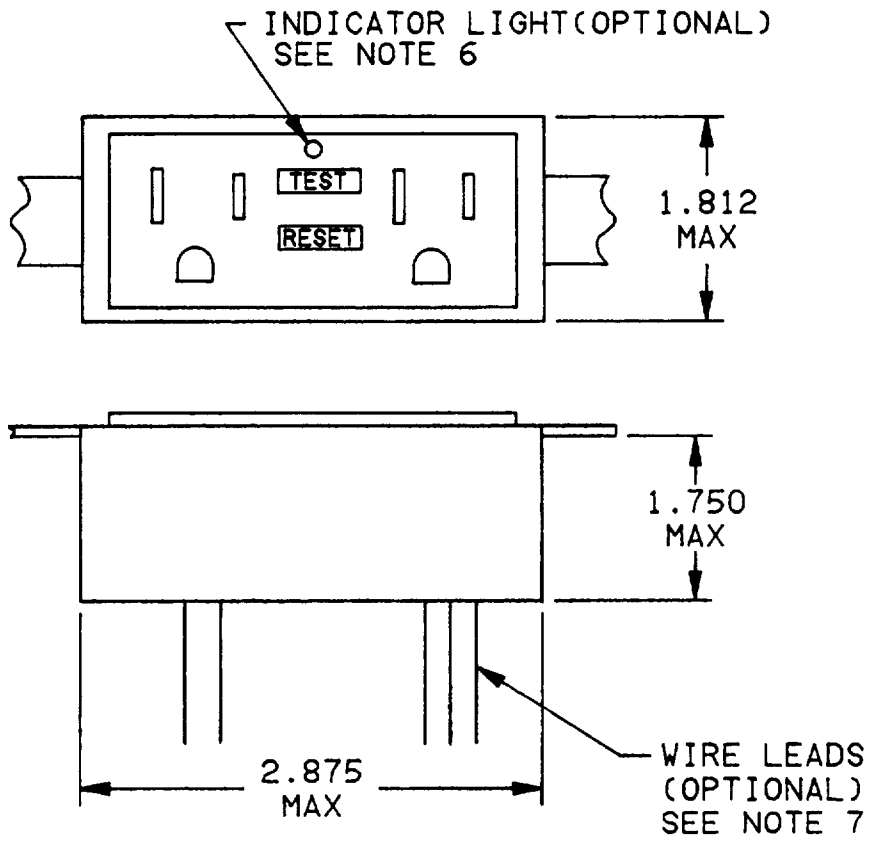

Inches	mm
1 750	44.45
1.812	46 02
2.875	73 02

NOTES
1. For mounting dimensions see figure 11 configuration B
2 Dimensions are in inches.
3 Metric equivalents are given for general information only and are based upon 1.00 inch = 25.4 mm.
4 Orientation of receptacle faces and location of test and/or reset buttons optional.
5 The GFCI shall be furnished with a wallplate of the appropriate color.
6. If an indicator light is provided, when lighted it shall indicate power availability to the receptacle; when unlighted it shall show the "tripped" condition of the circuit interrupter
7 If wire leads are provided in lieu of other termination means, the green (ground) leads shall be a minimum of 6 inches long and the remaining leads shall be a minimum of 4 inches long. Each wire shall be capable of withstanding pull of 20 pounds for one minute.

FIGURE 1 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:33Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and configuration: Hospital grade (see figure 1).

Dimensions conform to ANSI C73.11 (reference NEMA configuration 5-15R).

Ratings:

Voltage: 125 volts.

Current: 15 amperes.

Frequency: 60 Hertz.

Mating connector: W-C-596/13.

These connectors shall meet the class A requirements as specified in UL943.

Part number: WC596/212-(dash number from table I).

TABLE I. Dash number.

Dash No.	Description	Color
1	Hospital grade Ground fault circuit interrupting	Ivory
2	Hospital grade Ground fault circuit interrupting	Brown

TABLE II. Supersession and cross reference.

Active Government part number	Superseding numbers			
	FSCM 1/ 74545	FSCM 75582	FSCM 04009	FSCM 71183
WC596/212-1	GF8200-I	6198-HGI		
WC596/212-2	GF8200			

1/ FSCM is the Federal Supply Code for Manufacturers in accordance with Federal Supply Handbooks H4-1 and H4-2.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:33Z
Check the source to verify that this is the current version before use.

MILITARY INTERESTS:

Custodians
Army - CR
Navy - YD
Air Force - 85

Review activities
Army - MI
Navy - EC, AS

User activities
Army - AV, ME
Navy - MC, SH

PREPARING ACTIVITY.

DLA - ES

CIVIL AGENCY COORDINATING ACTIVITIES:

DCGOVT - DCG
DOT - ACO
GSA - FSS, PCD
HHS - FEC
Interior - BPA
USDA - BPA
VA - DMS

(Project 5935-3205-2)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See Section 2 of this specification to obtain extra copies and other documents referenced herein. Price cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:33Z
Check the source to verify that this is the current version before use.