INCH POUND

A-A-55128
25 MAY 1995

COMMERCIAL ITEM DESCRIPTION

INSULATOR, SPREADER

The General Services Administration has authorized the use of this Commercial Item Description for all federal agencies.

1. ABSTRACT.

1.1. Intended use. The insulator is used to separate or hold apart suspended free swinging electrical conductors.

2. SALIENT CHARACTERISTICS

2.1. Design and construction. The insulator shall be constructed of glass, Corning, type 7056, Corning Inc., Corning, NY, or fiberglass rod (with ultraviolet protective coating) having equivalent electrical insulating characteristics. Length shall be sufficient to provide six inches (minimum) spread between electrical conductors. Outside diameter of insulator shall be 1/2 inch (minimum). End fasteners shall be brass, with a 1/8 inch (nominal) wire slot to accommodate .125in diameter wire. See Figure 1 for details.

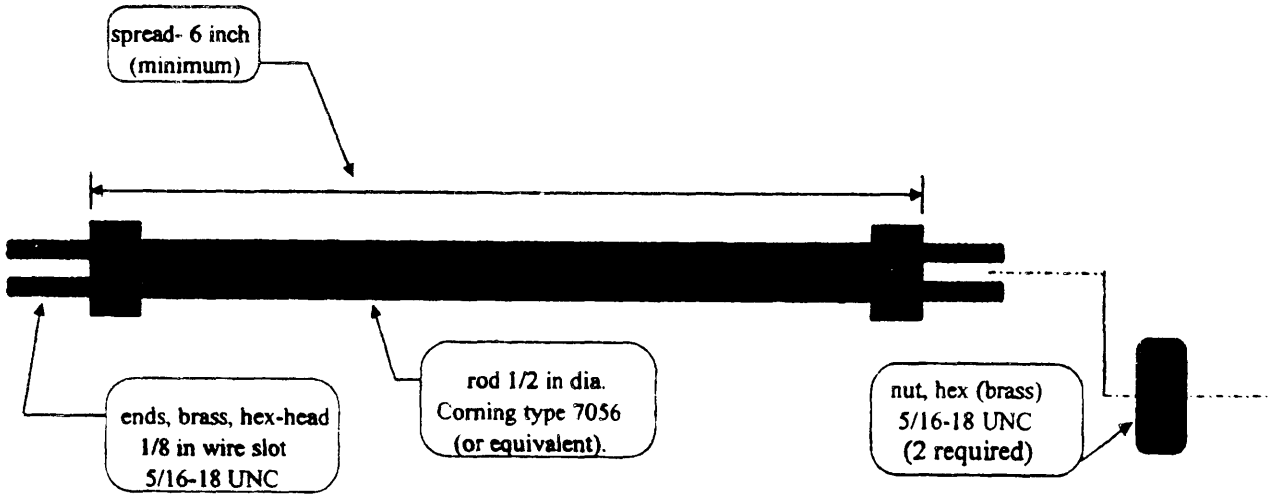


Figure 1

Beneficial comments, recommendations, additions, deletions, clarifications, etc. and any data which may improve this document should be sent to: Defense General Supply Center (DGSC), ATTN: DGSC-VCA, 8000 Jefferson Davis Highway, Richmond, VA 23297-5768.

AMSC N/A FSC 5970

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 202610-26T09:42Z
Check the source to verify that this is the current version before use.

2.2. Workmanship. All components and assemblies shall be free of dirt and other extraneous materials. Burrs, slivers, rough die, tool, and grinding marks, dents, and cracks shall be unacceptable. Castings, molded parts and stampings, shall be free of sand, fins, pits, blow holes, and sprues. The surfaces of parts to be welded or brazed shall be clean. All scale and flux shall be removed from the finished weld area. The welds shall be smooth. Threaded fasteners shall not be missing, broken, cracked, or stripped of threads. There shall be no defects affecting serviceability, durability, operation or appearance.

3. REGULATORY REQUIREMENTS.

3.1. Recovered materials. The offeror/contractor is encouraged to use recovered materials in accordance with Public Law 94-580 to the maximum practical extent. Recycled or reclaimed materials may be used in the construction of the equipment described herein. Recycled and reclaimed materials shall consist of previously used material which has been reprocessed to become a source of new raw materials. Under no conditions or circumstances shall the contractor submit to the Government for acceptance reconditioned or rebuilt components as a part of the equipment described herein.

4. QUALITY ASSURANCE PROVISIONS.

4.1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this Commercial Item Description, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices and is the same as the product offered for sale in the commercial marketplace. When specific quality assurance provisions are specified for any commercial characteristic the contractor shall maintain records resulting from his inspection(s) conducted in accordance with the specific quality assurance provisions. The government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided under the provisions of the contract. The government reserves the right to audit the contractor's quality assurance records.

4.2. Successful commercial operation. No item of equipment offered under this CID shall be acceptable unless the manufacturer has marketed equipment of the same size (similar capacity) and type in a commercial environment for a minimum period of one year. Equipment installed for test purposes in a manufacturer's plant or test laboratory shall not be considered as complying with this requirement.

4.3. Warranty. Unless otherwise specified in the contract, the manufacturer's standard commercial warranty terms shall apply.

5. PACKAGING.

5.1. Preservation, Packaging, Packing, Labeling and Marking. Preservation, packaging, packing, labeling and marking shall be as specified in the contract or purchase order.

5.1.1. Commercial. In the absence of detailed instructions in the contract or purchase order, preservation and packing shall be in accordance with ASTM D 3951, Standard Practice for Commercial Packaging.

6. NOTES.

6.1. Commercial item certification. When this CID is used for procurement, the commercial item certification clause must appear in the solicitation.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:42Z
Check the source to verify that this is the current version before use.

6.2. Referenced documents. Copies of referenced documents are available from:


Government documents:
Standardization Documents Order Desk
700 Robbins Avenue
Building 4, Section D
Philadelphia, PA 19111-5094

Non-government documents:
ASTM D 3951 may be obtained from:

ASTM
1916 Race Street
Philadelphia, PA 19103

6.3. Metric product. Products manufactured to metric (SI) dimensions will be considered on an equal basis with those manufactured using inch-pound units of measure, provided they fall within specified tolerances using conversion tables contained in the latest revision of Federal Standard 376, and all other requirements of this CID are met.

6.4 Part identification number (PIN). The following part identification numbering procedure is for government purposes and does not constitute a requirement for the contractor. The PIN shall be constructed as follows:

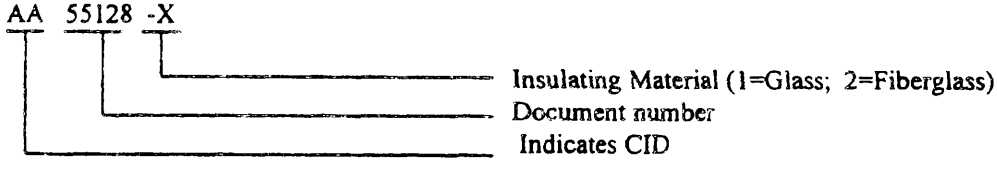

6.5. Sources of supply. Equipment described herein can be procured from the following sources:
Cardwell Condenser Corporation, Lindenhurst, NY 11757-5893
The ANT Company of Virginia, Richmond, VA 23250-0174

6.6. Subject term (key word) list.
Electrical; insulator; spreader.

MILITARY INTERESTS:

Custodians
Air Force - 99
Army - ER
Navy - SH

Review activities
Army - CR, ME, MI
Navy - SH, YD, EC
Air Force - 85

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FSS/7FXE

PREPARING ACTIVITY:

DLA - GS

(Project 5970-1096)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:42Z
Check the source to verify that this is the current version before use.