INTERIM FEDERAL SPECIFICATION

FAUCET; DOUBLE, SINGLE, AND LAWN (LAUNDRY SINK, KITCHEN, AND LAVATORY) (LAND USE)

This Interim Federal Specification was developed by the General Services Administration, Federal Supply Service, Washington DC 20406, based upon currently available technical information. It is recommended that Federal agencies use it in procurement and forward recommendations for changes to the preparing activity at the address shown above.

1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification covers requirements for lawn faucets and, double and single faucets.

1.1.1 Specification coverage. Federal specifications do not include all varieties of the commodity as indicated by the title of the specification, or which are commercially available. This specification is intended to cover faucets generally used by the Federal Government for the use indicated by the title.

1.2 Classification.

1.2.1 Types. Faucets furnished under this specification shall be of the types indicated in figure 1.

1.3 Definitive part number (DPN). Items furnished under this specification shall be designated by a definitive part number. This number shall consist of the specification number followed by the specification part number (SPN) as described herein. This part number is intended for cataloging and ordering purposes, and not for surface printing on parts (see 6.2 and 6.4). The DPN shall be written as indicated below:

DPN (see 6.4)----------WWF1910 - XXX - XX X

Federal Specification number. ----------

Specification part number.

Type designator (see 3.4 and figure 1).
Supply connection thread size (see 1.3.1 and table I).
Special requirements identifier (see 1.3.2 and table II).

1.3.1 Supply connection thread size designator. The supply connection thread size shall be indicated by the two numeric digit designation code in table I.

TABLE I. Supply connection thread size identification

Designation code	Supply connection thread size (inch)
50	1/2
75	3/4

1.3.2 Special requirements identifier. The special requirements identifier will be used to indicate features that differentiate faucets of the same type and size, see table II.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.

TABLE II. Special requirements identification

Indicator code	Requirement
C	Handle indexed C
H	Handle indexed H
P	Chrome plated finish
R	Rough brass finish

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issues in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein.

Federal Specifications:

PPP-B-566 - Boxes, Folding, Paperboard.
PPP-B-636 - Boxes, Shipping, Fiberboard.
PPP-B-665 - Boxes, Paperboard, Metal Stayed (Including Stay Material).
PPP-B-676 - Boxes, Setup.

Federal Standard:

Fed. Std. No. 123 - Marking for Shipment (Civil Agencies).

(Activities outside the Federal Government may obtain copies of Federal Specifications, Standards, and Handbooks as outlined under General Information in the Index of Federal Specifications and Standards and at the prices indicated in the Index. The Index, which includes cumulative monthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

(Single copies of this specification and other Federal Specifications required by activities outside the Federal Government for bidding purposes are available without charge from Business Service Centers at the General Services Administration Regional Offices in Boston, New York, Washington, DC, Atlanta, Chicago, Kansas City, MO, Fort Worth, Denver, San Francisco, Los Angeles, and Seattle, WA.

(Federal Government activities may obtain copies of Federal Specifications, Standards, and Handbooks and the Index of Federal Specifications and Standards from established distribution points in their agencies.)

Military Specification:

MIL-P-116 - Preservation, Methods of.

Military Standards:

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.

(Copies of Military Specifications and Standards required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless a specific issue is identified, the issue in effect on date of invitation for bids or request for proposal shall apply.

American Society for Testing and Materials (ASTM) Standards:

B 487 - Method for Measuring Metal and Oxide Coating Thickness by Microscopical Examination of a Cross Section.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race St., Philadelphia, PA 19103.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.

American National Standards Institute (ANSI) Standard:

A112.18.1 - Finished and Rough Brass Plumbing Fixtures.

(Application for copies should be addressed to the American National Standards Institute, 1430 Broadway, New York, NY 10018.)

National Motor Freight Traffic Association, Inc., Agent:

National Motor Freight Classification.

(Application for copies should be addressed to the American Trucking Associations, Inc., Tariff Order Section, 1616 P Street, N.W., Washington, DC 20036.)

Uniform Classification Committee, Agent:

Uniform Freight Classification.

(Application for copies should be addressed to the Uniform Classification Committee, Room 1106, 222 South Riverside Plaza., Chicago, IL 60606.)

3. REQUIREMENTS

3.1 General. Unless otherwise specified herein, faucets covered by this specification shall comply with the requirements of ANSI A112.18.1. Faucets shall be furnished with locknuts, washers, coupling nuts, and applicable escutcheons.

3.2 Materials. Materials shall conform to the requirements of ANSI A112.18.1 and shall be of the type and quality recognized by industry for the intended purpose.

3.3 Construction, general.

3.3.1 Faucets, body and spouts. Faucet bodies and integral or separate spouts shall be cast or wrought copper alloy at the manufacturer's option. Internal parts of faucets shall be metal, molded plastic, rubber, or any combination thereof. All internal parts shall be suitable for use with potable water. Metal parts shall be compatible with each other.

3.3.2 Handle. Unless otherwise specified by the part number, handles on faucets may be corrosion resisting steel, copper alloy, die cast zinc alloy, or molded plastic. Handles shall be indexed, as specified by the part number, for use with hot or cold water as applicable. The shape of the handle shall be crown, lever, tee, or wheel in accordance with the DPN specified.

3.3.3 Flow control. Water flow shall be controlled by manual positioning of the faucet handle. The rate of flow through faucets shall be adjustable in the normal flow range.

3.3.4 Location of water supplies. Where both hot and cold water are supplied to fixtures, hot water shall be supplied at the left and cold water at the right.

3.3.5 Escutcheons. Escutcheons shall be copper alloy, corrosion-resisting steel, die cast zinc alloy, or plastic. Escutcheons shall be finished the same as the faucet.

3.3.6 Chromium plated plastics. The metal coat on plastic shall not lift off when tested in accordance with 4.4.1.2.


3.4 Types. Faucet types shall be as specified in figure 1. Faucets shall conform to the applicable requirements specified in 3.1 through 3.3.6 and the specific requirements stated below:

Specification part number	Specific requirements
010-50C	Type 10 - Single faucet, crown style handle indexed "C". All exposed surfaces of faucet body, spout, and handle chrome plated. Interchangeable cartridge type valve unit. Full thread shank with 1/2 inch straight pipe thread. Furnished with locknut, washer, and coupling nut.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.

Specification part number	Specific requirements
010-50H	Same as 10-50C except handle indexed "H".
036-50P	Type 36 - Combination faucet, indexed lever style brass handles with or without hood. All exposed surfaces of faucets, handles, and spout chrome plated. Eight (8) inch c to c measurement of hot and cold water supply connections. Swing spout with aerator outlet and metal soap dish. Shall have union inlets with 1/2-inch internal pipe thread. Each inlet equipped with adjustable flange.
039-50P	Type 39 - Combination faucet, indexed lever style brass handles with or without hood. All exposed surfaces of faucet, handles, and spout chrome plated. Swing spout with aerator outlet. Escutcheons for valves and spout, locknuts and washers, or locknut-type escutcheous shall be furnished together with coupling nuts. 1/2-inch threaded supply connections, 8-inches c to c measurement of hot and cold water connection.
065-50P	Type 65 - Single faucet with hexagonal shoulder inlet. Tee style brass handle, chrome plated body and handle. Inlet size 1/2-inch external threads. 3/4-inch garden hose connection on spout.
065-50R	Same as 65-50P except that finish shall be rough brass.
065-75P	Same as 65-50P except that inlet size shall be 3/4-inch.
065-75R	Same as 65-75P except that finish shall be rough brass.
207-50R	Type 207 - Lawn faucet, straight or angle body with flange and 1/2-inch internal pipe threads for supply connection. Flats on body for wrench grip. Wheel style brass or zinc-alloy handle securely attached to body. Rough brass finish except that handle may be painted. Faucet with 3/4-inch garden hose connection.
207-75R	Same as 207-50R except that supply connection size is 3/4-inch.


Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.




Type 10




Type 36



Type 39



Type 65

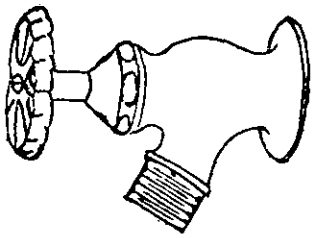

Type 207

FIGURE 1. Faucet types

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.

3.5 Workmanship.

3.5.1 Welding and brazing. All surfaces of welded or brazed parts shall be clean. Welding and brazing shall be accomplished in a manner which will prevent the occurrence of burn holes, cracks, fractures or incomplete fusion.

3.5.2 End item. The end item shall be assembled in a manner to insure that all parts are in proper alignment and that all exposed surfaces are free of sharp burrs, slivers, pits, indentations, cracks, ridges, blow holes, or checks that may injure the user. Coatings on surfaces shall be free of cracks, blisters, and void spots.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or order, the supplier may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure that supplies and services conform to prescribed requirements.

4.2 Sampling for lot acceptance.

4.2.1 Inspection lot. A lot shall consist of all faucets of the same definitive part number offered for delivery at the same time.

4.2.2 Sampling for examination and tests. Size of sample for faucets shall be level S-4 in MIL-STD-105.

4.3 Examination and tests.

4.3.1 Examination for visual and dimensional characteristics. Examine faucets for defects listed in table III. The acceptable quality levels (AQL's) for defects shall be 2.5 percent defective for major and 6.5 percent defective for total defects.

TABLE III. Classification of defects, end item

Defect	Major	Minor
Specification part number		
Style not as specified	X	
Dimensions not as specified	X	
Size not as specified	X	
Handle material not as specified		X
Handle style not as specified		X
Handle index not as specified	X	
Hose connection omitted	X	
Finish not as specified	X	
Workmanship		
Welds clean and free of blowholes		X
Surface free of sharp burrs, slivers, pits, ridges, or checks	X	
Damage or defects affecting function or serviceability	X	
Damage or defects not affecting function or serviceability		X

4.3.2 Tests, AQL. The AQL for all tests, and for all specimens in individual test shall be 4.0 percent defective.

4.4 Test methods.

4.4.1 Chromium plated faucets.

4.4.1.1 Metals. Test total thickness of the electrodeposited coat in accordance with any of the test procedures in ASTM B 487 (see 3.1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.

4.4.1.2 Plastics. Test electrodeposited coat on plastics as follows (see 3.3.6):

(a) Place the units in an oven heated to 160° ± 5°F. Leave them in the oven for a period of at least 1 hour. Remove from oven and air cool to room temperature.

(b) Allow units to remain at room temperature for 1 hour ± 5 minutes.

(c) Place the units in a cold chamber maintained at - 20° ± 2°F. Leave them in the chamber for a period of at least 1 hour. Remove from the chamber and air warm to room temperature.

(d) Allow units to remain at room temperature as in (b) above.

(e) Scribe an X of convenient size through the coat using a razor blade or sharp knife.

(f) Place a piece of 3/4-inch wide transparent tape over the X and press firmly against the X, then remove quickly.

4.4.2 Test faucets as specified in ANSI A112.18.1.

4.4.2.1 Frequency of life test. Life test shall be performed on the initial inspection and thereafter only when changes in material or design are made.

4.5 Inspection of preparation for delivery. An inspection shall be made to determine whether the packaging, packing and marking comply with the requirements in section 5 of this specification. Defects shall be scored in accordance with table IV. For examination of interior packaging, the sample unit shall be one shipping container fully prepared for delivery, selected at random just prior to the closing operations. Sampling shall be in accordance with MIL-STD-105. Defects of closure listed shall be examined on shipping containers fully prepared for delivery. The lot size shall be the number of shipping containers in the end item inspection lot. The inspection level shall be S-2 with an AQL of 4.0 defects per hundred units.

TABLE IV. Classification of preparation for delivery defects

Examine	Defects
Markings	Omitted; incorrect; illegible; improper size, location, sequence, or method of application.
Material	Any component missing, damaged or not conforming to the applicable specification or requirements stated herein.
Workmanship	Inadequate application of components, such as incomplete closure of container flaps, loose strapping, inadequate stapling or distortion of container.
Contents	Quantity per container is more or less than required. Gross weight exceeds requirements of the box specification.

5. PREPARATION FOR DELIVERY

5.1 Packaging. Packaging shall be level A, B or C as specified (see 6.2).

5.1.1 Level A. Each faucet shall be packaged in a close-fitting box conforming to PPP-B-566, PPP-B-665 or to PPP-B-676. Prior to placing the faucets in the boxes they should be cleaned and dried in accordance with MIL-P-116. When specified (see 6.2) the individually boxed faucets shall be further packaged in quantities as specified in the contract or order in close-fitting boxes conforming to PPP-B-566, PPP-B-665, PPP-B-676 or to PPP-B-636. Closure of boxes shall be in accordance with the applicable box specification or appendix thereto.

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:24Z
Check the source to verify that this is the current version before use.

5.1.2 Level B. Each faucet shall be packaged in a close-fitting box conforming to PPP-B-566, PPP-B-665 or to PPP-B-676. When specified (see 6.2) the individually boxed faucets shall be further packaged in quantities as specified in the contract or order in close-fitting boxes conforming to PPP-B-566, PPP-B-665, PPP-B-676 or to PPP-B-636. Closure of boxes shall be in accordance with the applicable box specification appendix thereto.

5.1.3 Level C. Faucets of like description shall be packaged to insure protection during shipment and safe delivery to destination.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2).

5.2.1 Level A. Faucets of the description, packaged as specified in 5.1 shall be packed in quantities as specified in the contract or order in close-fitting boxes conforming to PPP-B-636, class weather resistant. Close, waterproof, seal and strap the boxes in accordance with the appendix to PPP-B-636.

5.2.2 Level B. Faucets of like description, packaged as specified in 5.1 shall be packed in quantities as specified in the contract or order in close-fitting boxes conforming to PPP-B-636, class domestic. Closure of boxes shall be in accordance with method II of the appendix to PPP-B-636.

5.2.3 Level C. Faucets packaged as specified in 5.1 shall be packed to comply with the National Motor Freight Classification rules or the Uniform Freight Classification rules.

5.3 Marking. In addition to any special marking required by the contract or order, all marking shall be in accordance with 5.3.1 or 5.3.2, as specified (see 6.2).

5.3.1 Civil agencies. Marking shall be in accordance with Fed. Std. No. 123.

5.3.2 Military agencies. Marking shall be in accordance with MIL-STD-129.

6. NOTES

6.1 Intended use. Faucets covered by this specification are intended for domestic and general purpose use.

6.2 Ordering data. Purchasers should select the preferred options permitted herein, and include the following information in procurement documents:

(a) Title, number, and date of this specification.
(b) Definitive part number (see 1.3).
(c) Selection of applicable packaging and packing levels (see 5.1 and 5.2).
(d) Whether marking shall be in accordance with 5.3.1 ro 5.3.2 (see 5.3).

6.3 Illustrations. The illustrations contained herein are for the convenience of identification. They are not intended to preclude the purchase of faucets of similar design which are otherwise in accordance with the requirements of this specification.

6.4 Example of DPN.

Characteristic	DPN
	WWF1910 - 010 - 50 C
Faucet	WWF1910
Type 10 - Lavatory	010
1/2-inch Supply connection	50
Handle indexed "C"	C

Note: See 3.4 for details of part number.

Preparing activity:

GSA-FSS

GSA DC 75-12264

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:24Z
Check the source to verify that this is the current version before use.