MILITARY SPECIFICATION

HEATERS, CONVECTION, STEAM OR HOT WATER

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers definite length coil or cast finned-tube heaters (convectors), and coupled together small tube, cast iron radiant type heaters (radiators) of the natural-air-circulation type, operated with steam or hot water to supply heated air in a room.

* 1.2 Classification. The heaters shall be of the following types, classes, styles, models, and sizes as specified (see 6.2):

Type I - Nonferrous heating element.
Type II - Ferrous heating element.

Class 1 - Nonrecessed.
Class 2 - Recessed.

Style A - Floor-mounted (free-standing).
Style B - Wall-mounted.

Model F - Front air outlet.
Model T - Top air outlet.
Model S - Side, front, and top air outlet, perforated metal construction.
* Model C - Cast iron.
Size 14 - Overall height of 14 inches.
Size 16 - Overall height of 16 inches.
Size 18 - Overall height of 18 inches.
Size 20 - Overall height of 20 inches.
Size 22 - Overall height of 22 inches.
Size 24 - Overall height of 24 inches.
Size 26 - Overall height of 26 inches.
Size 28 - Overall height of 28 inches.
Size 32 - Overall height of 32 inches.

* NOTE: Refer to paragraph 3.1 for specifying sizes of Model C heaters.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commanding Officer (Code 156), Naval Construction Battalion Center, Port Hueneme, CA 93043, by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

FSC 4520

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the current version before use.

* 1.3 Definitive military specification part number. The definitive military specification part number for items described in this specification will be identified as shown in 6.5.

2. APPLICABLE DOCUMENTS

* 2.1 Government documents.

2.1.1 Specifications, standards, and handbooks. Unless otherwise specified, the following specifications, standards, and handbooks of the issue listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation, form a part of this specification to the extent specified herein.

SPECIFICATIONS

MILITARY

MIL-P-116 - Preservation, Methods of.
MIL-B-121 - Barrier Material, Greaseproofed, Waterproofed, Flexible.

STANDARDS

MILITARY

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.
MIL-STD-794 - Parts and Equipment, Procedures for Packaging of.

(Copies of specifications, standards, handbooks, drawings, and publications required by manufacturers in connection with specific acquisition functions should be obtained from the contracting activity or as directed by the contracting officer.)

* 2.2 Other publications. The following document(s) form a part of this specification to the extent specified herein. The issues of the documents which are indicated as DoD adopted shall be the issue listed in the current DoDISS and the supplement thereto, if applicable.

AMERICAN NATIONAL STANDARDS INSTITUTE, INC. (ANSI)

B1.1 - Unified Inch Screw Threads (UN and UNR Thread Form).
B1.2 - Pipe Threads (Except Dry Seal).
B2.1 - Dry Seal Pipe Threads.

(Application for copies should be addressed to the American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:42Z
Check the source to verify that this is the current version before use.

2.2.1 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein, the text of this specification shall take precedence.

3. REQUIREMENTS

3.1 Description. The heaters, models F, T, and S, convection, steam or hot water (referred to herein as "heaters") shall be a self-contained, factory-assembled unit, consisting of tubes, expanded surfaces (fins), headers, when required, and an enclosure. The enclosure shall be of either the cabinet or section type (see 3.7.2). The radiant type cast iron heaters (radiators), model C, shall consist of an assembly of small tube cast iron sections connected by tie rods at the top and bottom, and shall include all the necessary tappings, nipples, and fittings. The height of the cast iron heater shall be 19 or 25 inches with four tubes per section, or 25 inches with six tubes per section as specified (see 6.2). The number of sections for all radiators shall be an even-numbered amount from 2 to 56, as specified (see 6.2). The heating element shall have provisions for connections to steam or hot water piping as specified (see 6.2).

3.2 First article. When specified (see 6.2), the contractor shall furnish a heater for first article inspection and approval (see 4.2.1 and 6.4).

* 3.3 Certification. The manufacturer shall certify that heaters are subject to Quality Assurance procedures which include periodic tests on Commerce Standard by the manufacturer for heaters production which verify these heaters meet the performance requirement of this specification. This letter of certification shall be signed by an officer of the manufacturer and shall be submitted at the same time with his bid to the contracting officer.

* 3.4 Standard commercial product. The unit shall, as a minimum, be in accordance with the requirements of this specification and shall be the manufacturer's standard commercial product. Additional or better features which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product, shall be included in the unit being furnished. A standard commercial product is a product which has been sold or is being currently offered for sale on the commercial market through advertisements or manufacturer's catalogs, or brochures, and represents the latest production model.

* 3.5 Materials. Materials used shall be free from defects which would adversely affect the performance or maintainability of individual components or of the overall assembly. Materials not specified herein shall be of the same quality used for the intended purpose in commercial practice. Unless otherwise specified herein, all equipment, material, and articles incorporated in the work covered by this specification are to be new and fabricated using materials produced from recovered materials to the maximum extent possible without jeopardizing the intended use. The term "recovered materials" means materials which have been collected or recovered from solid waste and reprocessed to become a source of raw materials, as opposed to virgin raw materials. None of the above shall be interpreted to mean that the use of used or rebuilt products are allowed under this specification unless otherwise specified.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the current version before use.

* 3.6 Interchangeability. All units of the same classification furnished with similar options under a specific contract shall be identical to the extent necessary to insure interchangeability of component parts, assemblies, accessories, and spare parts.

* 3.7 Design and construction. The unit shall be designed to withstand strains, jars, vibrations, and other conditions incidental to shipping, storage, and installation, and to permit easy accessibility for maintenance and service in the field. The design shall be such as to prevent conditions which may be hazardous to personnel or deleterious to equipment. The unit shall be complete so that when installed and connected to the specified source of steam or hot-water piping it can be used for any operation for which it was designed. Construction shall be free of any characteristics or defects that will prevent the unit from passing any of the inspections specified in 4.5 and 4.6. All necessary brackets and fasteners for mounting style B heaters shall be furnished. Unless otherwise specified (see 6.2), the heaters shall be tapped at opposite ends. All threaded parts shall be in the inch system and shall conform to ANSI Standard B1.1, B1.2, or B2.1 as applicable.

3.7.1 Heating element. The heating element shall consist of headers, when required, and of expanded-metal (finned) tubes. The heating element shall be capable of operating safely under a test pressure of not less than 100 pounds per square inch gage (psig) (see 4.6.1).

* 3.7.1.1 Tubes and fins. Tubes and fins shall be suitable for the heating medium and conditions as specified herein. Tubes shall be considered a primary heating surface and shall be copper, brass, manganese, steel, or aluminum. Fins shall be considered a secondary heating surface and shall be copper, steel, or aluminum. The fins shall be continuously bonded to the tubes to insure a tight, rigid, metal-to-metal contact under specified operating conditions. The fins shall have a uniform pitch, be in a plane perpendicular to the centerline of the pipe, and have smooth surfaces, free from wrinkles or kinks, except that die-formed fins curved to increase turbulence will be acceptable. Orifices or baffle plates of proper size shall be provided when required to insure uniform distribution of the heating medium to each tube. Tubes shall be arranged to minimize expansion and contraction stresses.

* 3.7.1.2 Headers. Headers, when required, shall be cast iron, cast brass, steel tubing, steel pipe, steel plate, or copper tubing. Finned tubes shall be mechanically bonded to cast iron, steel tube, or copper tube headers but may be brazed or welded to steel pipe or steel plate headers. When headers are used on hot water systems the water velocity shall be not less than one foot per second through the finned tubes.

3.7.1.3 Air chamber and venting device. When the heating medium is not water, the highest point of the heating element shall be provided with an air chamber and with a manual venting device operable without removal of any part of the heater. When specified (see 6.2), an automatic venting device shall be furnished.

3.7.2 Enclosure. The heating element shall be completely enclosed in a sheet steel cabinet or section type enclosure. Proper rigidity shall be accomplished by configuration design, bracing, or reinforcing. Horizontal tubes shall have a pitch with respect to the enclosure for proper drainage.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the current version before use.

Trappings of condensate in steam systems or air in hot-water systems shall be avoided. Unless otherwise specified (see 6.2), dimensions other than the height (see 1.2) shall be at the manufacturer's option. When specified (see 6.2), the air-outlet opening shall be equipped with a readily adjustable damper.

* 3.7.2.1 Cabinet type. The cabinet type enclosure shall be sheet metal not less than 18 gage (0.0478-inch nominal thickness) for top and front and not less than 20 gage (0.0359-inch nominal) for sides and back. When galvanized, the nominal thickness shall be 0.050 and 0.0375 inch, respectively. The front panel shall be readily removable to allow access to the heating element.

* 3.7.2.2 Section type. The section type enclosure shall be metal having a thickness of not less than 20 gage (0.0359-inch nominal) and so formed as to increase the strength of the material. The section shall be bonded to the tube or primary surface and shaped to form a flue. The enclosure shall have proper configuration to prevent accumulation of dirt and other foreign matter. Inlet and outlet air grilles and fin spacing shall be designed for proper air velocity.

3.7.2.3 Models F, T, C, and S. Model F, model T, and style A of model C shall be provided at the bottom of the enclosure with air inlet openings that need not be grilled, and with a grilled air outlet at or near the top. Model S enclosures shall be provided with a perforated metal housing covering the front, top, and sides.

* 3.8 Capacity. The heater shall have a capacity in British thermal units per hour (Btu/hr) not less than that specified when operated with steam or hot water at the temperature and pressure specified (see 6.2). The capacity shall be based on an entering air temperature of 65° Fahrenheit (F). Unless otherwise specified (see 6.2), the maximum surface temperature of the enclosure shall be 175°F.

* 3.9 Treatment and painting. Unless otherwise specified (see 6.2), the heater shall be treated and painted in accordance with the manufacturer's standard practice. All surfaces of the heater, other than corrosion-resisting steel, shall be protected against corrosion.

* 3.10 Identification marking. Identification shall be permanently and legibly marked directly on the heater or on a corrosion-resisting metal plate securely attached to the heater or on a corrosion-resisting metal plate securely attached to the heater at the source of manufacture. Identification shall include the manufacturer's model and serial number, name, and trademark to be readily identifiable to the manufacturer.

3.11 Workmanship.

* 3.11.1 Steel fabrication. The steel used in fabrication shall be free from kinks, sharp bends, and other conditions which would be deleterious to the finished product. Manufacturing processes shall not reduce the strength of the steel to a value less than intended by the design. Manufacturing processes shall be done neatly and accurately. All bends shall be made by controlled means to insure uniformity of size and shape.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the currentversion before use.

* 3.11.2 Bolted connections. Bolt holes shall be accurately punched or drilled and shall have the burrs removed. Washers or lockwashers shall be provided in accordance with good commercial practice, and all bolts, nuts, and screws shall be tight.

* 3.11.3 Riveted connections. Rivet holes shall be accurately punched or drilled and shall have the burrs removed. Rivets shall be driven with pressure tools and shall completely fill the holes. Rivet heads, when not countersunk or flattened, shall be of approved shape and of uniform size for the same diameter of rivet. Rivet heads shall be full, neatly made, concentric with the rivet holes, and in full contact with the surface of the member.

* 3.11.4 Welding. Welding procedures shall be in accordance with a nationally recognized welding code. The surface of parts to be welded shall be free from rust, scale, paint, grease, or other foreign matter. Welds shall be of sufficient size and shape to develop the full strength of the parts connected by the welds. Welds shall transmit stress without permanent deformation or failure when the parts connected by the weld are subjected to proof and service loadings.

* 3.11.5 Castings. All castings shall be sound and free from patching, misplaced coring, warping, or any other defect which reduces the casting ability to perform its intended function.

4. QUALITY ASSURANCE PROVISIONS

* 4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disap- proved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

* 4.2 Classification of inspection. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.2.1).
b. Quality conformance inspection (see 4.2.2).

* 4.2.1 First article inspection. First article inspection shall be performed on one heater when a first article is required (see 3.2 and 6.4). This inspection shall include the examination of 4.5, the tests of 4.6, and the requirements of 4.7. The first article may be either a first production item or a standard production item from the supplier's current inventory provided the unit meets the requirements of the specification and is representative of the design, construction, and manufacturing technique applicable to the remaining units to be furnished under the contract.

* 4.2.2 Quality conformance inspection. Quality conformance inspection shall be performed on the sample heaters selected in accordance with 4.4. This inspection shall include the examination of 4.5, the tests of 4.6, and the requirements of 4.7.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the current version before use.

* 4.3 Inspection lot. All units of the same classification offered for delivery at one time shall be considered a lot for purposes of inspection. The sample unit shall be one complete heater.

4.4 Sampling.

4.4.1 Sampling for examination. A random sample of heaters shall be selected from each lot offered to the Government in accordance with MIL-STD-105 at inspection level II. The acceptable quality level (AQL) shall be 1.5 percent defective for major defects and 4.0 percent defective for minor defects.

* 4.5 Examination. Each unit selected in accordance with 4.4.1 shall be examined to verify compliance with the requirements of this specification. Examination shall be conducted as specified in table I. Any heater in the sample containing one or more defects shall be rejected, and if the number of defective units in any sample exceeds the acceptance number for that sample, the lot represented by the sample shall be rejected. All defective units shall be replaced with non-defective units prior to testing.

TABLE I. Classification of defects.

Categories	Defects
Major:	
101	Parts missing or not as specified.
102	Component parts not new or not interchangeable.
103	Construction precludes easy accessibility for maintenance or service.
104	Materials not of proper quality.
105	Dimensions not as specified.
106	Extended surfaces (fins) not properly bonded to tubes.
107	External connections not adequate.
108	Tubes not properly pitched to avoid trappings.
Minor:	
201	Painting of poor grade.
202	Workmanship not of high quality.
203	Identification marking not correct.

* 4.6 Tests. All units presented in 4.3 shall be tested as specified in 4.6.1. Any unit failing to pass the tests, shall be rejected.

* 4.6.1 Pressure tests. Each heating element shall be pressure tested to show compliance with 3.7.1. The test shall be either pneumatic or hydraulic and the duration shall be not less than one minute. When pneumatic, the heating element shall be submerged in water to facilitate indication of leaks. In either case, the test pressure shall be not less than 100 psig. Any unit exhibiting leakage shall be rejected.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the currentversion before use.

* 4.7 Packaging inspection. The preservation, packaging, packing, and marking of the heaters shall be inspected to determine conformance with the applicable requirements of section 5 of this specification.

* 5. PACKAGING

* 5.1 Preservation. Preservation shall be level A or commercial as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Methods of preservation. Cleaning processes, drying procedures, preservatives, and methods of preservation specified in the following paragraphs are listed in MIL-P-116 and shall conform to the requirements of MIL-P-116 and any applicable specifications.

* 5.1.1.2 Cleaning and drying. Prior to the application of preservative compounds or paint, surfaces shall be cleaned by process C-1 and dried by any applicable procedure of MIL-P-116.

5.1.1.3 Unprotected surfaces. Unpainted ferrous metal surfaces, including threaded surfaces, shall be coated with type P-1 preservative. Care should be taken not to coat fins, coils, or other areas that would impair the heat transfer capabilities of the equipment.

* 5.1.1.3 Accessories. Accessories shall be preserved and packaged method I or III as applicable in accordance with MIL-P-116.

* 5.1.1.4 Heating element. The heating element supply and return connections shall be sealed with type I, grade A, barrier material conforming to MIL-B-121 and secured with pressure-sensitive tape.

* 5.1.1.5 Accessories. Accessories shall be preserved and packaged method I or III as applicable in accordance with MIL-P-116.

* 5.1.2 Commercial. The heaters shall be preserved and packaged in a manner to prevent deterioration and damage during shipment.

* 5.2 Packing. Packing shall be level A, B, or commercial as specifed (see 6.2).
* 5.2.1 Levels A and B. Packing shall be accordance with MIL-STD-794. Containers shall be selected from table I for the appropriate level.

* 5.2.2 Commercial. The heaters shall be packed in a manner which will insure arrival at destination in satisfactory condition. Containers and packing shall comply with applicable carrier rules and regulations.

* 5.3 Marking. Marking shall comply with MIL-STD-129.

6. NOTES

6.1 Intended use. Heaters are used to heat air, under natural circulation (thermal convection) conditions, in individual rooms of residences, offices, etc.

Source: https://assist.dla.mil -- Downloaded: 202640-18T11:42Z
Check the source to verify that this is the currentversion before use.

* 6.2 Ordering data. Acquisition documents should specify the following:


a. Title, number, and date of this specification.
b. Type, class, style, model, and size of heater required (see 1.2).
c. Whether a steam or hot water system shall be used; for model C only, height of heater, number of tubes per section, and number of sections required (see 3.1).
d. When first article is required for inspection and approval (see 3.2).
e. When tapping location, if other than as specified (see 3.7).
f. When an automatic venting device is required (see 3.7.1.3).
g. Maximum enclosure dimensions and adjustable damper, when required (see 3.7.2).
h. Capacity in Btu/hr and values of steam pressure (psig), or entering water temperature (°F) and water pressure (psig), as applicable; and enclosure surface temperature, if other than as specified (see 3.8).
i. Treatment of painting, if other than as specified (see 3.9).
j. Level of preservation, and level of packing required (see 5.1 and 5.2).

* 6.3 Contract data requirement. When this specification is used in an acquisition which incorporates a DD Form 1423 and invokes the provisions of paragraph 7-104.9(n) of the Defense Acquisition Regulation (DAR), the data requirements will be developed as specified by an approved Data Item Description (DD Form 1664) and delivered in accordance with the Contract Data Requirements List (DD Form 1423) incorporated into the contract. When the provisions of DAR 7-104.9 (n) are not invoked, the data shall be deliverd in accordance with the contract requirements.

* 6.4 First article. When a first article is required, it shall be tested and approved under the appropriate provisions of paragraph 7-104.55 of the DAR. The first article may be either a first production item consisting of one complete heater or a standard production item from the contractor's current inventory as specified in 4.2.1. The contracting officer should include specific instructions in all acquisition instruments, regarding arrangement for examinations, tests, and approval of the first article.

* 6.5 Definitive military specification part number. The definitive military specification part number corresponds to the type, class, and other specific classification data applicable to heater units covered by this specification, and defines the requirements of the options presented under this specification. The military specification number, the type and class code number, and the heater units' other applicable code numbers are combined to form the definitive military specification part number.

* 6.5.1 Cataloging data. For cataloging purposes, definitive military specification part numbers for the heater units are assigned as follows:

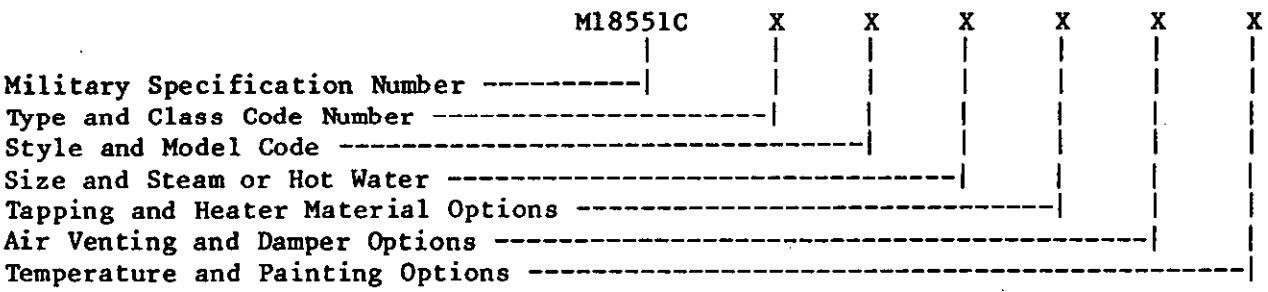

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:42Z
Check the source to verify that this is the current version before use.

* 6.5.2 Type and class. The type and class of heater units are identified by a single number (see table II).

TABLE II. Type and class.

Type	Class	
	Class I Nonrecessed	Class 2 Recessed
Type I - Nonferrous heating element	1	2
Type II - Ferrous heating element	3	4

* 6.5.3 Style and model. The style and model of heater units are identified by a single number (see table III).

TABLE III. Style and model.

Model	Model	
	Style A Floor-mounted	Style B Wall-mounted
Model F - Front air outlet	1	2
Model T - Top air outlet	3	4
Model S - Side, front, and top outlet (perforated metal construction)	5	6

* 6.5.4 Size and steam or hot water. The size and heating medium option of heater units are identified by a single letter (see table IV).

Table IV. Size and heating medium.

Size	Heating medium	
	Steam	Hot water
Size 14 Overall Height of 14 inches	A	L
Size 16 Overall Height of 16 inches	B	M
Size 18 Overall Height of 18 inches	C	N
Size 20 Overall Height of 20 inches	D	P
Size 22 Overall Height of 22 inches	E	R
Size 24 Overall Height of 24 inches	F	S
Size 26 Overall Height of 26 inches	G	T
Size 28 Overall Height of 28 inches	H	U
Size 30 Overall Height of 30 inches	J	V
Size 32 Overall Height of 32 inches	K	X

* 6.5.5 Tapping and header material. The tapping location and header material of heater units are identified by a single letter (see table V).

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the current version before use.

TABLE V. Tapping and header material.

Header material	Tapping location		
	Both right	Both left	Opposite ends
Cast Iron	A	G	N
Cast Brass	B	H	P
Steel Tubing	C	J	R
Steel Pipe	D	K	S
Steel Plate	E	L	T
Copper Tubing	F	M	U

* 6.5.6 Air venting and damper option. The air venting and damper option of heater units are identified by a single number (see table VI).

TABLE VI. Air venting and damper.

Air venting	Damper	
	With damper	Without damper
Manual air venting	1	2
Automatic air venting	3	4

* 6.5.7 Temperature and painting. The maximum allowable surface temperature of the heater enclosure and whether other than the manufacturers standard painting process will be required on heating units are identified by a single letter (see table VII).

TABLE VII. Temperature and painting.

Enclosure maximum allowable surface temperature	Painting (see 3.9)	
	Manufacturers' Std.	Other (see 6.2)
175°F	A	D
180°F	B	E
185°F	C	F

* 6.6 Changes from previous issue. The margins of this specification are marked with an asterisk to indicate where changes (additions, modifications, corrections, deletions) from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodian:
Army - ME
Navy - YD
Air Force - 99

Review activities:
Air Force - 84
Navy - MC

User activity:
Army - CE

Preparing activity:
Navy - YD

Project No. 4520-N269

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:42Z
Check the source to verify that this is the currentversion before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-H-18551C	HEATERS, CONVECTION, STEAM OF HOT WATER

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR ☐ USER ☐ MANUFACTURER ☐ OTHER *(Specify)*:
b. ADDRESS *(Street, City, State, ZIP Code)*	

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

DD FORM 82 MAR 1426 PREVIOUS EDITION IS OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:42Z
Check the source to verify that this is the current version before use.