INCH-POUND

MIL-P-49378 (AR)
AMENDMENT 1
03 January 2000

MILITARY SPECIFICATION

POWER CONVERTER FOR AN/VSG-2

This Amendment forms part of MIL-P-49378, dated 16 June 1980, and is approved for use by the US Army Armament, Research, Development, and Engineering Center, and is available for use by all Departments and Agencies of the Department of Defense.

PAGE 4

3.7.7: Table, under Voltage ripple column: Change all "25" to "50".

3.7.9: Delete in its entirety and substitute the following:

"3.7.9 Transient power.

3.7.9.1 Transient voltage input: The Power Converter shall operate in accordance with paragraph 3.7.4 and 3.7.5 during the transient voltage defined in Figure 1 applied at the input connector 4J1.

3.7.9.2 Severe transient voltage input: The Power Converter shall not be damaged by the transient voltages defined in Figure 2 applied at the input connector 4J1, and shall operate in accordance with paragraphs 3.7.4 and 3.7.5 following reset of the circuit breaker."

PAGE 11

4.7.9: Delete in its entirety and substitute the following:

"4.7.9 Transient power.

4.7.9.1 Transient voltage. The Power Converter shall operate in accordance with paragraphs 3.7.4 and 3.7.5 during the transient voltages defined in Figure 1 applied at connector 4J1.

4.7.9.2 Severe transient voltage. The Power Converter shall not be damaged by the transient voltages defined in Figure 2 applied at the input connector 4J1 and shall operate in accordance with paragraphs 3.7.4 and 3.7.5 following reset of the circuit breaker."

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T20:04Z
Check the source to verify that this is the current version before use.

PAGE 18

Figure 1 : Delete in its entirety and substitute:

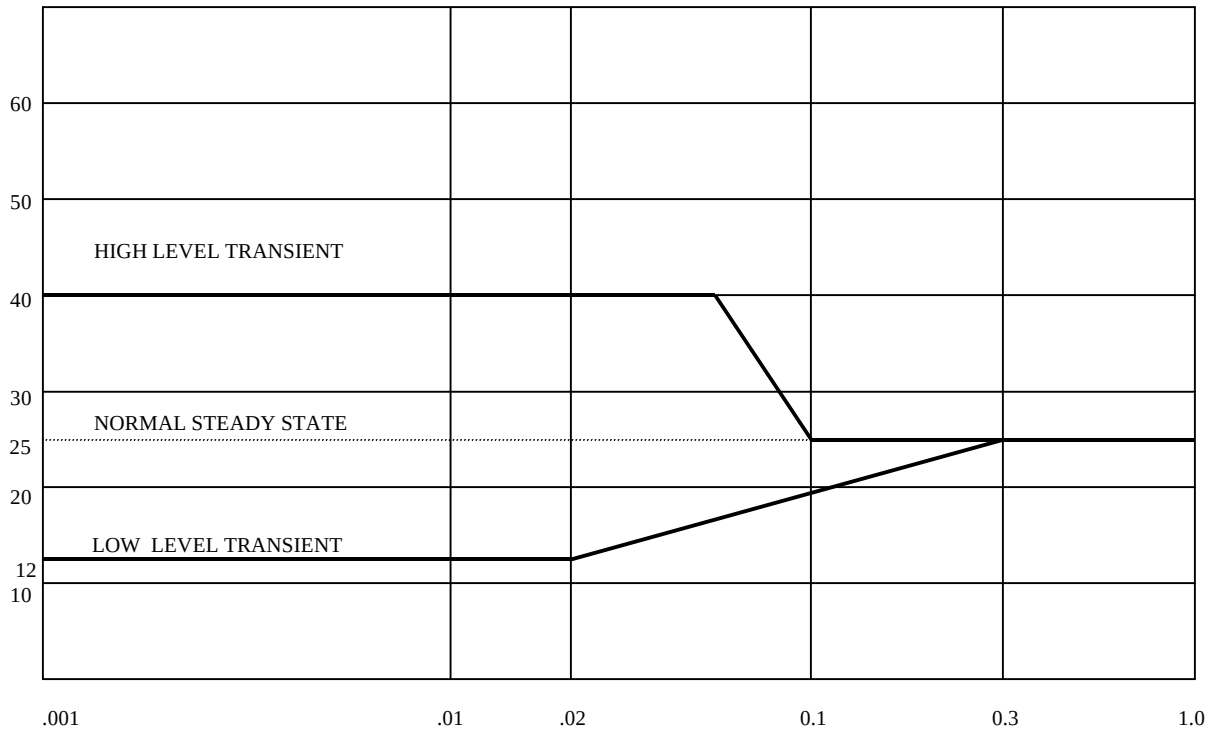

Figure 1. Transient Voltage Levels.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T20:04Z
Check the source to verify that this is the current version before use.

Figure 2 : Delete in its entirety and substitute :

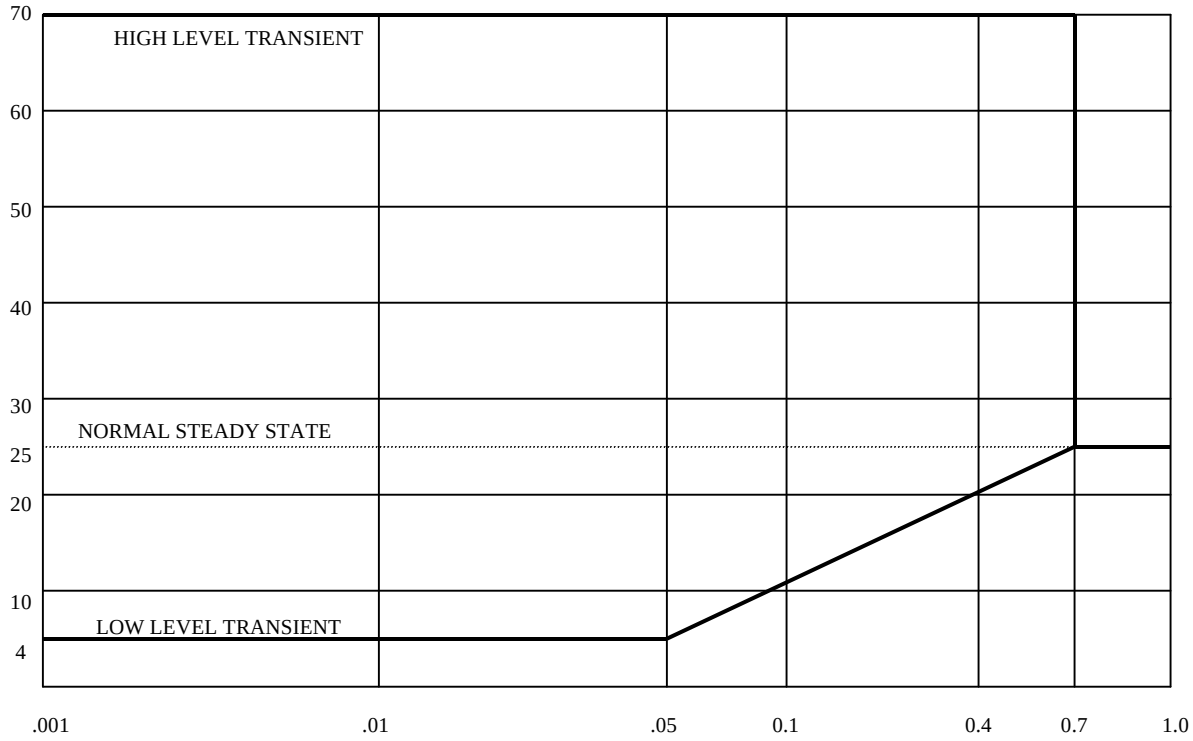

Figure 2. Severe Transient Voltage Levels.

Custodian:
Army – AR

Preparing activity:
Army – AR

(Project 5855-0224)

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T20:04Z
Check the source to verify that this is the current version before use.