MIL-C-29184/10A(NAVY)
3 December 1984
SUPERSEDING
MIL-C-29184/10
15 December 1979

MILITARY SPECIFICATION SHEET

CABLE ASSEMBLIES, POWER, ELECTRICAL, FOR PORTABLE PANELBOARDS: TYPE IV, CLASS 1, 60 AMPERE, CONFIGURATION 2

This specification is approved for use by the Naval Facilities Engineering Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring cable assemblies described herein shall consist of this specification and the latest issue of MIL-C-29184.

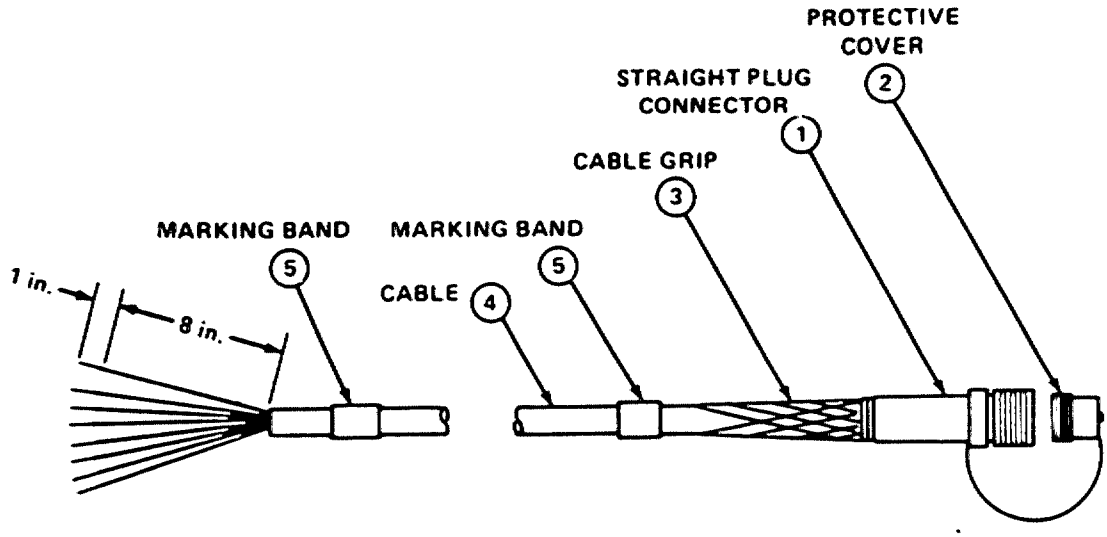


FIGURE 1. Cable assembly functional components.

FSC 6150

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Physical:

Design and construction - See figure 1 and table I.
Overall length - 10 feet, measured from the outside front edge of the connector housing with the protective cover off.

Electrical:

Power - 208Y/120 volt, 3 phase, 4 pole, 5 wire.
Ampacity - 60 amperes.
Cable to connector wiring - See table II.

Government part number - M29184/10.
Government-furnished equipment - Items 1 through 3A of table I. Items 2, 3, and 3A should be furnished as part of item 1.

TABLE I. Cable assembly components.

Item	Quantity	Description	Military part number (if applicable)
1	1	MIL-C-22992, class L, 60 amperes straight plug connector.	MS90556C32412P
* 2	1	Protective cover (plug type) for item 1.	MS90564-4C
* 3	1	Cable strain relief grip.	MS90561-2
* 3A	1	Cable sealing gland for use with item 3.	MS23747-2
4	1	Portable power cable, NEMA type G, 4 conductor, No. 6 AWG with not less than 259 strands per conductor and 4 grounding conductors, No. 12 AWG with not less than 19 strands per conductor. The end opposite the connector shall have 8 inches of the outer jacket and 1 inch of insulation removed from each conductor. Bare conductor leads shall be dipped in solder.	
5	2	Marking bands.	

*These items should be supplied as part of item 1 when item 1 is procured.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.

TABLE II. Cable wire termination.

Conductor Color	Phase	Terminal Identification
Black	A	A
Red	B	B
Orange	C	C
White	Neutral	N
Green or bare	Ground	G(1)

(1) The four grounding conductors shall be connected to terminal G.

Custodian:
Navy - YD

Preparing Activity:
Navy - YD

(Project 6150-N193)

Review Activity:
Navy - MC, Fleet Hospital Support Office

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.