MILITARY SPECIFICATION SHEET

CABLE ASSEMBLIES, POWER, ELECTRICAL, FOR PORTABLE PANELBOARDS: TYPE IV, CLASS 1, 20 AMPERE

This specification is approved for use by the Naval Facilities Engineering Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring cable assemblies described herein shall consist of this specification and the latest issue of MIL-C-29184.

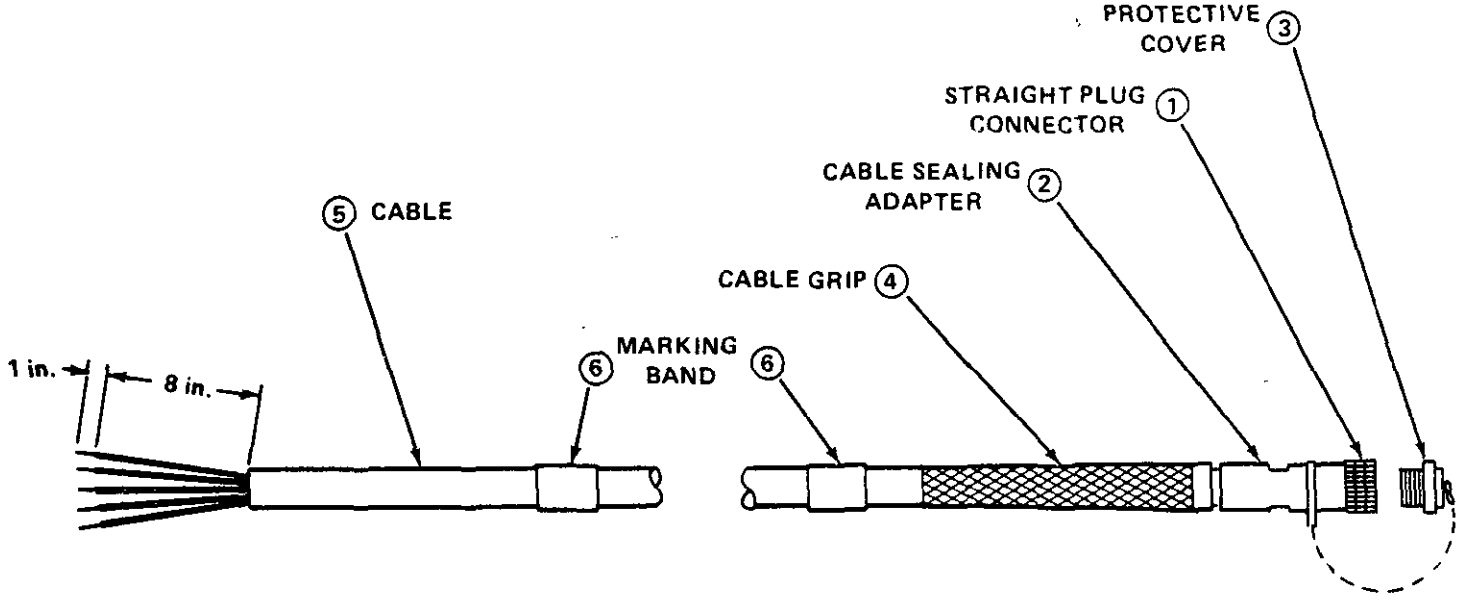


FIGURE 1. Cable assembly functional components.

FSC 6150

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:05Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Physical:

Design and construction - See figure 1 and table I.
Overall length - 10 feet, measured from the outside front edge of the connector housing with the protective cover off.

Electrical:

Power - 208Y/120 volt, 3 phase, 4 pole, 5 wire.
Ampacity - 20 amperes.
Cable to connector wiring - See table II.

Government part number - M29184/12.
Government-furnished equipment - Items 1 through 4 of table I. Nonconductive finish (designated by N in military part number) shall be supplied.

TABLE I. Cable assembly components.

Item	Quantity	Description	Military part number (if applicable)
1	1	MIL-C-22992, class R, straight plug connector with pin contacts.	MS17344R24N10P
2	1	MIL-C-22992, class R, straight through cable sealing adapter (includes cable grip and captive protective cover with chain for item 1).	MS90571N16A
3	1	Captive protective cover (plug) for item 1 (included as part of item 2).	
4	1	Cable strain relief grip (included as part of item 2).	
5	1	Portable control cable, NFPA No. 70, type SO, 5 conductor, No. 10 AWG with not less than 105 strands per conductor. The end opposite the connector shall have 8 inches of the outer jacket and 1 inch of insulation removed from each conductor. Bare conductor leads shall be dipped in solder.	
6	2	Marking bands.	

Source: https://assist.dla.mil -- Downloaded: 20261O-20T22:05Z
Check the source to verify that this is the current version before use.

TABLE II. Cable wire termination.

Conductor Color	Phase	Terminal Identification
Black	A	F
Red	B	B
Orange	C	E
White	Neutral	A
Green or bare	Ground	C

Note: Terminals D and G are not used.

Custodian:
Navy - YD

Review Activity:
Navy - MC, Fleet Hospital Support Office

Preparing Activity:
Navy - YD

(Project 6150-N195)

Source: https://assist.dla.mil -- Downloaded: 202610-20T22:05Z
Check the source to verify that this is the current version before use.