MIL-C-29184/8A(NAVY)
3 December 1984
SUPERSEDING
MIL-C-29184/8
15 December 1979

MILITARY SPECIFICATION SHEET

# CABLE ASSEMBLIES, POWER, ELECTRICAL, FOR PORTABLE PANELBOARDS: TYPE IV, CLASS 1, 60 AMPERE, *CONFIGURATION 1*

This specification is approved for use by the Naval Facilities Engineering Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring cable assemblies described herein shall consist of this specification and the latest issue of MIL-C-29184.

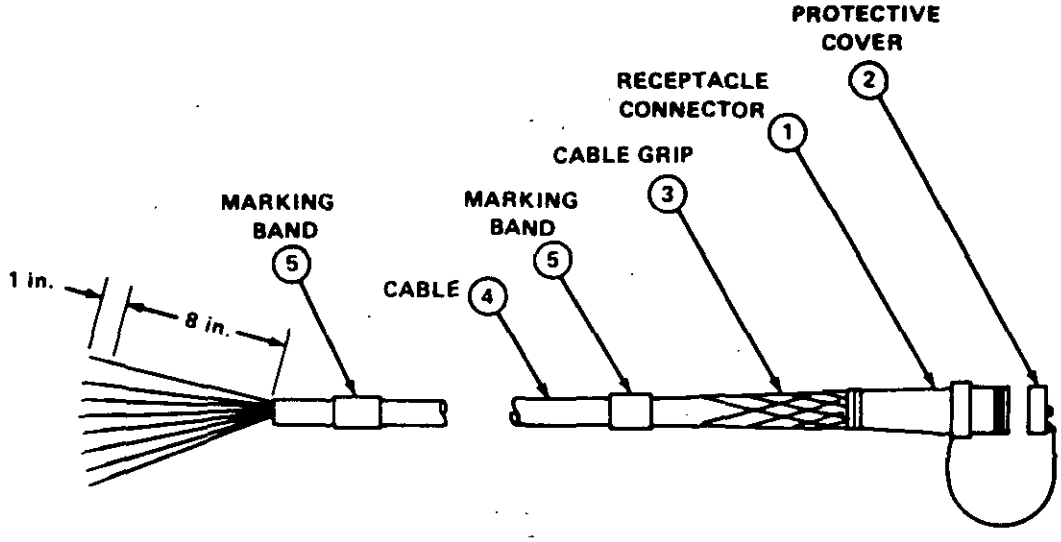



FIGURE 1. Cable assembly functional components.

FSC 6150



Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Physical:

Design and construction - See figure 1 and table I.
Overall length - See table II. Measured from the outside front edge of the connector housing with the protective cover off.

Electrical:

Power - 208Y/120 volt, 3 phase, 4 pole, 5 wire.
Ampacity - 60 amperes.
Cable to connector wiring - See table III.

Government part number - M29184/8 - (dash number from table II).
Government-furnished equipment - Items 1 through 3A of table I. Items 2, 3, and 3A should be furnished as part of item 1.

TABLE I. Cable assembly components.

| Item | Quantity | Description | Military part number (if applicable) |
|---|---|---|---|
| 1 | 1 | MIL-C-22992, class L, 60 amperes cable connecting receptacle connector without coupling ring. | MS90557C32412S |
| * 2 | 1 | Protective cover (cap type) for item 1. | MS90563-4C |
| * 3 | 1 | Cable strain relief grip. | MS90561-2 |
| * 3A | 1 | Cable sealing gland for use with item 3. | MS23747-2 |
| 4 | 1 | Portable power cable, NEMA type G, 4 conductor, No. 6 AWG with not less than 259 strands per conductor and 4 grounding conductors, No. 12 AWG with not less than 19 strands per conductor. The end opposite the connector shall have 8 inches of the outer jacket and 1 inch of insulation removed from each conductor. Bare conductor leads shall be dipped in solder. | |
| 5 | 2 | Marking bands. | |

*These items should be supplied as part of item 1 when item 1 is procured.



Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.

TABLE II. Dash numbers.

| Dash Number | Description |
|---|---|
| 01 | Cable assembly, 50 feet overall length. |
| 02 | Cable assembly, 100 feet overall length. |

TABLE III. Cable wire termination.

| Conductor Color | Phase | Terminal Identification |
|---|---|---|
| Black | A | A |
| Red | B | B |
| Orange | C | C |
| White | Neutral | N |
| Green or bare | Ground | G(1) |

(1) The four ground conductors shall be connected to terminal G.

Custodian:
Navy - YD

Preparing Activity:
Navy - YD

Review Activity:
Navy - MC, Fleet Hospital Support Office

(Project 6150-N191)



Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:04Z
Check the source to verify that this is the current version before use.