INCH-POUND

MIL-DTL-29183/17A
13 March 2003
SUPERSEDING
MIL-P-29183/17
18 June 1990

DETAIL SPECIFICATION SHEET

PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE I, CLASS 1, CONFIGURATION 4: 208Y/120 VOLT, 100 KILOWATT

Inactive for new design after 22 April 1998

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of MIL-DTL-29183 listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation.

REQUIREMENTS: The distribution panel shall be as specified herein and in accordance with figure 1 and tables I and II. Required accessory equipment shall be as specified in table III.

Physical:

Weight: The weight shall not exceed 180 pounds (82 kilograms).

Dimensions (maximum):
Length: 40.0 inches (1016 millimeters (mm))
Width: 32.0 inches (813 mm)
Height: 35.0 inches (889 mm)

Stability: The vertical center of gravity shall be not more than 21.0 inches (533 mm) above level ground. Additional stability requirements shall apply in accordance with MIL-DTL-29183.

Paralleling cable access panel: Required (see MIL-DTL-29183).

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.

Electrical:

Input: The input to the distribution panel shall be 208Y/120 volt (V), 3-phase (ø), 4-pole (P), 5-wire (W), 60 Hertz (Hz).

Bus capacity: The bus bar capacities shall be 225 amperes (A) (see figure 1).

Circuit breaker: The number of poles and current rating shall be as indicated in table I herein and the voltage rating shall be sufficient for the intended circuit.

Modification capability: Design provisions shall be made to accommodate in the future an additional 3P-400A main breaker and a knockout for 100A, class L in put connection (MS90558C44412P).

PIN: The government part identification number (PIN) is as follows:

M 29183 / 17

- 17 — Specification sheet number
- 29183 — General specification number
- M — Prefix

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.

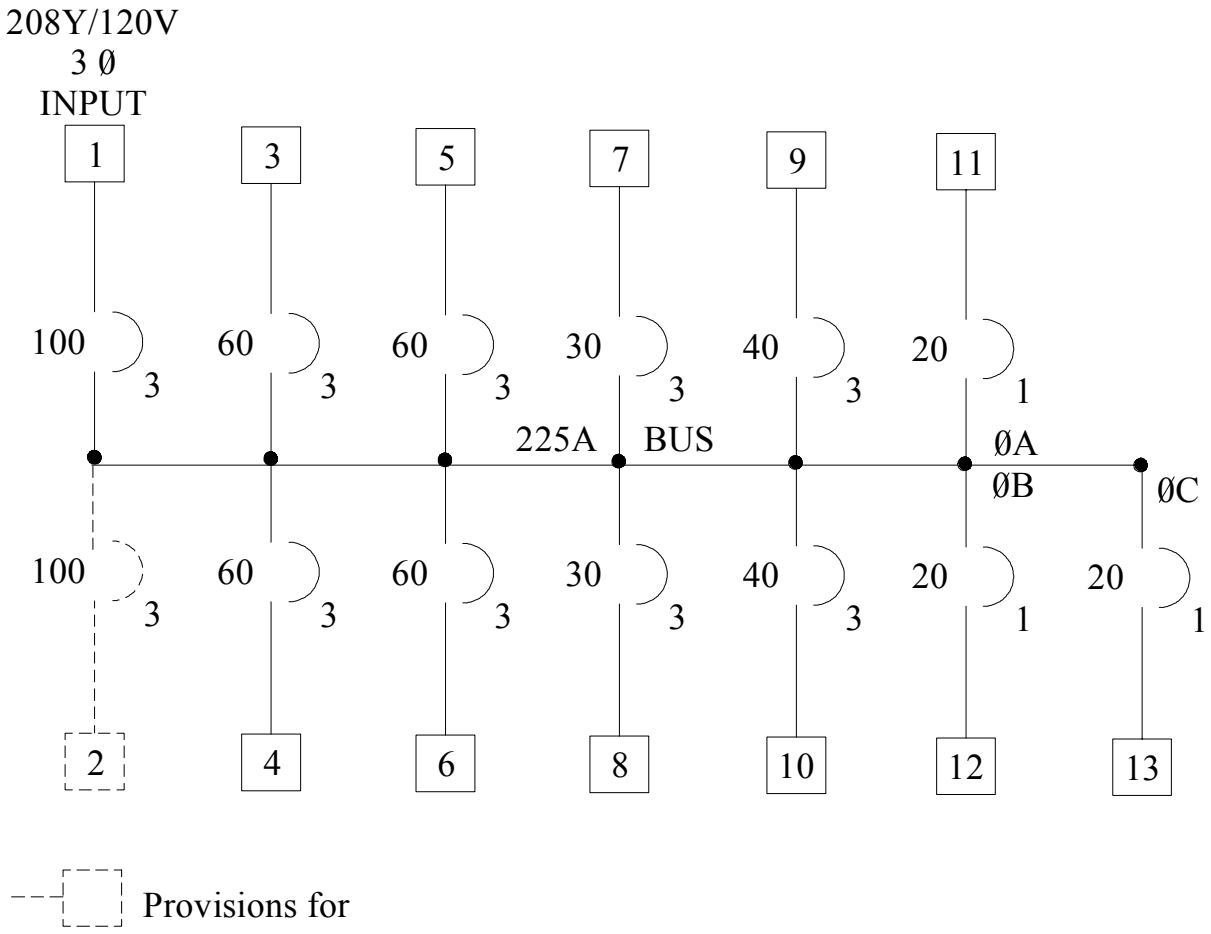


FIGURE 1. Single-line wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.

TABLE I. Circuit characteristics.

Quantity	Circuit kind	Circuit breaker Pole (P) - Ampere (A)	Interface connector
1	208Y/120V, 3-phase, 5W	3P-100A	MS90558C44412P[1]
4	208Y/120V, 3-phase, 5W	3P-60A	MS90555C32412S[1]
2	208Y/120V, 3-phase, 5W	3P-30A	MS90555C32412S[1]
2	208Y/120V, 3-phase, 5W	3P-40A	MS90555C32412S[1]
3	120V, 1-phase, 3W	1P-20A	NEMA L5-20R[2]

[1] Connector designations are military part numbers for military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

[2] Connector designations are National Electrical Manufacturers Association (NEMA).

TABLE II. Connector assignment and connector terminal wiring.

Circuit	Function	Interface connector	Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
1	Input	MS90558C44412P[1]	A	B	C	N	G1, G2 G3, G4
3, 4, 5, 6	Branch	MS90555C32412S[1]	A	B	C	N	G
7, 8, 9, 10	Branch	MS90555C32412S[1]	A	B	C	N	G
11	Branch	L5-20R[2]	X[3]			W	G
12	Branch	L5-20R[2]		X[3]		W	G
13	Branch	L5-20R[2]			X[3]	W	G

[1] Connector designations are military part numbers for military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

[2] Connector designations are National Electrical Manufacturers Association (NEMA).

[3] Unmarked terminal.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.

TABLE III. Required accessory equipment.

Item	Quantity	Description	Part number
1	1	MIL-C-22992, class L, 100A wall mount, plug, with coupling ring, connector	MS90558C44412P[1]
2	1	Protective cover (cap) for item 1	MS90564-7C[1]
3	8	MIL-C-22992, class L, 60A, wall mount socket receptacle	MS90555C32412S[1]
4	8	Protective receptacle cover (cap) for item 3	MS90563-3C[1]
5	3	NEMA type, connector, locking	L5-20R[2]
6	3	Protective receptor cover (cap) for item 5	NEMA standard

[1] Designations are military part numbers for military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

[2] Connector designations are National Electrical Manufacturers Association (NEMA).

Custodians:
Army - CR4
Navy - YD

Preparing Activity:
DLA - GS2

(Project 6110-0443-012)

Review Activities:
Navy - MC, MS

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.

2. The submitter of this form must complete blocks 4, 5, 6, and 7.

3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	**1. DOCUMENT NUMBER** MIL-DTL-29183/17A	**2. DOCUMENT DATE** (YYYYMMDD) 20030313

3. DOCUMENT TITLE
PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE I, CLASS 1, CONFIGURATION 4: 208Y/120 VOLT, 100 KILOWATT

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME *(Last, First, Middle Initial)*	b. ORGANIZATION	
c. ADDRESS *(Include Zip Code)*	d. TELEPHONE (Include Area Code) (1) Commercial (2) DSN *(if applicable)*	**7. DATE SUBMITTED** (YYYYMMDD)

8. PREPARING ACTIVITY

a. NAME Defense Supply Center Richmond	b. TELEPHONE (*Include Area Code*) Commercial: (804) 279-5019 DSN: 695-5019
c. ADDRESS *(Include Zip Code)* ATTN: DSCR-VBD (C. Hammond) 8000 Jefferson Davis Highway Richmond, VA 23297-5610	**IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:** DEFENSE STANDARDIZATION PROGRAM OFFICE (DLSC-LM) 8725 John J. Kingman Road, Suite 2533 Fort Belvoir, VA 22060-6221 Commercial: (703) 767-6888 DSN: 427-6888

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:59Z
Check the source to verify that this is the current version before use.