| INCH-POUND |

MIL-P-29183/19
18 June 1990

MILITARY SPECIFICATION SHEET

PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF
TYPE 1, CLASS 1, CONFIGURATION 5: 208Y/120 VOLT, 100 KILOWATT

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-P-29183B

REQUIREMENTS.

The distribution panel shall be as specified herein and in accordance with tables I and II, and figure 1. Required accessory equipment shall be as specified in table III.

Physical.

Nominal weight: 434 pounds (197 kilograms).
Maximum dimensions: Length: 65 inches (1651 millimeters (mm)).
Width: 32 inches (813 mm), Height: 35 inches (889 mm).
Vertical center of gravity: 20.5 ± 0.5 inches (521 ± 13 mm) above level ground.
Paralleling access panel: Provisions only (see 3.8.5.2.1 of MIL-P-29183).

Electrical.

Input: 208Y/120 volt (V), 3 phase, 4 pole (P), 5 Wire (W), 60 Hertz.
Bus capacity: 400 amperes (A).

Government part number - M29183/19

AMSC N/A FSC 6110

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 20261O-20T22:00Z
Check the source to verify that this is the current version before use.

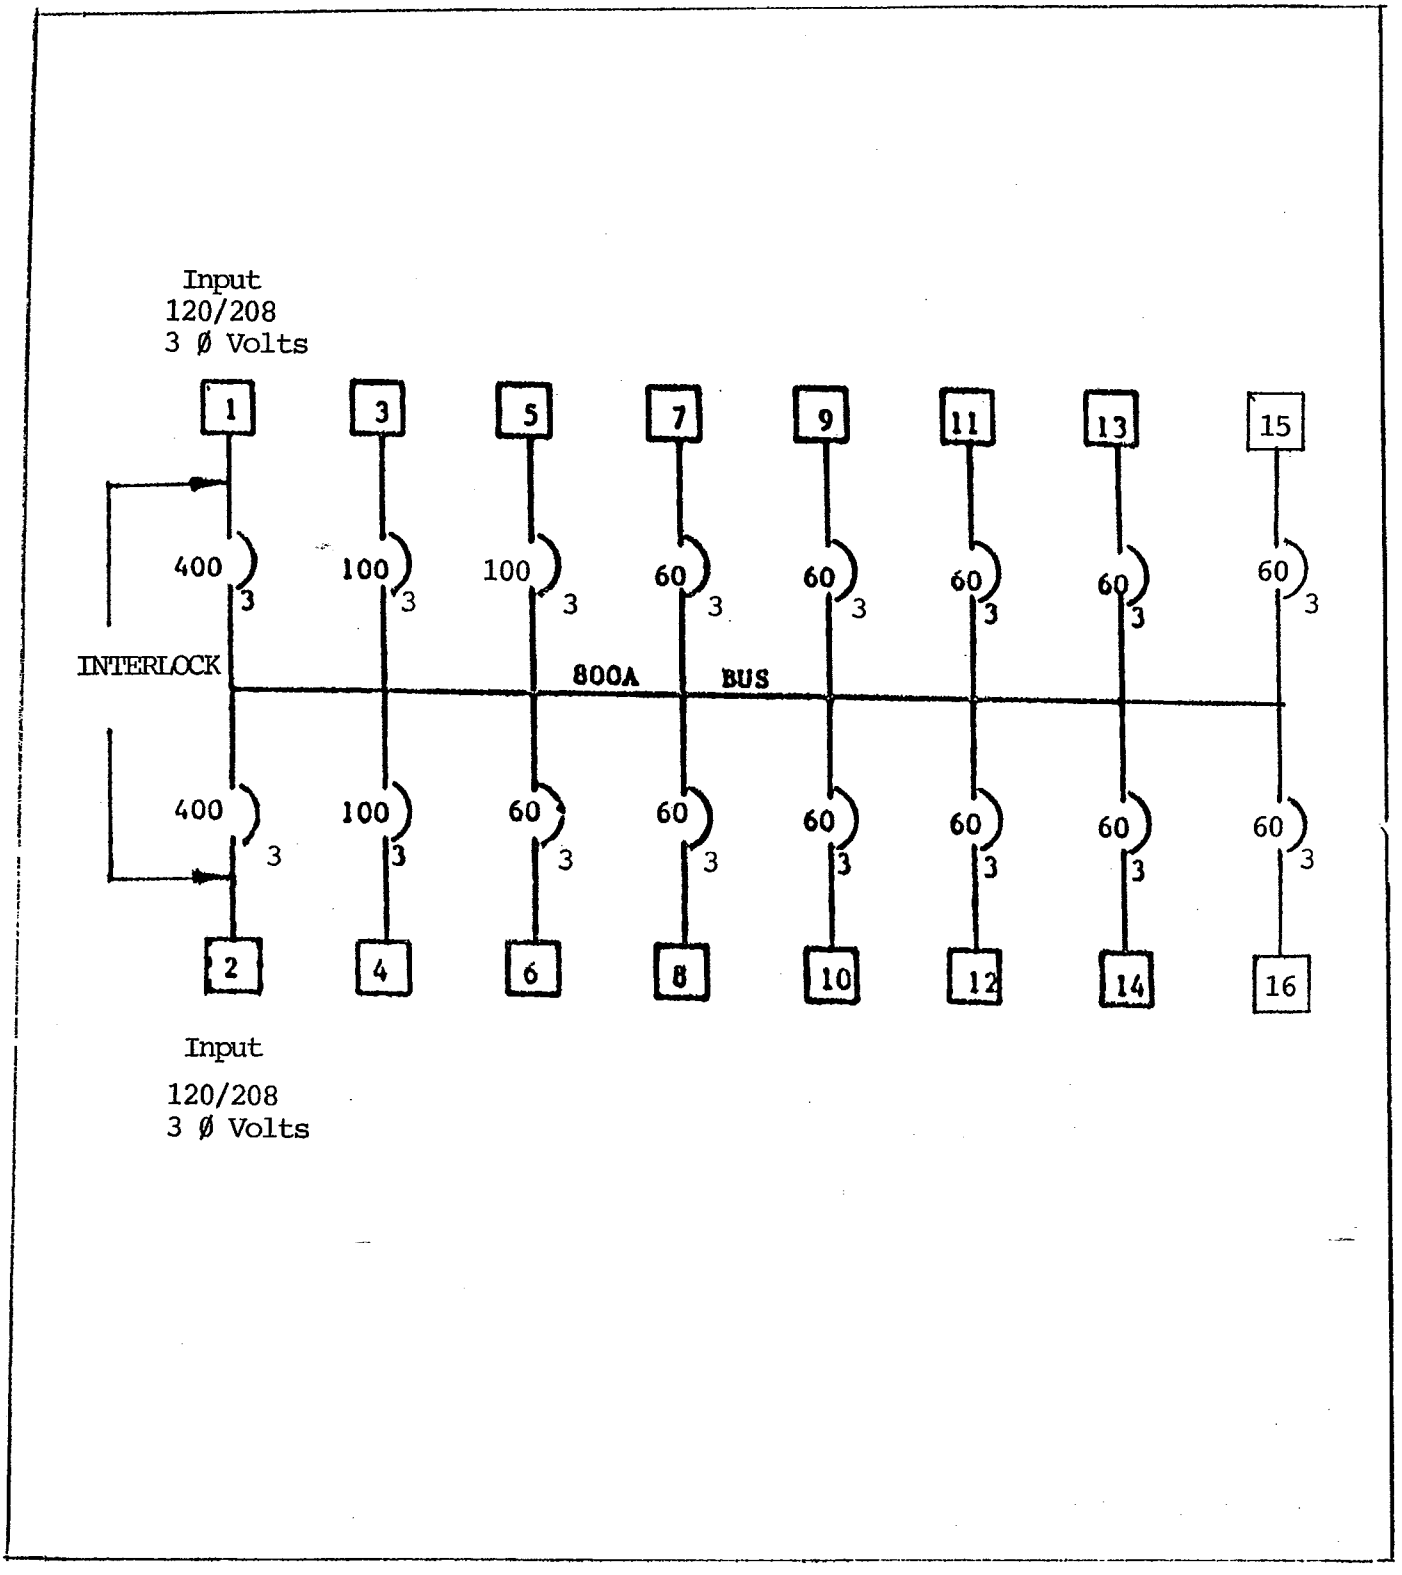


FIGURE 1. Single-line wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:00Z
Check the source to verify that this is the current version before use.

An interlock bar shall be provided between the two main breakers to preclude both breakers from being in the "on" position at the same time. Interlocking of circuit breakers shall be accomplished through a mechanical interlock. Interlocking shall be of the break before make type; of two interlocked circuits, one cannot be made (circuit closed or energized) until the other is first broken (circuit open or de-energized). Interlocking between the first circuit breaker and the second circuit breaker shall be provided to preclude the first circuit breaker from being closed when the second circuit breaker is closed, and to preclude the second circuit breaker from being closed when the first circuit breaker closed.

TABLE I. Circuits characteristics.

Quantity	Circuit kind	Circuit breaker Pole - Ampere	Interface connector	
2	208/120V, 3 phase, 5W	3P-400A (Main)	Input, terminals	
4	208/120V, 3 phase, 5W	3P-100A	MS90555C44412S	1/
10	208/120V, 3 phase, 5W	3P-60A	MS90555C32412S	1/

1/ Connector designations are military part numbers for military type connectors conforming to MIL-C-22992.

TABLE II. Connector assignment and connector terminal wiring.

Circuit	Function	*Connector type	Connector terminal wiring/color code: Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral White wire	Ground green (bare) wire
1	Input	Pressure type, dual terminal lugs	T1	T2	T3	T0	G
2	optional input	4/0 AWG to 300 MCM	P1	P2	P3	P0	G
3,4,5,6	Branch	MS90555C44412S	A	B	C	N	G
7,8, 9,10,11 12,13,14 15,16	Branch	MS90555C32412S	A	B	C	N	G

1/ Connector designations are military part numbers for military type connectors conforming to MIL-C-22992.

Source: https://assist.dla.mil -- Downloaded: 20260-20T22:00Z
Check the source to verify that this is the current version before use.

TABLE III. Required accessory equipment.

Item	Quantity	Description	Military part number
1	4	MIL-C-22992, class L, 100A wall mount socket, receptacle	MS90555C44412S
2	4	Protective cover (cap) for item 1	MS90563-7C
3	10	MIL-C-22992, class L, 60A, wall mount socket, receptacle	MS90555C32412S
4	10	Protective cover (cap) for item 3	MS90563-3C

Custodians:
Army - ME
Navy - YD
Air Force - 99

Review Activity:
Navy - MC, MS
Air Force - 80
DLA - GS

Preparing Activity:
Navy - YD

(Project 6110-0335-07)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T22:00Z
Check the source to verify that this is the current version before use.