2.1310

MIL-C-38159A(USAF)
1 September 1967
SUPERSEDING
MIL-C-38159 (USAF)
2 October 1963

MILITARY SPECIFICATION

CONNECTORS, ELECTRIC, RAMP POWER, 416/240 VOLTS

1. SCOPE

1.1 This specification covers the requirements for molded rubber, male and female connectors for 416/240-V ramp power. (See 6.3.1, 6.3.2, and 6.3.3.)

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issue in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

SPECIFICATIONS

Federal

QQ-B-626	Brass, Leaded and Non-Leaded, Rods, Shapes, Forgings and Flat Products With Finished Edges (Bars, Flat Wire and Strips)
QQ-S-365	Silver Plating, Electrodeposited, General Requirements For
PPP-B-636	Box, Fiberboard
PPP-T-60	Tape, Pressure Sensitive Adhesive, Waterproof - For Packaging
PPP-T-76	Tape, Pressure-Sensitive Adhesive Paper, Water Resistant, (For Carton Sealing)

Military

MIL-P-116	Preservation, Methods of
MIL-T-5624	Turbine Fuel, Aviation, Grades JP-4 and JP-5
MIL-L-7808	Lubricating Oil, Aircraft Turbine Engine, Synthetic Base

STANDARDS

Military

MIL-STD-100	Engineering Drawing Practices
MIL-STD-105	Sampling Procedures and Tables for Inspection by Attributes
MIL-STD-129	Marking for Shipment and Storage
MIL-STD-130	Identification Marking of U.S. Military Property
MIL-STD-143	Specifications and Standards, Order of Precedence for the Selection of

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

MIL-STD-202	Test Methods for Electronic and Electrical Component Parts
MIL-STD-810	Environmental Test Methods for Aerospace and Ground Equipment
MIL-STD-831	Test Reports, Preparation of
MS27265	Connector, Plug, Electrical - Ramp Power, 416/240 Volts, Male
MS27285	Connector, Plug, Electrical - Ramp Power, 416/240 Volts, Female
MS27567	Dummy Connector, Electrical, Male
MS27568	Dummy Connector, Electrical, Female
MS33586	Metals, Definition of Dissimilar

(Copies of specifications, standards, drawings, and publications required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publication. The following document forms a part of this specification to the extent specified herein. Unless otherwise indicated, the issue in effect on date of invitation for bids or request for proposal shall apply.

American Society For Testing and Materials

Standard D735 Elastomer Compounds For Automotive Applications

(Applications for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, Pennsylvania 19103.)

3. REQUIREMENTS

3.1 Preproduction. This specification makes provisions for preproduction testing.

3.2 Selection of specifications and standards. Specifications and standards for necessary commodities and services not specified herein shall be selected in accordance with MIL-STD-143.

3.3 Materials

3.3.1 Fungusproof materials. Materials that are nutrients for fungi shall not be used where it is practical to avoid them. When used and not hermetically sealed, they shall be treated with a fungicidal agent. However, if they will be used in a hermetically sealed enclosure, fungicidal treatment will not be necessary.

3.3.2 Metals. Metals shall be of the corrosion-resistant type or treated to resist corrosion due to fuels, salt spray, or atmospheric conditions likely to be met in storage or normal service.

3.3.2.1 Dissimilar metals. Unless protected against electrolytic corrosion, dissimilar metals shall not be used in intimate contact with each other. Dissimilar metals are defined in MS33586.

Source: https://assist.dla.mil -- Downloaded: 202640-21T11:59Z
Check the source to verify that this is the currentversion before use.

3.4 Design and construction. The male connector shall be designed and constructed in accordance with MS27265 and, the female connector in accordance with MS27285. Connector-type and grommet size(s) shall be as specified (see 6.2).

3.4.1 The connector shall be so designed and constructed that parts will not work loose in service. It shall be built to withstand the strains, jars, vibrations, and other conditions incident to shipping, storage, installation, and service.

3.4.2 Maintainability. The connector shall be fabricated to allow connection or removal of the connector to or from the cable within a 10-minute period.

3.4.3 Connector body and shell. The connector body and shell shall be fabricated of a synthetic rubber compound conforming to ASTM Standard 735, class SC510, suffix B E_3 F_2. (See 3.9.)

3.4.4 Contacts. Power contacts (see 6.3.4) and associated current-carrying parts shall be constructed of tellurium copper. Control contacts shall be constructed of free-turning brass conforming to QQ-B-626, composition 22.

3.4.5 Dummy connectors. Unless otherwise specified (see 6.2), dummy connectors conforming to MS27567 and MS27568 shall be provided to protect the male and female contacts from adverse environmental conditions when the connector is not engaged with a service receptacle.

3.4.6 Grommets. Grommets shall be made of rubber material conforming to ASTM Standard 735, class SC, suffix B E_3 F_2.

3.4.7 Set screws. All set screws shall be of corrosion-resistant steel.

3.5 Performance

3.5.1 Environmental conditions. The connector shall withstand the following environmental conditions:

a. Temperature shock

b. Humidity

c. Salt-fog

d. Immersion

e. Shock incident to service.

3.5.2 Dielectric. The connector shall withstand a potential of 2,500V rms between any contacts or between any contact and other metal parts of a mounting hardware of the connector under the humidity conditions specified in method 106 of MIL-STD-202.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

3.5.3 Temperature rise. Connectors that have been subjected to salt-fog shall indicate no more than 10 percent increase in temperature over the maximum temperature rises specified in table I for connectors tested prior to the salt-fog test.

TABLE I

Temperature Limits

Test Current (Amps)	Temperature Rise °F (Max)
7/32-inch contacts - 35	95
1/2-inch contacts - 300	95

3.5.4 Current overload. Mated connectors shall perform satisfactorily when subjected to the current overload ratings specified in table II.

TABLE II

Current Overload Ratings

Contact Size	Continuous	1/2-Hour	3-Minutes
4/0	300 amps	450 amps	800 amps

3.5.5 Horizontal engaging and disengaging forces. The forces required for engaging and disengaging female and male connectors shall be in accordance with table III.

TABLE III

Engaging And Disengaging Forces

Conditions	Connector Temperature (°F)		Engaging and Disengaging Force-Pounds
	Female	Male	
A	+75	+75	120 ±20
B	+75	-40	120 ±20
C	-40	+75	120 ±20

3.5.6 Female connector power contact strength. The female connector power contacts shall withstand internal forces caused by a moment of 12 ±1/2 lb ft (see 6.4). These internal moments shall not reduce the horizontal engaging forces specified in 3.5.5 by more than 10 percent.

Source: https://assist.dla.mil -- Downloaded: 202640-21T11:59Z
Check the source to verify that this is the currentversion before use.

3.5.7 Male and female connector contact mounting strength. The male and female connector contacts shall withstand the following torques in either direction:

a. Power contacts - 14 lb ft

b. Control contacts - 3 lb ft

3.5.8 Endurance. The male and female connectors shall withstand 575 cycles of engaging and disengaging without increasing the electrical resistance of the connectors beyond the contact resistance specified in table IV.

TABLE IV

Contact Resistance

Contact Size	Test Current (amps)	Voltage Drop (mv)
4/0	300	40

3.6 Part numbering of interchangeable parts. All parts having the same manufacturer's part number shall be functionally and dimensionally interchangeable. The item identification and part number requirements of MIL-STD-100 shall govern the manufacturer's part numbers and changes thereto.

3.7 Dimensions. The dimensions of the connectors shall be as specified on the applicable MS drawing.

3.8 Weights. The maximum weights of the connectors shall not exceed the following:

a. Male - 11 pounds

b. Female - 11 pounds.

3.9 Color. The color of the connector body and shell shall be black.

3.10 Finishes and protective coatings

3.10.1 Metal parts. All metal current-carrying parts shall be silver-plated in accordance with QQ-S-365, type III, .0002/.0004 coverage.

3.11 Contact identification. Contacts shall be permanently identified by molded markings on both the mating and cable ends of the inserts (see 6.3.5). The markings shall be as shown on the applicable MS drawing.

Source: https://assist.dla.mil -- Downloaded: 202610-21T11:59Z
Check the source to verify that this is the current version before use.

3.12 Identification of product. Equipment, assemblies, and parts shall be marked for identification in accordance with MIL-STD-130.

3.13 Workmanship. The connector, including all parts and accessories, shall be finished in a thoroughly workmanlike manner. Particular attention shall be given to accuracy of dimensions, marking of parts and assemblies, removal of burrs and sharp edges, and removal of foreign material during and after final assembly.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified, the supplier may utilize his own facilities or any commercial laboratory acceptable to the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.2 Classification of tests. The inspection and testing of the connector shall be classified as follows:

a. Preproduction testing . . . . . See 4.4

b. Acceptance tests . . . . . See 4.5.

4.3 Test conditions

4.3.1 Atmospheric conditions. Unless otherwise specified, all tests shall be conducted under any combination of the following standard conditions:

a. Temperature 77° ±4°F

b. Relative humidity 50 ±5 percent

c. Barometric pressure 30 inches Hg ±5 percent.

4.3.2 Apparatus

4.3.2.1 Test apparatus for contact strength test. A contact extension device shall be provided for attachment of the cable end of the female contacts. This extension shall allow for a weight to hang a suitable distance behind the front face of the female connector to yield the moment specified in 4.6.4.

4.3.2.1.1 Special apparatus. Where testing of a male or female portion of the connector is to be accomplished separately, special apparatus shall be devised to facilitate tests where mating capability must be verified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

4.4 Preproduction testing

4.4.1 Test samples. The test samples shall consist of two complete connector assemblies (male and female) representative of the production equipment. The samples shall be identified with the manufacturer's own part number and any additional information required by the letter of authorization.

4.4.2 Test report. After the preproduction tests are completed, three complete copies of a test report in accordance with MIL-STD-831 shall be supplied to the procuring activity.

4.4.2.1 Reliability and maintainability information. The following information shall be included as an attachment accompanying the preproduction test report (same quantity and quality of copies) or shall be included as part of that report:

a. All failure, maintenance, and other events recorded shall be identified by accumulated operating cycles in the test procedure as appropriate. Test conditions during the failures or irregular operations identified shall be recorded.

b. Description of the engineering reasoning and of any tests conducted to determine assignable causes for all failures and irregular operations identified.

c. Description of the engineering reasoning verifying corrections made, to be made on production items, or proposed to be made that substantiate the predicted effectiveness of those corrections.

d. Test activity or contractor comments on item features or requirements that, if modified, should improve the item.

e. Test activity or contractor comments on field conditions on procedures to be avoided or cultivated to increase the reliability and useful life of the item.

f. Estimates (±5 percent of actual experienced) or manhours required for each maintenance and servicing action during the tests. A brief description of the qualifications and experience of the personnel involved shall be included and shall be adequate to allow comparison to the personnel anticipated in similar fieldwork.

4.4.3 Preproduction tests. The preproduction tests shall consist of all tests described under 4.6.

4.5 Acceptance tests. The acceptance tests shall consist of the sampling tests.

4.5.1 Sampling tests

4.5.1.1 MIL-STD-105. Connectors shall be selected at random in accordance with MIL-STD-105 and subjected to the tests listed below and described under 4.6. The AQL shall be 1.0 for major defects and 4.0 for minor defects. Major defects shall be

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

those which interfere with the mating interchangeability of connectors and their electrical functioning. Minor defects shall be those that are objectional, but that do not render the connector incapable of meeting performance requirements. Table V may be used in defining defects:

a. Examination of product

b. Dielectric test

c. Horizontal engaging and disengaging forces.

4.6 Test methods

4.6.1 Examination of product. Connectors shall be visually examined for workmanship, cleaning, identification and operational marking, and for evenness of finishing. The connector shall also be examined for conformance to the applicable MS drawing.

4.6.2 Dielectric test. Unmated connectors shall be subjected to the humidity exposure specified in method 106 of MIL-STD-202. After the tenth and final cycle, the chamber shall be maintained at the end-of-cycle conditions for the period necessary to take final measurements. Connectors shall be tested at 2,500V rms in accordance with method 301 of MIL-STD-202. For this test, the connectors shall be mounted on grounded conducting plates and the potential applied between each contact and the grounded plate and between each contact and all adjacent contacts.

4.6.3 Horizontal engaging and disengaging forces. A male connector shall be rigidly clamped and mounted in a horizontal attitude to accept counterpart female connectors. Female connectors shall then be positioned in a test rig to allow engagement with the male connectors. The connectors shall be alternately engaged and disengaged at least 50 times under standard atmospheric conditions. Measurement shall be taken of the force required for full engagement and disengagement. During temperature shock testing (see 4.6.7.5), the connectors when removed from the cold chamber after stabilizing at -40°F and with no preheating, shall be subjected to engagement tests to demonstrate compliance with conditions B and C of 3.5.5. The connectors shall be engaged and disengaged three times only during this test.

4.6.4 Female power contact strength. The female contacts shall be tested by hanging a weight on the rear of the specially constructed female test contact (see 4.3.2.1.) with a male contact inserted to a depth of 2.250 ±0.062 inch from the face of the female connector. The weight shall hang free at a distance that will yield a moment of 12 ±1/2 lb ft. The moment shall be calculated using a point located at the tip of the inserted male contact as the fulcrum. At the completion of the contact strength, the engaging forces test specified in 4.6.3 shall be repeated. The engaging forces shall not be reduced by more than 10 percent as a result of this test.

4.6.5 Male and female contact mounting strength. With the connector rigidly clamped and mounted, torque shall be applied as specified in 3.5.7. The torque shall be not less than that specified in 3.5.7.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

TABLE V

Defects

Major	Minor
Inability to mate with counterpart	Poor exterior finish
Incorrect contact construction	Molding flash
Poor contact finish	Incorrect materials that have complied under performance tests
Poor vulcanization	Incorrect exterior or outline dimensions not preventing engagement or mounting
Incorrect dimensions which effect mating	
Burrs capable of cutting personnel	
Incorrect marking	
Contacts missing	
Missing socket spring	
Material incorrect	
Other design and construction not listed minor	
Other workmanship not listed minor	
Failure of any test specified under 4.6	

Source: https://assist.dla.mil -- Downloaded: 202610-21T11:59Z
Check the source to verify that this is the currentversion before use.

4.6.6 Current overload. A continuous current cycle of 300 amps for 1 hour, 450 amps for 1/2 hour, and 800 amps for 3 minutes shall be passed simultaneously through all mated contacts in the connector, except the control contacts. After this test, the connectors shall be visually inspected for damage.

4.6.7 Environmental tests

4.6.7.1 Temperature shock. A male and female connector shall be subjected to temperature shock in accordance with MIL-STD-810, method 503, procedure I. There shall be no special mounting.

4.6.7.2 Salt-fog. A male and female connector shall be subjected to salt-fog in accordance with MIL-STD-810, method 509, procedure I (see 4.6.8).

4.6.7.3 Humidity. A male and female connector shall be subjected to humidity in accordance with MIL-STD-202, method 106 (see 4.6.2).

4.6.7.4 Immersion. An unmated female connector shall be immersed in each of the following fluids as indicated. The connector shall then be wiped free of fluids and subjected to the engaging and disengaging test specified in 4.6.3.

a. Aircraft lubricating oil conforming to MIL-L-7808 for 20 hours

b. Grade JP-4 turbine fuel conforming to MIL-T-5624 for 20 hours.

4.6.7.5 Shock. The connectors shall be subjected to 15 free fall drops to a hard, level concrete surface or runway as shown on figure 1. The drops shall be from a height of 6 feet with the connector attached to an insulated cable containing four 4/0 and two AWG No. 12 conductors, 10 feet in length. The connector shall not crack or fracture as a result of this test. Immediately following this test, the connectors shall be subjected to the overload test specified in 4.6.6.

4.6.8 Temperature rise. Immediately following the salt-fog test specified in 4.6.7.2, mated male and female connectors shall be connected to a power supply and circuitry as needed to pass the requirements specified in 3.5.3. The test current shall be applied after the first mating action of the connectors under test.

4.6.9 Endurance. A male connector shall be rigidly clamped and mounted in a horizontal attitude to accept a counterpart female connector. The female connector shall be positioned in a test rig to allow engagement with the male connector. The connectors shall be dry and shall be alternately engaged and disengaged for 575 cycles under standard atmospheric conditions (simulating one engage and disengage per day for approximately 3 years). One engagement and disengagement of a connector constitutes one cycle. During the endurance test, the contact resistance shall be measured at the end of every 25 cycles by passing a current of 300 amps through each contact as specified in table IV. A millivolt drop in excess of 40 mv shall be cause for rejection. The connectors used for this test shall not be used for any other test.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

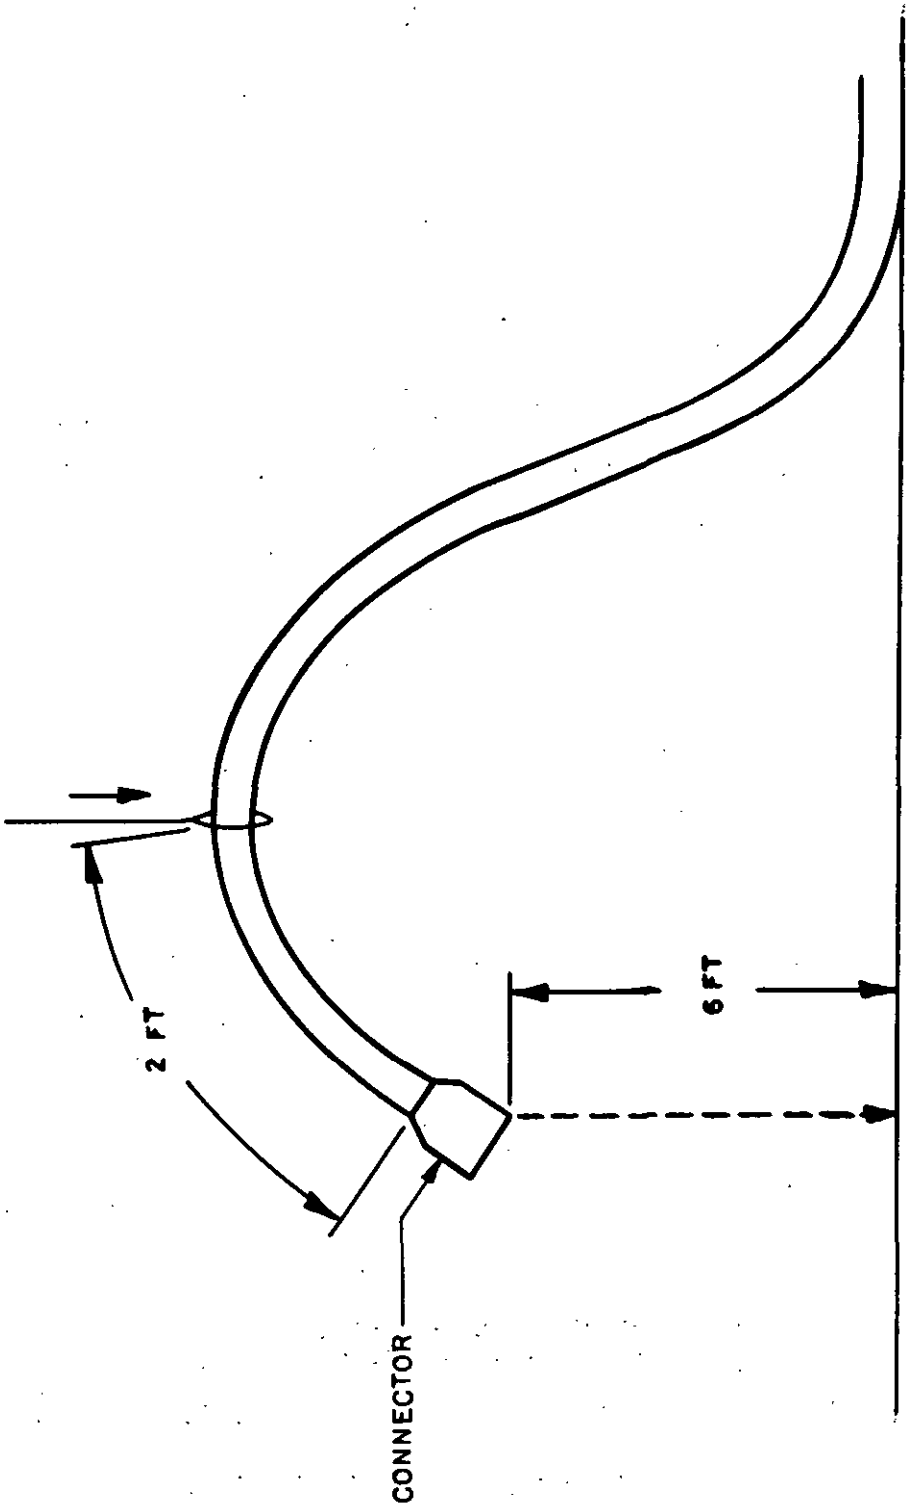


FIGURE 1. Connector Shock Test Setup

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

4.6.10 Reliability demonstration and test. Satisfactory completion of all tests specified herein demonstrates compliance with the quantitative reliability requirements of this specification.

4.6.11 Maintainability verification. Verification of the maintainability requirements as specified in 3.4.2 shall be demonstrated during three operations of assembly and disassembly.

4.7 Inspection of preparation for delivery. Sample items and packs shall be selected and inspected in accordance with MIL-P-116 to verify conformance to the requirements specified in section 5 of this specification.

5. PREPARATION FOR DELIVERY

5.1 Preservation and packaging. Preservation and packaging shall be level A or C, as specified (see 6.2).

5.1.1 Level A

5.1.1.1 Cleaning. Connectors shall be cleaned in accordance with MIL-P-116, process C-1.

5.1.1.2 Drying. Connectors shall be dried in accordance with MIL-P-116.

5.1.1.3 Preservative application. None required.

5.1.1.4 Unit packaging. Unless otherwise specified, each connector shall be individually packaged in accordance with MIL-P-116, submethod IA-8, insuring compliance with the general requirements paragraph under methods of preservation (unit protection) and the physical protection requirements paragraph therein. Each packaged connector shall be placed in a close-fitting container conforming to PPP-B-636, type CF, class domestic, variety SW; grade 125, style optional. Box closure shall be as specified in the appendix of PPP-B-636 under method I for domestic boxes.

5.1.2 Level C. Each connector shall be individually packaged in a manner that will afford adequate protection against corrosion, deterioration, and physical damage during shipment from the supply source to the first receiving activity. This package may conform to the supplier's commercial practice for retail distribution when it meets the requirements of this level.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2).

5.2.1 Level A. The packaged connectors shall be packed in weather-resistant fiberboard containers conforming to PPP-B-636, style optional, special requirement. In lieu of the closure and waterproofing requirements in the appendix of PPP-B-636, closures and waterproofing shall be accomplished by sealing all seams, corners, and

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

manufacturer's joint with waterproof tape, 2 inches minimum width, conforming to PPP-T-60, class 1, or PPP-T-76. Banding (reinforcing requirements) shall be applied in accordance with the appendix to PPP-B-636, using nonmetallic or tape banding only.

5.2.2 Level B. Connectors, packaged as specified in 5.1.1.5, shall require no additional packing for shipment.

5.2.3 Level C. The packaged connectors shall be packed in a shipping container in a manner that will afford adequate protection against damage during direct shipment from the supply source to the first receiving activity. This pack shall conform to the applicable carrier rules and regulations and may be the supplier's commercial practice when it conforms to the requirements of this level.

5.3 Marking. In addition to any special marking required by the contract or order (see 6.2), each unit package, supplementary, intermediate, and exterior container shall be marked in accordance with MIL-STD-129.

5.4 General. Exterior containers shall be of minimum tare and cube consistent with the protection required and shall contain equal quantities of identical stock-numbered items to the greatest extent possible.

5.5 Inspection. Inspection of military packaging shall be in accordance with MIL-P-116.

6. NOTES

6.1 Intended use. The male and female connectors covered by this specification are intended for use with ground support and base facility equipment (ramp or wall-mounted outlets) requiring 416/240V.

6.2 Ordering data. Procurement documents should specify the following:

a. Title, number, and date of this specification

b. Nomenclature, MS, and dash number of connectors

c. When dummy connectors as specified in 3.4.5 are not required

d. Applicable levels of preservation, packaging, and packing (see 5.1 and 5.2)

e. Special shipment marking (see 5.3)

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

6.3 Definitions. For the purpose of this specification, the following definitions will apply:

6.3.1 Connector. Connector is defined as a male or female connector. The term mated connector refers to a male and female connector in the engaged position.

6.3.2 Male connector. Male connector is defined as that portion of the mated connector assembly which has pin contacts.

6.3.3 Female connector. Female connector is defined as the connector which has socket contacts.

6.3.4 Power contacts. Power contacts are defined as pins and sockets on the intermating power current-carrying part of the connector.

6.3.5 Insert. An insert is the insulated part (body) of the connector in which the contacts are arranged.

6.4 Abbreviations. In order to save space and to avoid the spelling out of repetitious words and phrases, the following abbreviations have been used in the text of this specification:

amp	Ampere
Hg	Mercury
lb ft	Pound feet
mv	Millivolt
rms	Root mean square

6.5 Asterisks are not used in this revision to identify changes with respect to the previous issue, due to the extensiveness of the changes.

Custodian:
Air Force - 11

Preparing activity:
Air Force - 11

Reviewers:
Air Force - 82, 85

*U.S. GOVERNMENT PRINTING OFFICE: 1967-301-511/1315

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.

SPECIFICATION ANALYSIS SHEET

Form Approved
Budget Bureau No. 119-R004

INSTRUCTIONS

This sheet is to be filled out by personnel either Government or contractor, involved in the use of the specification in procurement of products for ultimate use by the Department of Defense. This sheet is provided for obtaining information on the use of this specification which will insure that suitable products can be procured with a minimum amount of delay and at the least cost. Comments and the return of this form will be appreciated. Fold on lines on reverse side, staple in corner, and send to preparing activity *(as indicated on reverse hereof)*.

SPECIFICATION

ORGANIZATION *(Of submitter)* | CITY AND STATE

CONTRACT NO. | QUANTITY OF ITEMS PROCURED | DOLLAR AMOUNT
$

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE SPECIFICATION CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES.

2. COMMENTS ON ANY SPECIFICATION REQUIREMENT CONSIDERED TOO RIGID

3. IS THE SPECIFICATION RESTRICTIVE?

☐ YES ☐ NO IF "YES", IN WHAT WAY?

4. REMARKS *(Attach any pertinent data which may be of use in improving this specification. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity)*

SUBMITTED BY *(Printed or typed name and activity)* | DATE

DD, FORM 1 APR 63 1426 REPLACES NAVSHIPS FORM 4863, WHICH IS OBSOLETE C-8279

Source: https://assist.dla.mil -- Downloaded: 202610-21T11:59Z
Check the source to verify that this is the current version before use.

FOLD

SEG (SEPS)
WRIGHT-PATTERSON AFB, OHIO

POSTAGE AND FEES PAID

UNITED STATES AIR FORCE
OFFICIAL BUSINESS

Commander
Systems Engineering Group
ATTN: SEPS
Wright-Patterson AFB, Ohio

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T11:59Z
Check the source to verify that this is the current version before use.