INCH-POUND

MIL-DTL-53126/3A

16 OCTOBER 2012
SUPERSEDING
MIL-E-53126(ME)
20 April 1992

DETAIL SPECIFICATION SHEET
POWER DISTRIBUTION, ILLUMINATION SYSTEMS, ELECTRICAL DISTRIBUTION SYSTEM, 40 AMPS/PHASE (A/P)

This specification is approved for use within US Army Research Development and Engineering Command, Communications and Electronics Research and Development Center, Product Realization Directorate, Department of the Army and is available for use by all Departments and Agencies of the Department of Defense.

The requirement for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-53126.

1. SCOPE

1.1. Scope. This specification sheet covers the detail requirements for the Power Distribution Illumination Systems Electrical (PDISE), Type III, model: M40.

2. APPLICABLE DOCUMENTS

2.1. Drawings. The following Government drawings form a part of this specification sheet to the extent specified herein. Unless otherwise specified, the issues are those cited in the solicitation.

DRAWING#	NOMENCLATURE	DRAWING #	NOMENCLATURE
CECOM & PM-MEP Drawings - Cage Code: 97403 and 30554			
13229E6353	Distribution System, Electrical, Three Phase, 40 Amperes/Phase	13229E6357	Connector Assembly 40 AMP/PH Input Plug


Distribution Statement A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

(Copies of drawings required by contractors in connection with specific acquisition functions should be obtained from: PROJECT MANAGER-MOBILE ELECTRIC POWER, 5850 Delafield Road, Bldg 324 FT BELVOIR VA 22060-5809.)

3. REQUIREMENTS

3.1. Requirements. The M40 PDISE shall be a self-contained, free-standing, man portable unit. The system shall be capable of distributing 40 A/P of electricity to all its outputs simultaneously, as specified herein.

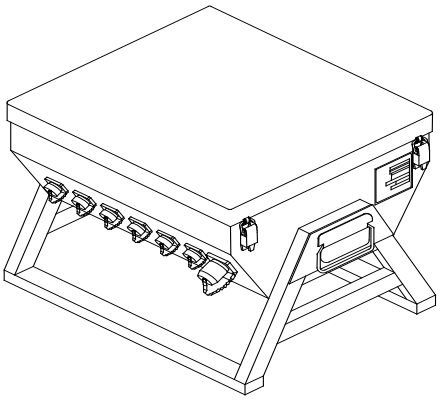

Type IV – 40 A/P distribution system

3.2. Design. The M40 PDISE shall be IAW TA13229E6353 and as specified herein.

3.2.1. Dimensions. The M40 PDISE shall not be greater than the following dimensions:

Length (Inches)	Width (Inches)	Height (Inches)
25.00	19.00	18.00

3.2.2. Weight. The M40 PDISE shall weigh no more than 50 pounds.

3.2.3. M40 PDISE Inputs. The M40 PDISE shall have a single 3-phase input capable of handling 40 A/P.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

3.2.3.1. Input circuit interrupter. The input circuit for the M40 PDISE shall be protected from overload by a properly sized circuit breaker. The circuit breaker shall act as a switch to activate/deactivate the circuit.

3.2.3.2. Input Connector. The M40 PDISE shall have a 40 ampere, three phase, male, input receptacle IAW 13229E6357.

3.2.4. M40 PDISE Outputs The M40 PDISE shall have the following output circuits and connectors:

Quantity	Output Rating	Ouput Connector P/N*
1	40Amp, 3 phase	M90556C32413P
12	20 Amp, 3 phase	M3406D16-10S

*Note: See 3.3.16.1 in MIL-DTL-53126.

3.2.4.1. Output circuit interrupters. Each output circuit shall be protected by a properly sized circuit breaker. The circuit breaker shall act as a switch to activate/deactivate the circuit.


3.2.5. Type III accessories. The unit shall be provided with the following accessories:

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

Quantity	Description	Reference*
1	Input interface cable assembly, rated at 40/60 amperes	3.3.18.1*
2	40/60 A/P cable assemblies	3.3.18.4*
3	20 A/P cable assemblies (25 ± 0.25 feet long)	3.3.18.6*
3	20 A/P cable assemblies (50 ± 0.25 feet long)	3.3.18.6*
2	Transition cable assemblies	3.3.18.8*
4	Single strap assemblies	3.3.19.2*
6	Cinching Strap	3.3.91.1*
1	Receptacle assembly	3.3.17*
1	In-Line GFCI	3.3.18.10*
1	Container	2.1


*Note: See requirement paragraph referenced MIL-DTL-53126.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

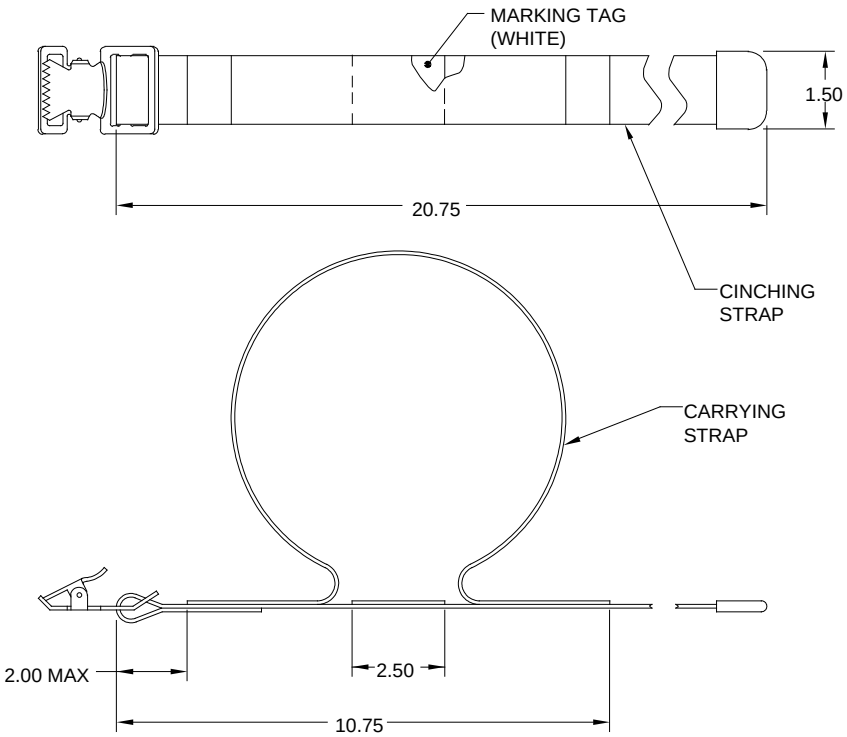

3.2.6. Wiring diagram. The circuits shall be configured as specified in the following wiring diagram:

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

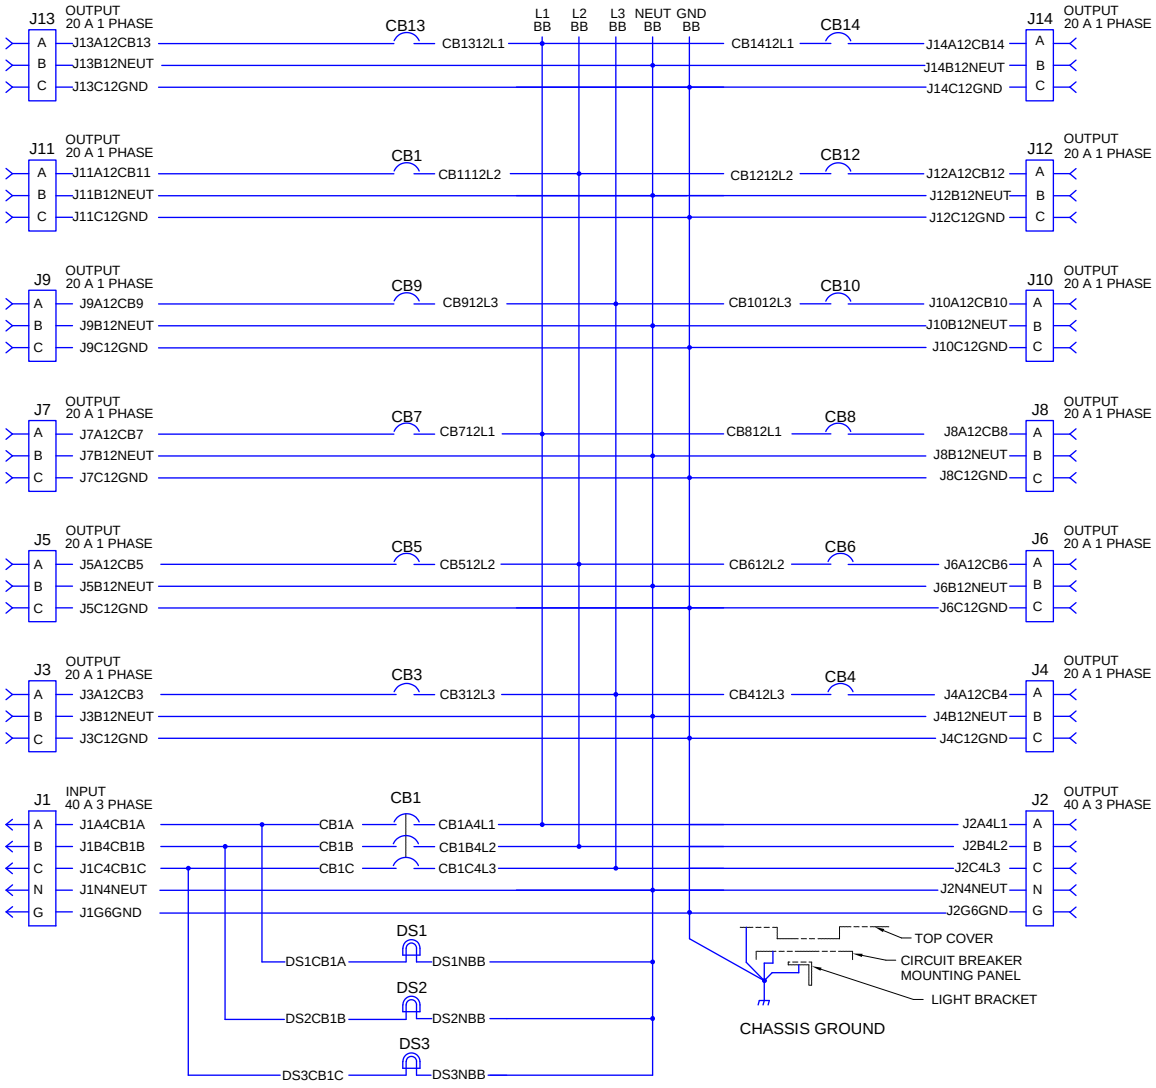

3.2.7 This specification sheet had no superseding “base”. The original publication of this specification was a performance specification that was used in-house by CR4. Since this specification is now a detailed military specification, this specification sheet is deemed necessary to capture the unique characteristics desired in the end item.

3.2.8 Changes from previous issues: Marginal notations are not used in this revision to identify changes with respect to the previous issue because this detail specification sheet although a part of the base document, was not published because it was a document with limited circulation and coordination that was used essentially by CR4.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.

Concluding Material

Custodian:

Army - CR4

Preparing Activity:

Army - CR4
(Project 6150-2012-012)

Review Activities:

DLA – GS

Note: The activities listed above were interested in this document as of the date of this document. Since organization and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T22:09Z
Check the source to verify that this is the current version before use.