
NOTICE: When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility, nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

NOTE: This drawing was approved by joint action of the Air Force and Navy Departments as the Air Force-Navy standard for this product. This drawing supersedes all antecedent standard drawings for the same product and shall become effective for the procurement of aeronautical supplies, or for use in new design, not later than 6 months after the latest date of approval shown.

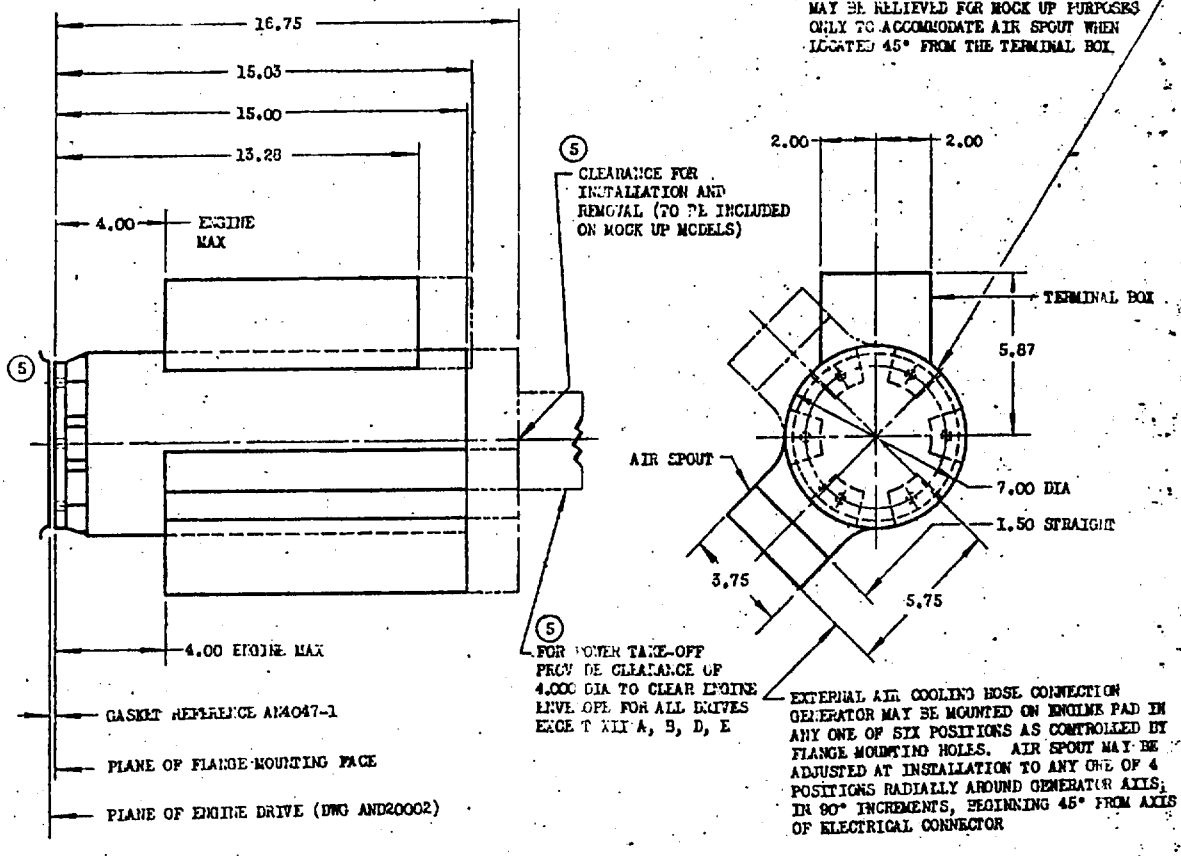


(5) REFERENCE SPECIFICATION AN-G-1.

(5) PROVIDE ACCESSORY CLEARANCE AROUND ACCESSORY MOUNTING FLANGE IN ACCORDANCE WITH DRAWING AND10262 AND AND10267. CLEARANCE SHALL BE PROVIDED TO PERMIT INSTALLATION OF GENERATOR IN AT LEAST ONE OF SIX POSSIBLE POSITIONS. CLEARANCE SHALL BE PROVIDED FOR ELECTRICAL CONNECTIONS TO TERMINAL BOX AND FOR 3.00 ID AN HOSE OR EQUIVALENT TO AIR SPOUT. DIMENSIONS IN INCHES. UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE MINIMUM CLEARANCE ON ENGINE.

APPROVED 28 Feb 42 REVISED (1) 31 Jul 45 (2) 24 Dec 46 (3) 3 Mar 47 (4) 1 Mar 49 (5) 12 Aug 49

AIR FORCE-NAVY AERONAUTICAL DESIGN STANDARD

(5) INSTALLATION CLEARANCE—TYPE XII AND TYPE XVII DRIVE (GENERATOR — POWER TAKE-OFF)

AND10305

NOT A PART NUMBER

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T14:29Z
Check the source to verify that this is the current version before use.