W-F-1814/48A
January 13, 1975
SUPERSEDING
W-F-1814/48
23 May 1974


FEDERAL SPECIFICATION SHEET

# FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS L (CURRENT-LIMITING) 600 VOLTS, 801-1200 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

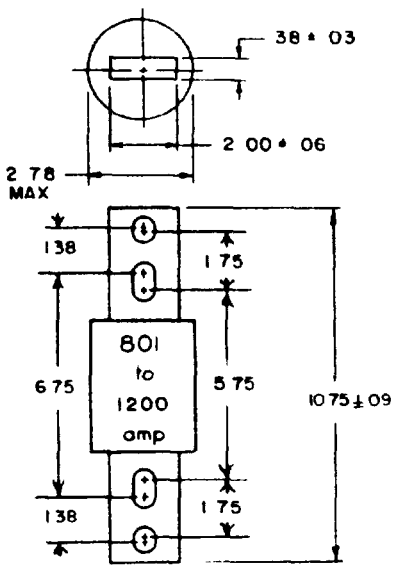


| INCHES | MM | INCHES | MM |
|---|---|---|---|
| .03 | .76 | 2.00 | 50.80 |
| 06 | 1.52 | 2 78 | 70.61 |
| .09 | 2.29 | 5 75 | 146.05 |
| 38 | 9 65 | 6 75 | 171 45 |
| 1.38 | 35.05 | 10 75 | 273 05 |
| 1.75 | 44 45 | | |

NOTES
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3 All tolerances are ±.02 unless otherwise noted
4 Slots and holes shall be 62 (15.75 mm)

Ⓐ denotes changes

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:36Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction - See figure

Physical Nonrenewable
Terminals - Knife blade type
Material - Brass, copper or copper alloy.
Strength - 20 pound-inches torque between body and knife blades.

Body
Insulating material - Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical
Voltage - 600 volts or less.
Frequency - 48 to 60 hertz.
Current - See table

Current carrying capacity - 110 percent of rated current indefinitely with temperature rise on the terminals not to exceed 65°C above the calibration temperature rise of the test equipment

Overload interrupt:
Instantaneous - Shall interrupt within 240 minutes at 150 percent of rated current
Ⓐ Time delay - In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 4 seconds

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage

Threshold ratio - 30 maximum.

Peak let-thru current - $80 \times 10^3$ amperes maximum

Maximum clearing $I^2T$ - $12 \times 10^6$ ampere$^2$ seconds.

Applicable fuseholding device: Fuseholding devices shall provide mounting holes to correspond with those in the fuse as specified. All fuses shall be bolted into fuseholding device during operation

Ⓐ Part number. See table

| Government part number | Current rating (amps) | Overload interrupt |
|---|---|---|
| WF1814/48-001 | 1000 | Instantaneous |
| -002 | 1200 | Instantaneous |
| -003 | 1000 | Time delay 1/ |
| -004 | 1200 | Time delay 1/ |

1/ Should not be considered for use in new design



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:36Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS

Army - EL
Navy - YD
Air Force - 85

Review activities

Army - FL, AT, WC
Navy -
Air Force - 80
DSA - ES
NS

User activities

Army - MU
Navy - OS
Air Force -

Preparing activity

DSA - ES

Civil Agency Coordinating Activities

AEC - AEC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0356-2)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 25 cents each.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:36Z
Check the source to verify that this is the current version before use.