[INCH-POUND]
A-A-55459A
June 6, 1995
SUPERSEDING
A-A-55459
January 25, 1994


COMMERCIAL ITEM DESCRIPTION

INTERRUPTER, GROUND FAULT, TWO-POLE, THREE-WIRE, 20-AMPERE

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for a 20-ampere ground fault interrupter. Ground fault interrupters covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

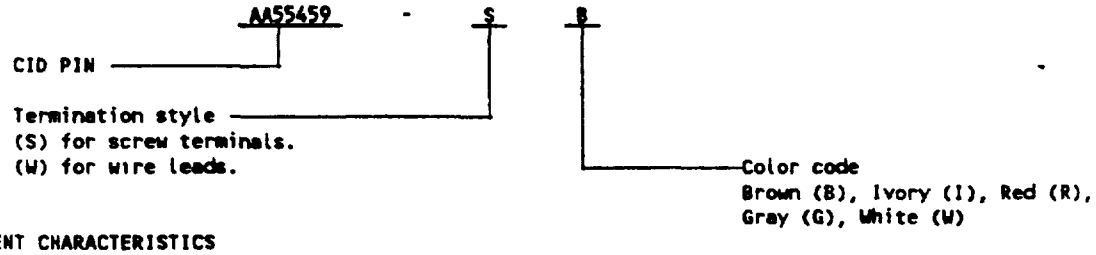

3. SALIENT CHARACTERISTICS

3.1 Ampere rating. The ampere rating shall be 20 amperes maximum.

3.2 Voltage rating. The voltage rating shall be 125 V ac maximum.

3.3 Frequency rating. The frequency rating shall be 60 Hz.

3.4 Trip threshold. This ground fault interrupter shall trip when a fault current to ground is 6 mA minimum.

3.5 Design and construction. Ground fault interrupters supplied to this CID shall be as specified herein and shall meet the requirements of UL 943 for class A ground fault interrupters.

3.6 Dimensions. Dimensions shall conform to NEMA standard WD 6 (reference NEMA configuration 5-20R) (see figure 1).

3.7 Termination style. The termination style shall be either screw terminals or wire leads.

3.8 Wire size. The maximum wire size the screw terminal connectors shall accept is number 10 AWG. The minimum wire size of the wire leads shall be number 14 AWG.


3.9 Wire lead length. The free length of the wire leads shall be 101.6 millimeters (4.0 inches) minimum. The free length of the ground lead shall be 152.4 millimeters (6 inches) minimum.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN: DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

AMSC N/A
FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

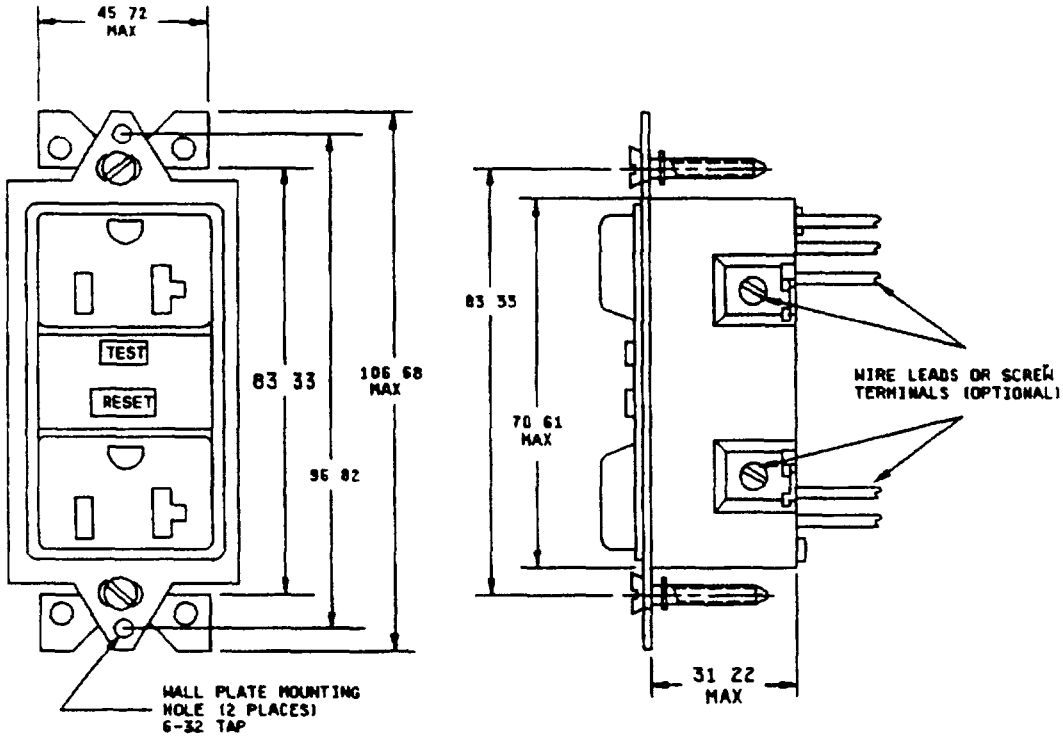

mm	Inches
31.22	1.229
45.72	1.800
70.61	2.780
83.33	3.280
96.82	3.812
106.68	4.200

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ±0.13 millimeter (.005 inch).
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.
4. Location of test and/or reset buttons optional.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

3.10 Marking. Ground fault interrupters supplied to this CID shall be marked with the manufacturer's standard commercial marking and the UL 943 listing mark.

4 QUALITY ASSURANCE PROVISIONS

4.1 Contractor certification The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

4.2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all ground fault interrupters supplied to this CID.

4.3 Market acceptability. The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b. The company must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

5. PACKAGING

5.1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

6. NOTES

6.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

6.2 Source of documents.

Other Publications

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA WD 6 - Wiring Devices - Dimensional Requirements.

(Applications for copies should be addressed to the National Electrical Manufacturers Association, 2101 L Street, N.W., Washington, DC 20037.)

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 943 - Ground-Fault Circuit-Interrupters, Standard For.

(Applications for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

6.3 Government users. To acquire information on obtaining these ground fault interrupters from the Government inventory system, contact Defense Electronics Supply Center, ATTN: DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5519, or telephone (513) 296-5106.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

6.4 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Quality assurance provisions.

c. If a bid sample is required.

d. Packaging requirements.

6.5 Suggested sources of supply. Suggested sources of supply are listed below. Additional sources will be added as they become available.

CID dash number (see table I) AA55459-	Vendor commercial PIN CAGE 04009	Vendor commercial PIN CAGE 41326	Vendor commercial PIN CAGE 71183	Vendor commercial PIN CAGE 74545
SB	GF5342	GFR5342-1	GFR53FT	GF5352A
SI	GF5342I	GFR5342-2	GFR53FT-I	GF5352IA
SR	---	---	GFR53FT-R	---
SG	GF5342GRY	GFR5342-9	GFR53FT-GRY	GF5352GYA
SW	GF5342W	GFR5342-7	GFR53FT-W	GF5352WA
WB	---	---	---	GF5362
WI	---	---	---	GF5362I
WR	---	---	---	GF5362R
WG	---	---	---	GF5362GY
WW	---	---	---	GF5362W

Vendor CAGE number	Vendor name and address
04009	Cooper Industries, Incorporated Crouse-Hinds Division Arrow-Hart Wiring Devices P.O. Box 4999 Syracuse, NY 13221-4999 (800) 628-8956
41326	General Electric Company 225 Service Avenue Warwick, RI 02886-1054 (401) 886-6290
71183	Bryant Electric, Incorporated 185 Plains Road Milford, CT 06460-2465 (203) 876-3767
74545	Hubbell, Incorporated Wiring Device Division 1613 State Street Bridgeport, CT 06605-0933 (203) 337-3302

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

6.6 Changes from previous issue. Asterisks are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project 5925-D158

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.