[INCH-POUND]
A-A-55461A
June 6, 1995
SUPERSEDING
A-A-55461
January 25, 1994


COMMERCIAL ITEM DESCRIPTION

INTERRUPTER, GROUND FAULT, TWO-POLE, THREE-WIRE, HOSPITAL GRADE, 20-AMPERE

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for a 20-ampere hospital grade ground fault interrupter. Ground fault interrupters covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

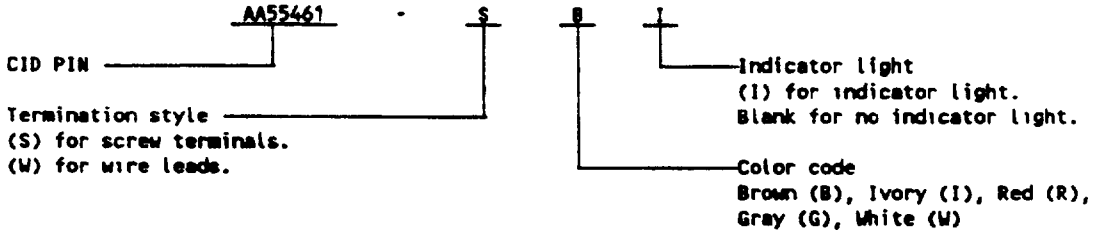

3. SALIENT CHARACTERISTICS

3.1 Ampere rating. The ampere rating shall be 20 amperes maximum.

3.2 Voltage rating. The voltage rating shall be 125 V ac maximum.

3.3 Frequency rating. The frequency rating shall be 60 Hz.

3.4 Trip threshold. This ground fault interrupter shall trip when a fault current to ground is 6 mA minimum.

3.5 Design and construction. Ground fault interrupters supplied to this CID shall be as specified herein and shall meet the requirements of UL 943 for class A ground fault interrupters and the hospital grade requirements as called out in UL 498.

3.6 Dimensions. Dimensions shall conform to NEMA standard WD 6-88 (reference NEMA configuration 5-20R) (see figure 1).

3.7 Termination style. The termination style shall be either screw terminals or wire leads.


3.8 Wire size. The maximum wire size the screw terminal connectors shall accept is #10 AWG. The minimum wire size of the wire leads shall be #14 AWG.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN: DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

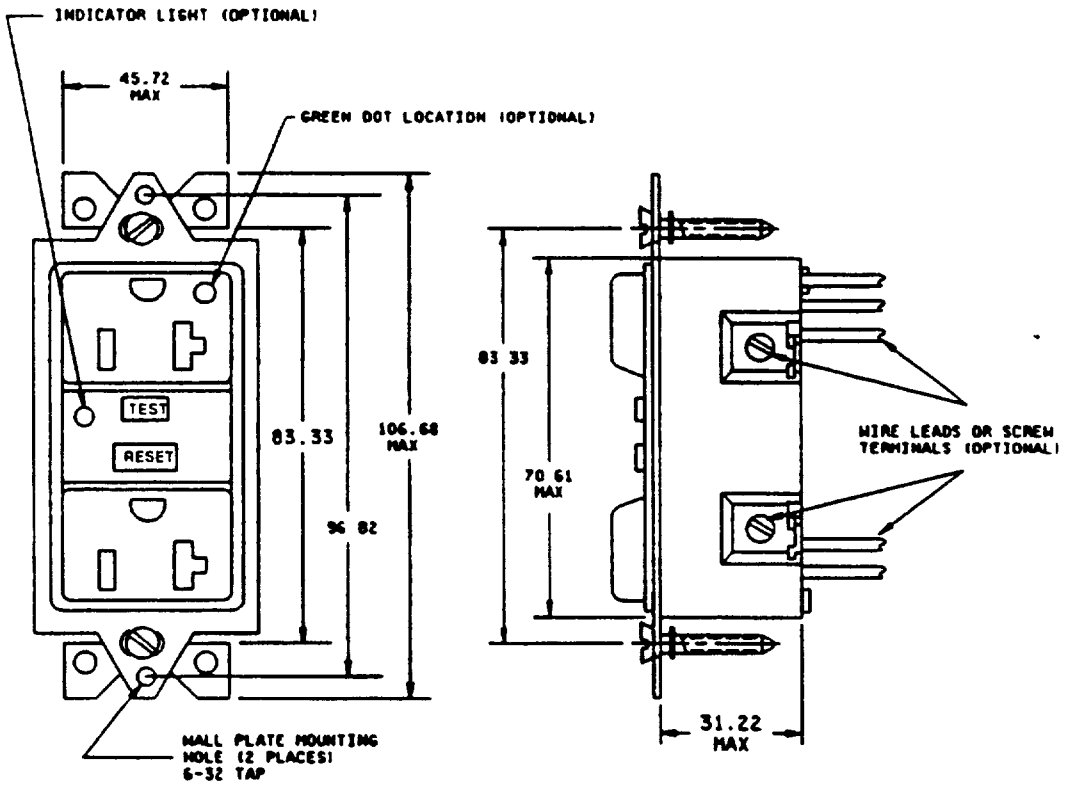

mm	Inches
31.22	1.229
45.72	1.800
70.61	2.780
83.33	3.280
96.82	3.812
106.68	4.200

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch).
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.
4. Location of test and/or reset buttons and indicator light optional.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

3.9 Wire lead length. The free length of the wire leads shall be 101.6 millimeters (4.0 inches) minimum. The free length of the ground lead shall be 152.4 millimeters (6 inches) minimum.

3.10 Indicator light. If an indicator light is provided, when lighted it shall indicate power availability to the receptacle; when unlighted it shall show the "tripped" condition of the circuit interrupter.

3.11 Marking. Ground fault interrupters supplied to this CID shall be marked with the manufacturer's standard commercial marking, the UL 943 listing mark and the UL 498 listing mark.

4. QUALITY ASSURANCE PROVISIONS

4.1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

4.2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all ground fault interrupters supplied to this CID.

4.3 Market acceptability. The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b. The company must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

5. PACKAGING

5.1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

6. NOTES

6.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

6.2 Source of documents.

Other Publications

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA WD 6 - Wiring Devices - Dimensional Requirements.

(Applications for copies should be addressed to the National Electrical Manufacturers Association, 2101 L Street, N.W., Washington, DC 20037.)

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 498 - Plugs and Receptacles, Attachment, Standard For.
UL 943 - Ground-Fault Circuit-Interrupters, Standard For.

(Applications for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

6.3 Government users. To acquire information on obtaining these ground fault interrupters from the Government inventory system, contact Defense Electronics Supply Center, ATTN: DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5519, or telephone (513) 296-5106.

6.4 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Quality assurance provisions.

c. If a bid sample is required.

d. Packaging requirements.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

6.5 Suggested sources of supply. Suggested sources of supply are listed below. Additional sources will be added as they become available

CID dash number (see table I) AA55461-	Vendor commercial PIN CAGE 04009	Vendor commercial PIN CAGE 41326	Vendor commercial PIN CAGE 71183	Vendor commercial PIN CAGE 74545
SB	---	GFR8300-1	GFR83FT	HGF8300
SI	---	GFR8300-2	GFR83FT-I	HGF8300I
SR	---	GFR8300-8	GFR83FT-R	HGF8300R
SG	---	GFR8300-9	GFR83FT-GRY	HGF8300GY
SW	---	GFR8300-7	GFR83FT-W	HGF8300W
SBI	GF8300	---	---	---
SII	GF8300I	---	---	---
SRI	GF8300RED	---	---	---
SGI	GF8300GRY	---	---	---
SWI	GF8300W	---	---	---
WB	---	---	---	GF8300
WI	---	---	---	GF8300I
WR	---	---	---	GF8300R
WG	---	---	---	GF8300GY
WW	---	---	---	GF8300W

Vendor CAGE number	Vendor name and address
04009	Cooper Industries Incorporated Crouse-Hinds Division Arrow-Hart Wiring Devices PO Box 4999 Syracuse, NY 13221-4999 (800) 628-8956
41326	General Electric Company 225 Service Avenue Warwick, RI 02886-1054 (401) 886-6290
71183	Bryant Electric Incorporated 185 Plains Road Milford, CT 06460-2465 (203) 876-3767
74545	Hubbell Incorporated Wiring Device Division 1613 State Street Bridgeport, CT 06605-0933 (203) 337-3302

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

6.6 Changes from previous issue. Asterisks are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project No. 5925-D160

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.