[INCH-POUND]
A-A-55461B
April 27, 2001
SUPERSEDING
A-A-55461A
June 6, 1995

COMMERCIAL ITEM DESCRIPTION

INTERRUPTER, GROUND FAULT, TWO-POLE, THREE-WIRE HOSPITAL GRADE, 20-AMPERE

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for a 20-ampere hospital grade fault interrupter. Ground fault interrupters covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 7.1).

AA55461	-	S	B	I
CID number		Termination style (see table I) (S) for screw terminals. (W) for wire leads.	Color code (B) Brown (I) Ivory (R) Red (G) Gray (W) White	Indicator light (I) for indicator light. Blank for no indicator light.

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Ground fault interrupters supplied to this CID shall be as specified herein and shall meet the requirements of UL 943 for class A ground fault interrupters and the hospital grade requirements as called out in UL 498 (see figure 1).

3.2. Ampere rating. The ampere rating shall be 20 amperes maximum.

3.3 Voltage rating. The voltage rating shall be 125 V ac maximum.

3.4 Frequency rating. The frequency rating shall be 60 Hz.

3.5 Trip threshold. This ground fault interrupter shall trip when a fault current to ground is 4-6 mA minimum.

Beneficial comments recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be addressed to: Defense Supply Center, Columbus, ATTN: DSCC-VAT, Post Office Box 3990, Columbus, OH 43216-5000, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

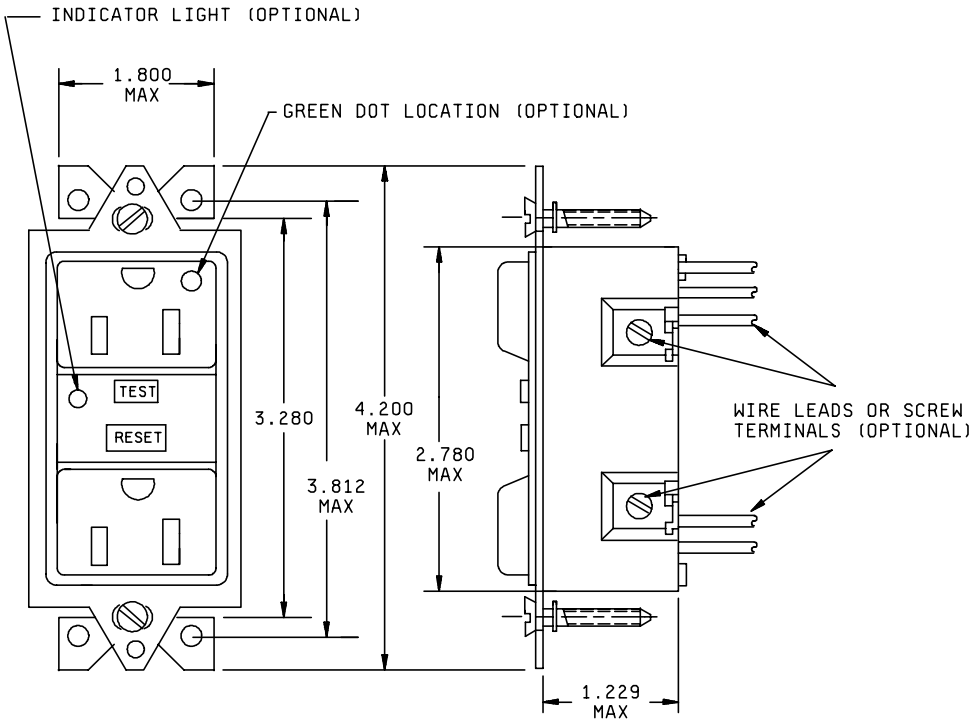

Inches	mm
1.229	31.22
1.800	45.72
2.780	70.61
3.280	83.33
3.812	96.82
4.200	106.68

NOTES:

1. Dimensions are in inches.
2. Tolerance is ±.005 inch (0.13 mm), unless otherwise specified.
3. Location of test and/or reset buttons optional and the indicator light is optional.

FIGURE 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

3.6 Dimensions. Dimensions shall conform to NEMA standard WD 6 (reference NEMA configuration 5-20R) (see figure 1).

3.7 Termination style. The termination style shall be either screw terminals or wire leads.

3.8 Wire size. The maximum wire size the screw terminal connectors shall accept is number 10 AWG. The minimum wire size of the wire shall be number 14 AWG.

3.9 Wire lead length. The free length of the wire leads shall be 101.6 millimeters (4.0 inches) minimum. The free length of the ground lead shall be 152.4 millimeters (6 inches) minimum.

3.10 Indicator light. If an indicator light is provided, when lighted it shall indicate power availability to the receptacle: when unlighted it shall show the “tripped” condition of the circuit interrupter.

3.11 Marking. Ground fault interrupters supplied to this CID shall be marked with the manufacturer’s (MFR’s) standard commercial PIN and the UL 943, and the UL 498 listing mark.

4. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

5. PRODUCT CONFORMANCE PROVISIONS.

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer’s own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b. The company must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these ground fault interrupters to DSCC under the Military Parts control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.3 Source of documents.

Other Publications

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA WD 6 - Wiring Devices - Dimensional Requirements.

(Applications for copies should be addressed to the National Electrical Manufacturers Association, 1300 North 17TH Street, Suite 1847, Rosslyn, VA 22209-3801.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 943 - Ground-Fault Circuit-Interrupters, Standard for.

(Applications for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.4 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Product conformance provisions.

c. Packaging requirements.

7.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

MFR's CAGE	MFR's name and address
04009	Cooper Industries, Incorporated Crouse-Hinds Division Arrow-Hart Wiring Devices P.O. Box 4999 Syracuse, NY 13221-4999 Phone number: (800) 628-8956 Facsimile number: (800) 628-8957 E-mail: arrow-hart@crouse-hinds.com Uniform Resource Locator (URL): www.crouse-hinds.com/arrowHart/main.cfm
41326	General Electric Company 225 Service Avenue Warwick, RI 02886-1054 Phone number: (800) 431-7867 URL: www.ge.com/wiringdevices
71183	Bryant Electric, Incorporated 185 Plains Road Milford, CT 06460-2465 Phone number: (203) 876-3600 Facsimile number: (203) 876-3675 E-mail: www.bryantelectric.com URL: www.hubbell-bryant.com
74545	Hubbell, Incorporated Wiring Device-Kellems 185 Plains Road Milford, CT 06460-2473 Phone number: (203) 882-4800 Facsimile number: (800) 255-1031 E-mail: cthompso@hubbell.com URL: www.hubbell-wiring.com

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.

7.6 Part number (P/N) supersession data. This CID supersedes the following manufacturers' P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE II. P/N supersession data.

CID dash number AA55461-	MFR's CAGE 04009	MFR's CAGE 41326	MFR's CAGE 71183	MFR's CAGE 74545
	MFR's P/N 1/	MFR's P/N 1/	MFR's P/N 1/	MFR's P/N 1/
SB	---	GFR8300-1	GFR83FT	HGF8300
SI	---	GFR8300-2	GFR83FT-I	HGF8300I
SR	---	GFR8300-8	GFR83FT-R	HG8300R
SG	---	GFR8300-9	GFR83FT-GRY	HGF8300GY
SW	---	GFR8300-7	GFR83FT-W	HGF8300W
SBI	GF8300	---	---	---
SII	GF8300I	---	---	---
SRI	GF8300RED	---	---	---
SGI	GF8300GRY	---	---	---
SWI	GF8300W	---	---	---
WB	---	---	---	GF8300
WI	---	---	---	GF8300I
WR	---	---	---	GF8300R
WG	---	---	---	GF8300GY
WW	---	---	---	GF8300W

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID PIN shown. For actual part marking requirements see 3.11.

7.7 Government users. To acquire information on obtaining these ground fault interrupters from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-CSAC, Post Office Box 3990, Columbus, OH 43216-5000, or telephone (614) 692-6920.

MILITARY INTERESTS:

Custodians:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-CC

Project 5925-0296

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:47Z
Check the source to verify that this is the current version before use.