
MILITARY SPECIFICATION SHEET

TERMINAL, CASULTY POWER, SWITCH, PORTABLE, 60-AMPERE, 500-VOLT, THREE-PHASE, ALTERNATING CURRENT, SYMBOL NUMBER 1041

The oomplate requirements for procuring the terminal switch dascribed herein shall consist of this document and the latest issue of Specification MIL-T-24381(SHIPS).

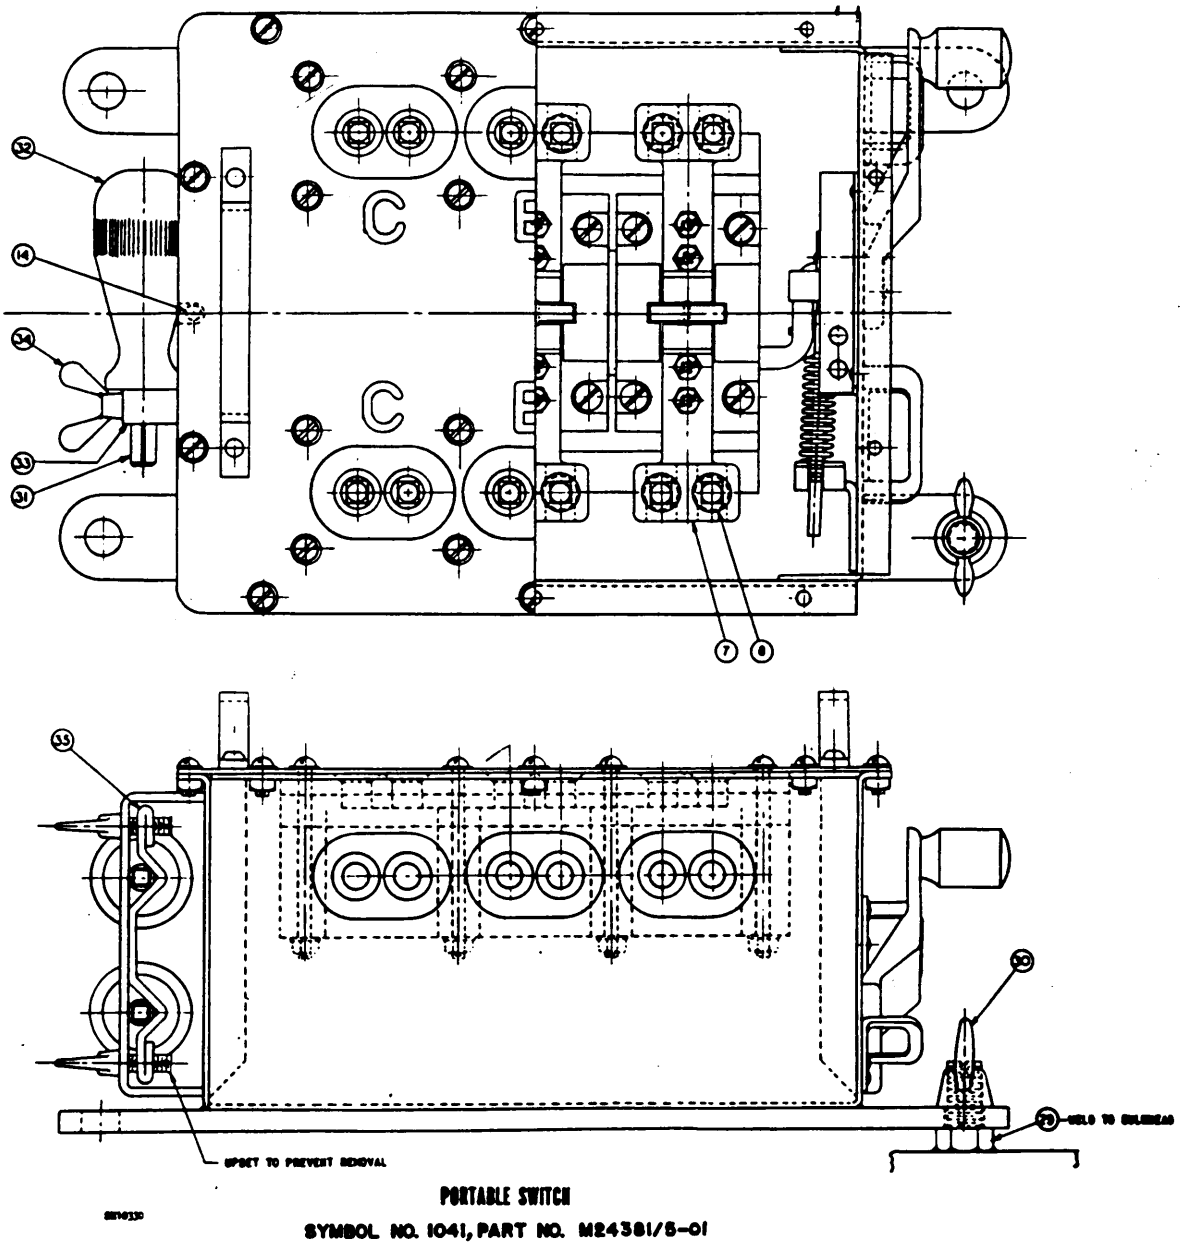



PORTABLE SWITCH
SYMBOL NO. 1041, PART NO. M24381/5-01


NOTE: Supersedes NAVSHIPS Drawing 9000-S6202-73177.

FSC 5940

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

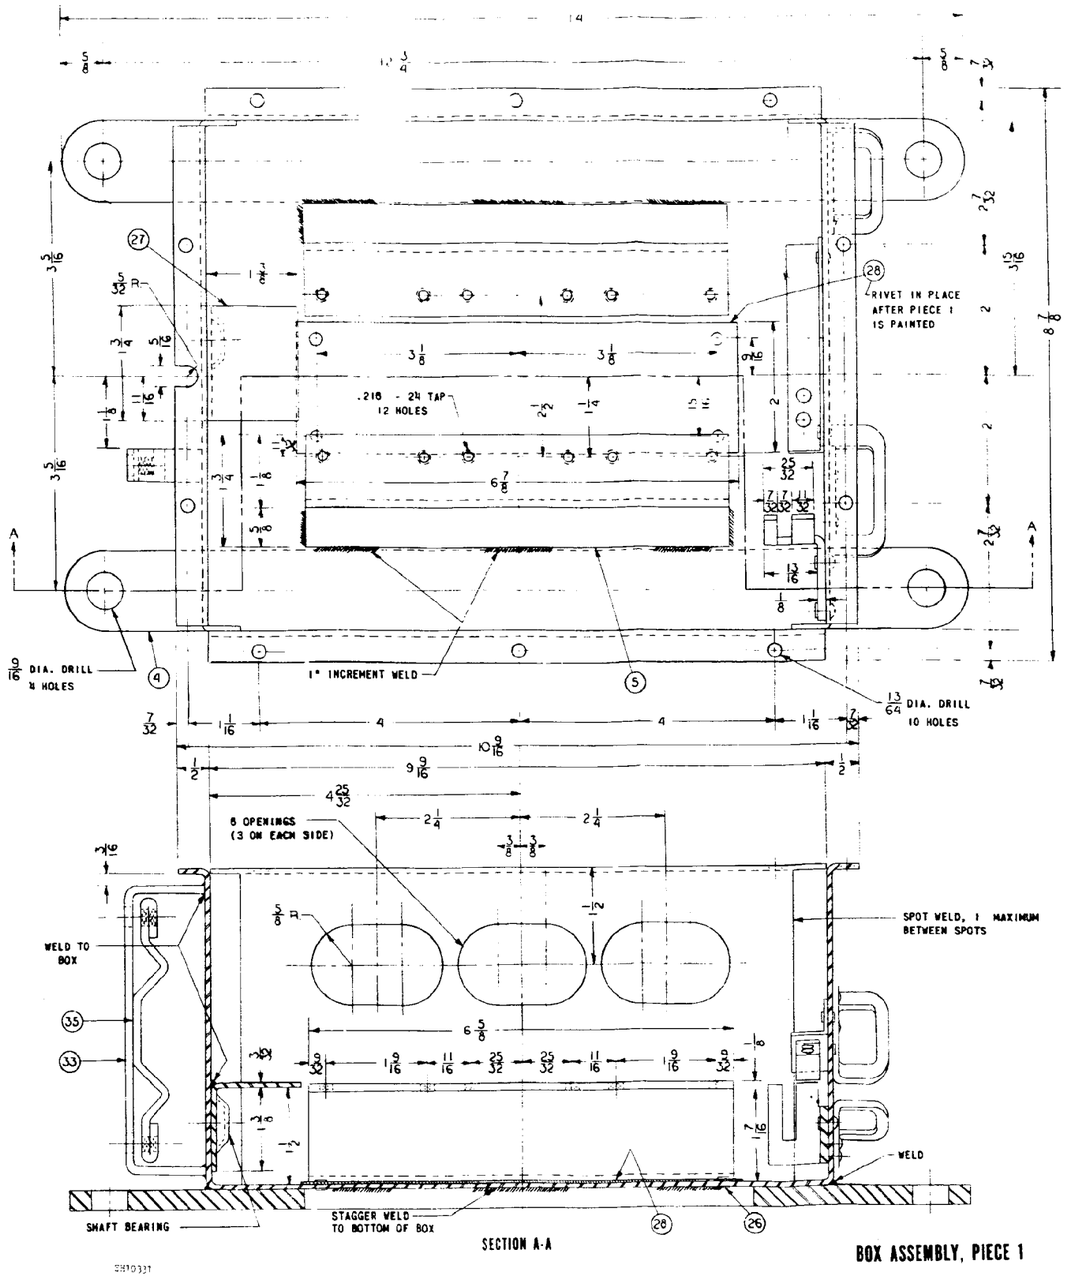

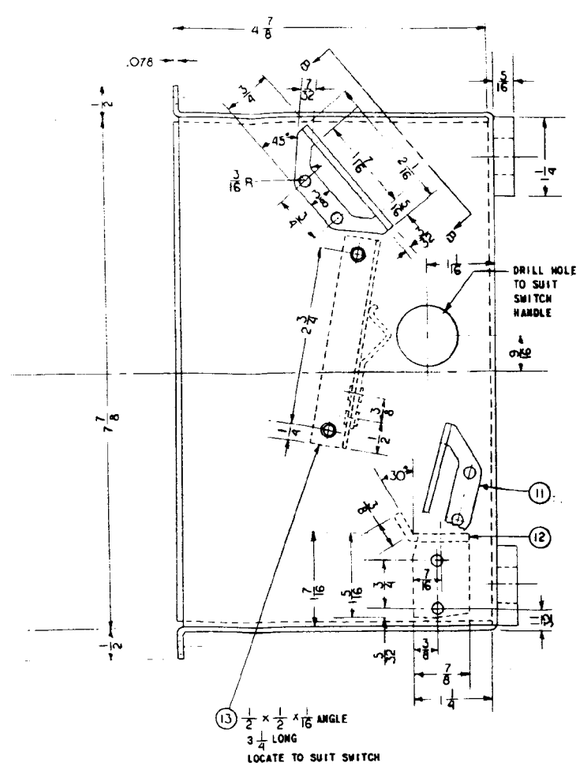





BOX ASSEMBLY, PIECE 1

5H10337


Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

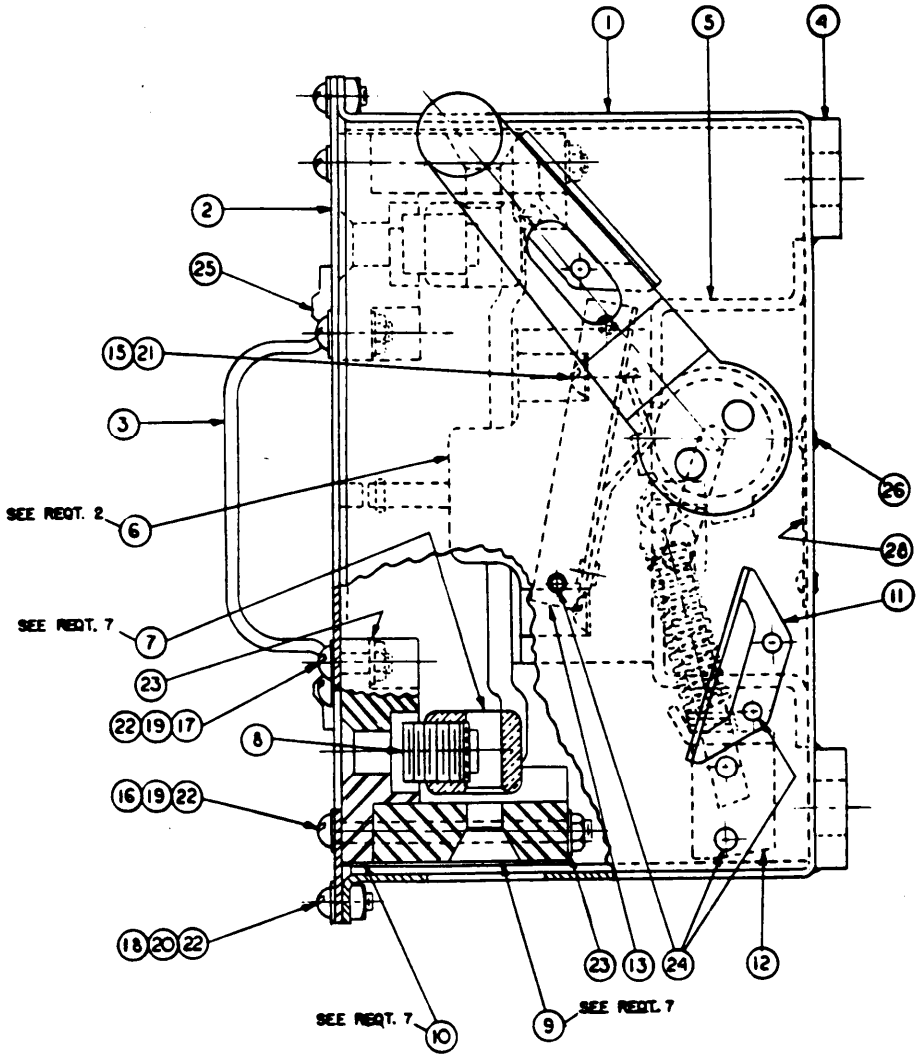

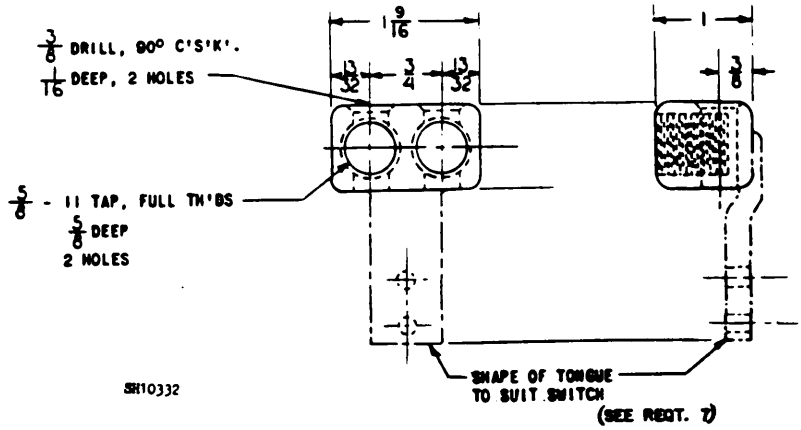

TERMINAL, PIECE 7


Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

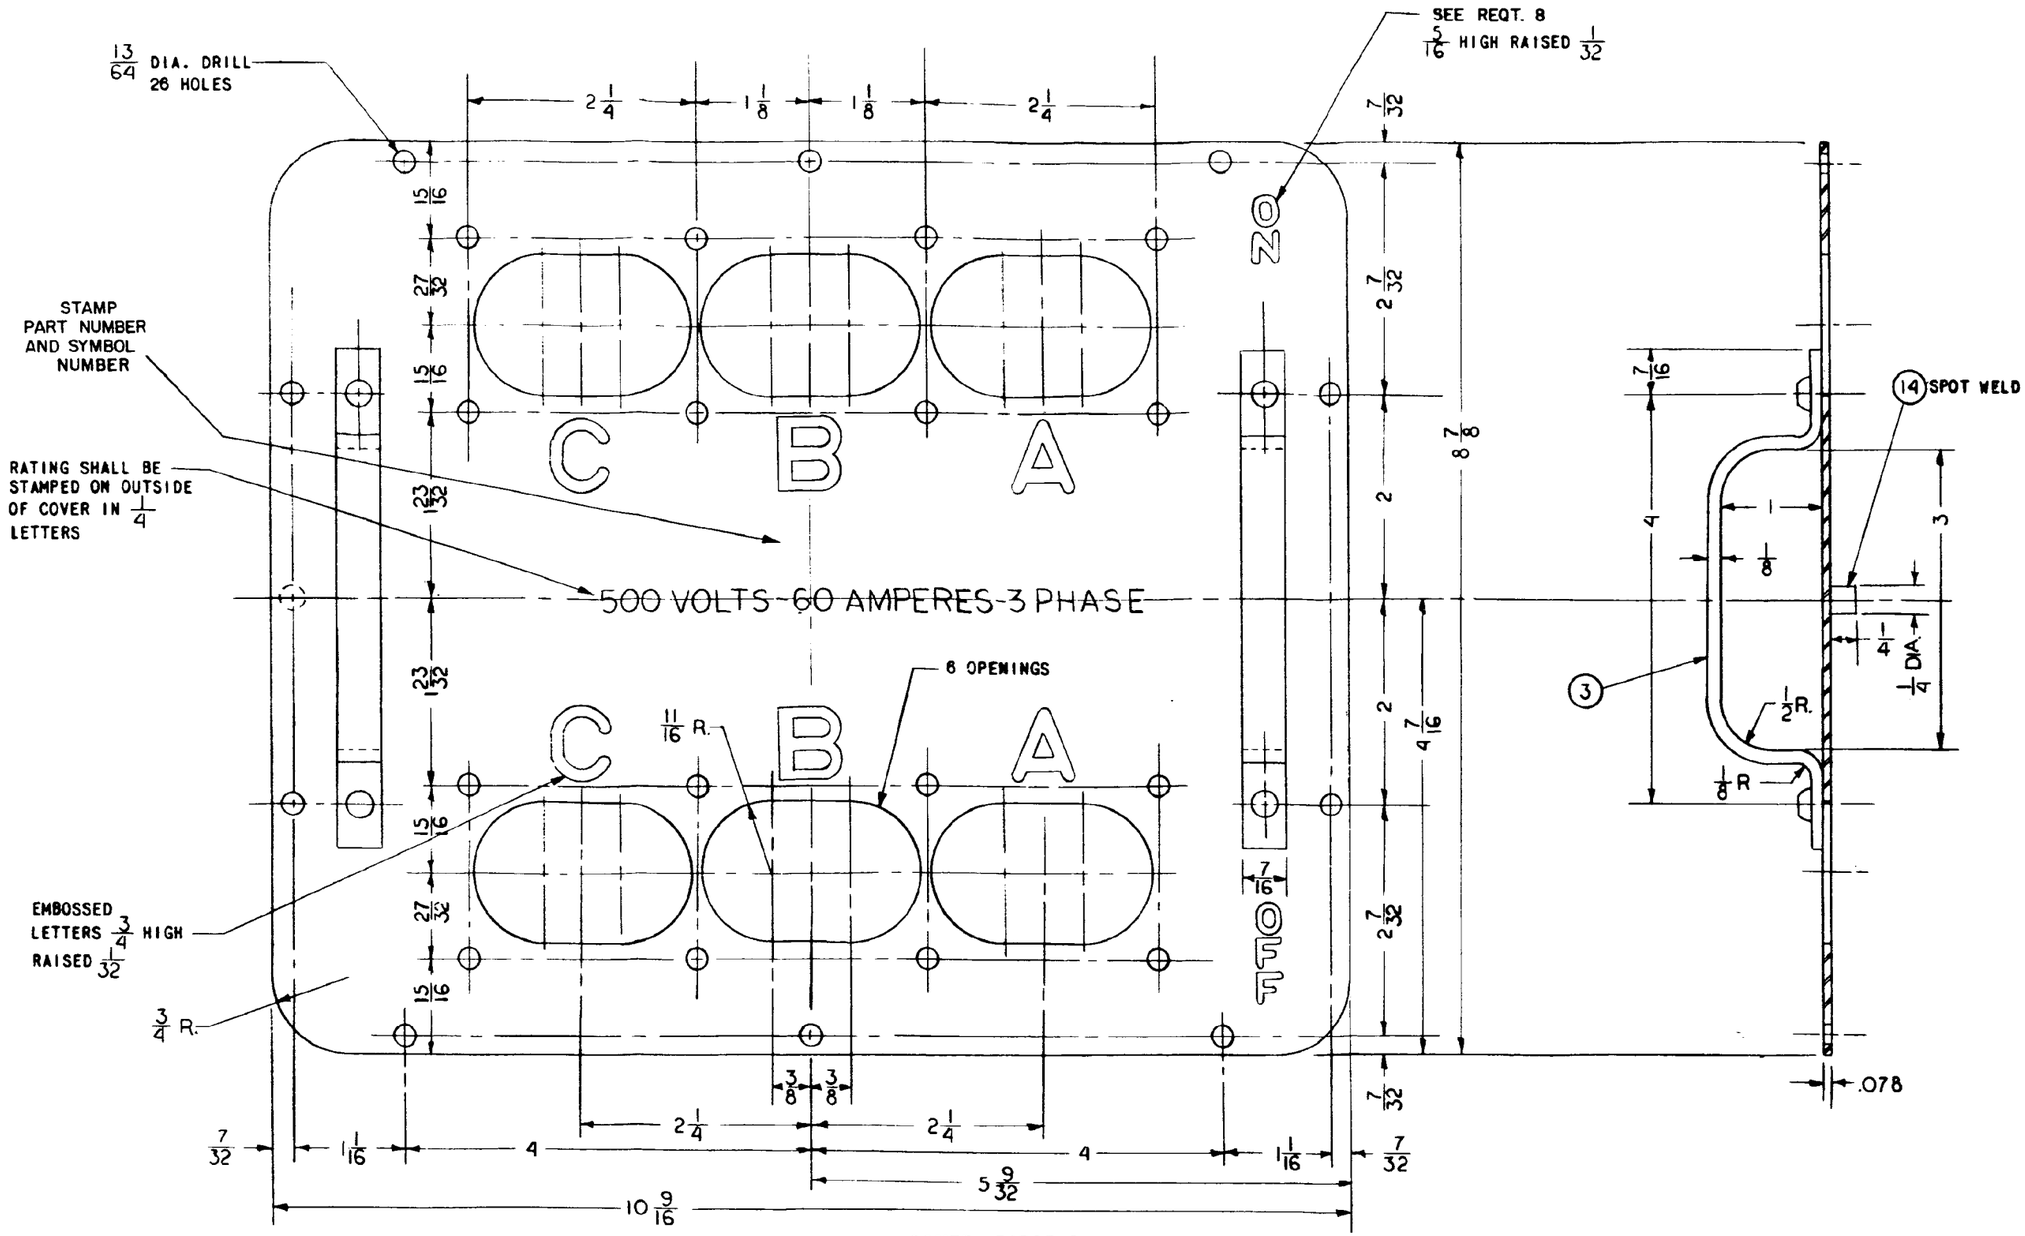

SH10333

COVER, PIECE 2


Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

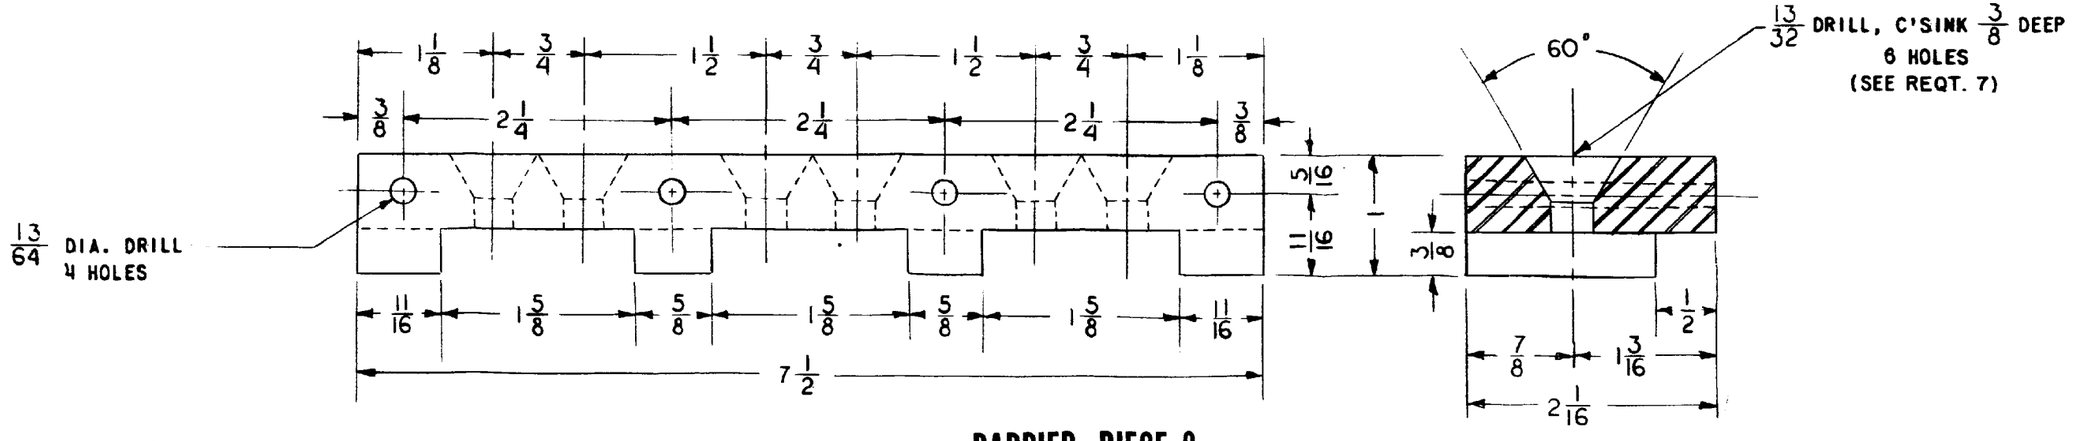

SH10334

BARRIER, PIECE 9

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

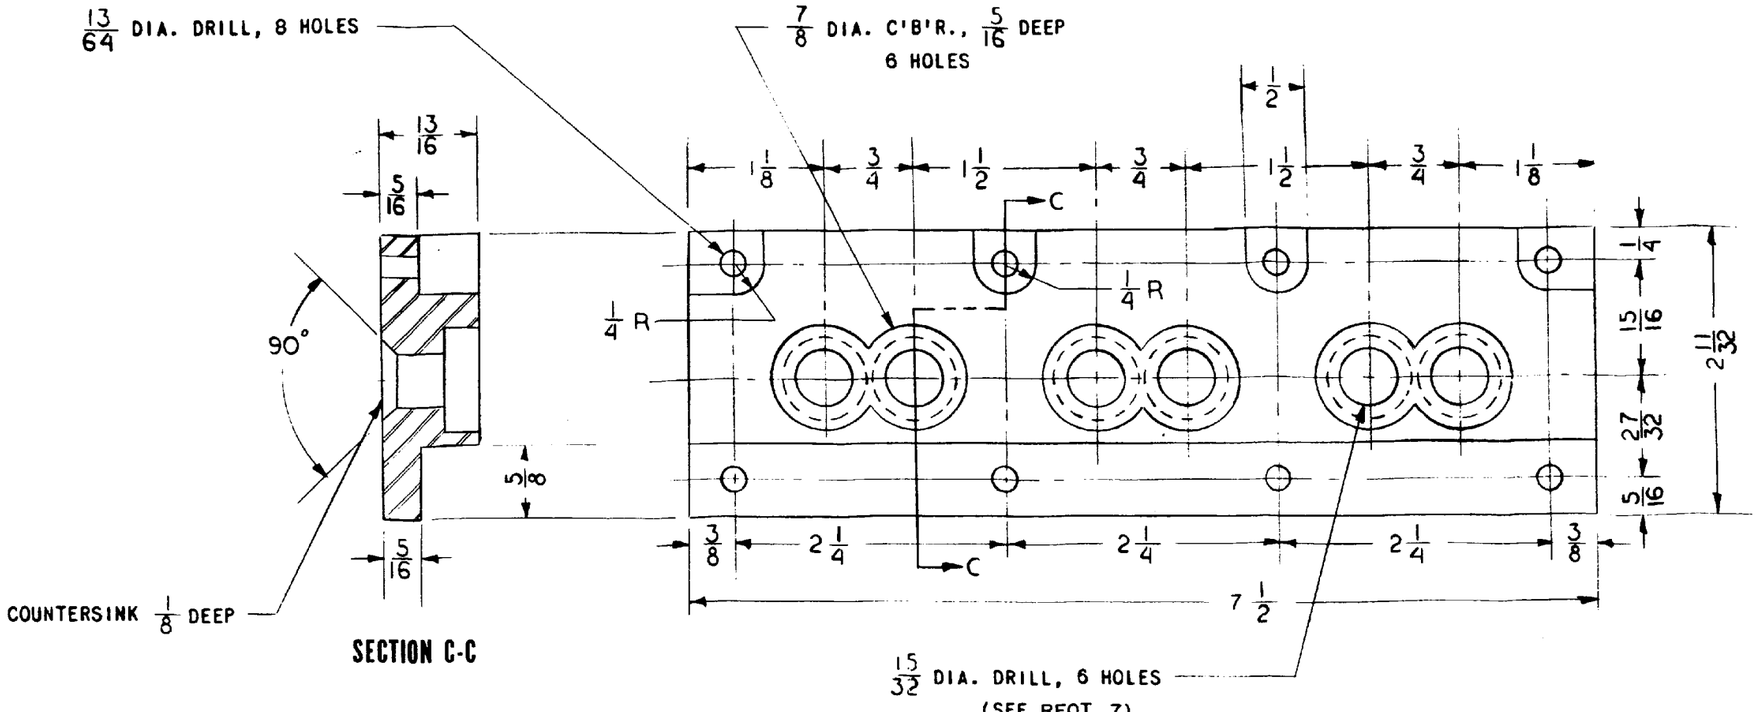

SH 10335

BARRIER, PIECE 10

Source: https://assist.dla.mil -- Downloaded: 202640-19T21:38Z
Check the source to verify that this is the current version before use.

LIST OF MATERIAL

QUANTITIES ARE FOR ONE SWITCH

Piece Number	Name of piece	Number req'd	Material	Material specification	Finish	Remarks
1	Box assembly	1	Steel			
2	Cover	1	Sheet steel			
3	Cover handle	2	Steel			
4	Mounting strap	2	Cold finished steel bar	QQ-S-637		
5	Switch mounting bracket	2	Sheet steel			see reqt. 11
6	Switch	1				see reqt. 2
7	Terminal	6	Cast copper alloy (alloy B2)	QQ-C-390		See reqt. 11
8	Terminal screw assembly	12				For det. see MIL-T-24381/1 PCg. 1
9	Barrier	2	Lam. plastic type GME	MIL-P-15037		
10	Barrier	2	Lam. plastic type GME	MIL-P-15037		
11	Stop	2	Sheet steel			See Reqt. 11
12	Trip spring anchor	1	Sheet steel			See reqt. 11
13	Spring support	1	Sheet steel			See reqt. 11
14	Dowel pin	1	Steel			
15	.216"-24 Rd. Hd.Mach Scr. 7/8" Lg.	12	Steel	Coml.	Zinc	
16	.190"-24 Rd. Hd.Mach Scr. 2-3/4" Lg.	8	Steel	Coml.	Zinc	
17	.190"-24 Rd. Hd.Mach Scr. 5/8" Lg.	8	Steel	Coml.	Zinc	
18	.190"-24 Rd. Hd.Mach Screw. 3/8" Lg.	10	Steel	Coml.	Zinc	
19	.190"-24 Hex. Nut	16	Steel	Coml.	Zinc	
20	.190"-24 Square Nut	10	Steel	Coml.	Zinc	
21	Shakeproof washer for .216" dia. scr.	12	Steel	Coml.	Zinc	See reqt. 11
22	Washer, 7/16"O.D. 13/64"I.D. .032"TH.	26	Steel	Coml.	Zinc	
23	Shakeproof washer for .190" dia. scr.	16	Steel	Coml.	Zinc	Int. locking type
24	Rivet 1/8" dia. lg. to suit	10	Steel			
25	Rivet 5/32" dia. lg. to suit	4	Steel			
26	Rivet 1/8" dia. drilled. lg. to suit	4	Brass			
27	Bearing bracket	1	Sheet steel			See reqt. 11
28	Insulating shield, 1/32" thick	1	Insulation fish paper			See reqt. 11
29	1/2"-13 Hex. hd. mach. scr. 1" lg.	4	Steel	Coml.	Zinc	
30	1/2"-13 wing nut	4	Steel	Coml.	Zinc	
31	Tool bit	2				For det's see MIL-T-24381/1 PC. 17
32	Tool handle	2				For det's see MIL-T-24381/1 PC. 18
33	Tool rack	1				For det's see MIL-T-24381/1 PC. 20
34	Wing screw	2				For det's see MIL-T-24381/1 pC. 22
35	Tool rack clamp	1				For det's see MIL-T-24381/1 pc. 21

All dimensions in inches, unless otherwise specified
Tolerances are:
Fractions . . . . . ±1/32
Decimals . . . . . ±.005
Angles . . . . . ±1/2 degree

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:38Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. Dimensions and configuration: See figures.
2. Switch shall be 500-volt, 60-ampere, three-phase, quick make and break contact type.
3. All steel parts of box and cover shall be assembled by welding as specified herein.
4. All projection and spot welding shall be performed by machines having automatic control of current, timing, and pressure to insure proper uniformity of the operation.
5. All parts shall be positioned by jig while welding to insure proper alinement.
6. All line contacting mechanisms shall have an interrupting capacity of not less than 360 amperes.
7. Cable entrance holes in barrier, piece 9, shall be in exact alignment with cable holes of terminal, piece 7 and terminal screw holes in piece 7 shall be in exact alignment with holes in the barrier, piece 10.
8. Switch position shall be stamped or enbossed on the cover or shall be designated by attaching permanent metal plates.
9. An installation and operating instruction sheet(s) shall be furnished with each switch.
10. If the manufacturer makes only the enclosure, his identification marking shall be on the interior of the cover.
11. The design and locations showm for pieces 5, 7, 11, 12, 13, 21, 27 and 28 are typical and shall be changed as necessary to conform to the design of switch, piece 6 as described in requirement 2.
12. Part number: M24381/5-001.

Preparing activity:
Navy - SH
(Project 5940-N560)

*U.S. GOVERNMENT PRINTING OFFICE: 1972-714-909-326

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:38Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

OMB Approval
No. 22-R255

INSTRUCTIONS: The purpose of this form is to solicit beneficial comments which will help achieve procurement of suitable products at reasonable cost and minimum delay, or will otherwise enhance use of the document. DoD contractors, government activities, or manufacturers/vendors who are prospective suppliers of the product are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity.

DOCUMENT IDENTIFIER AND TITLE

NAME OF ORGANIZATION AND ADDRESS

CONTRACT NUMBER

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?
   A. GIVE PARAGRAPH NUMBER AND WORDING.

   B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2. COMMENTS ON ANY DOCUMENT REQUIREMENT CONSIDERED TOO RIGID

3. IS THE DOCUMENT RESTRICTIVE?

   ☐ YES ☐ NO *(If "Yes", in what way?)*

4. REMARKS

SUBMITTED BY *(Printed or typed name and address - Optional)*

TELEPHONE NO.

DATE

DD FORM 1 JAN 72 1426 REPLACES EDITION OF 1 JAN 66 WHICH MAY BE USED

S/N 0102-014-1802

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:38Z
Check the source to verify that this is the current version before use.

FOLD

DEPARTMENT OF THE NAVY
Naval Ship Engineering Center
Center Building
Prince George's Center
Hyattsville, Maryland 20782

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

POSTAGE AND FEES PAID
Navy Department



Commander, Naval Ship Engineering Center
DOD Standardization Program & Documents Branch
Center Building - SEC 6124D
Prince George's Center
Hyattsville, Maryland 20782

FOLD

Source: https://assist.dla.mil -- Downloaded: 20261O-19T21:38Z
Check the source to verify that this is the current version before use.