INCH-POUND
MIL-DTL-2726/67B
31 August 2005
SUPERSEDING
MIL-R-2726/67A(SH)
3 July 1986

DRAFT SPECIFICATION SHEET

RECEPTACLE, ELECTRICAL, ENCLOSED, 10-AMPERE, 125-VOLT, 3-PHASE, GROUNDED (SYMBOL NO. 741.2)

Inactive for new design after 28 June 1999.

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-2726.


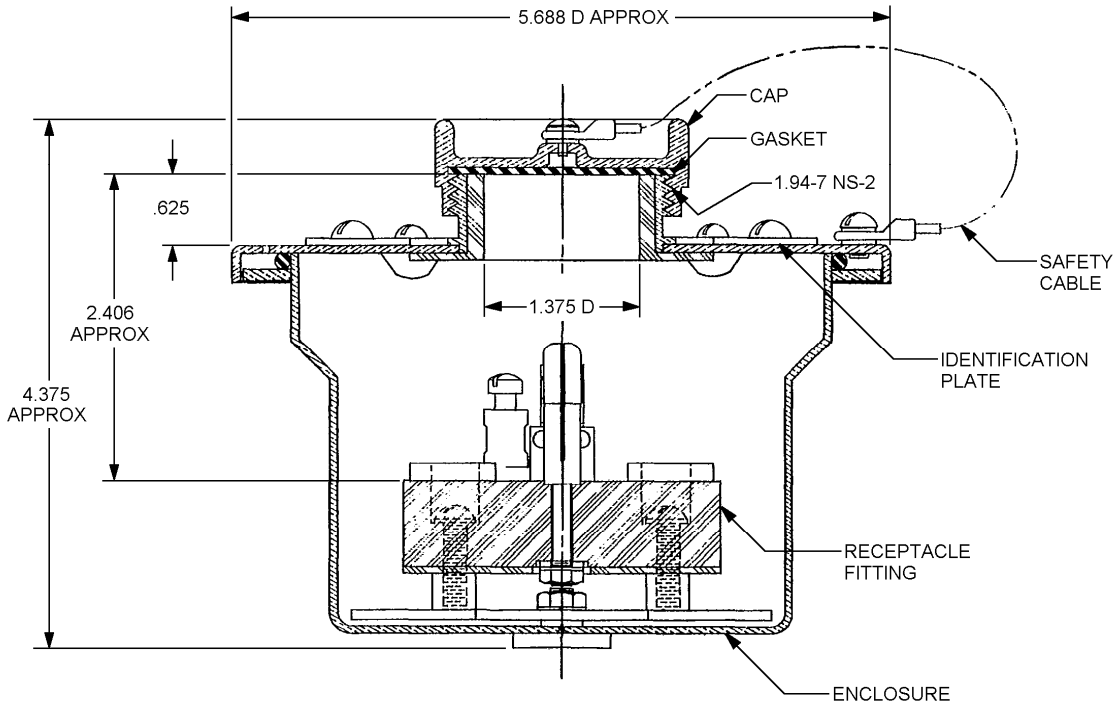


FIGURE 1. Receptacle assembly.

AMSC N/A FSC 5935

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.

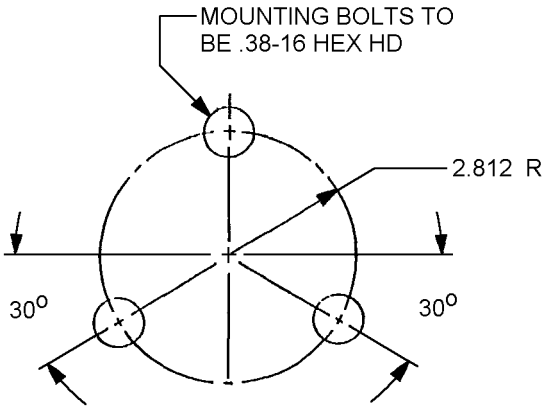

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for information only.
3. Unless otherwise specified, tolerances are ± .016 (0.41mm) and ± 0°30' on angles.
4.. Supersedes: Drawing 9000-S6202-74159.

FIGURE 1. Receptacle assembly – Continued.


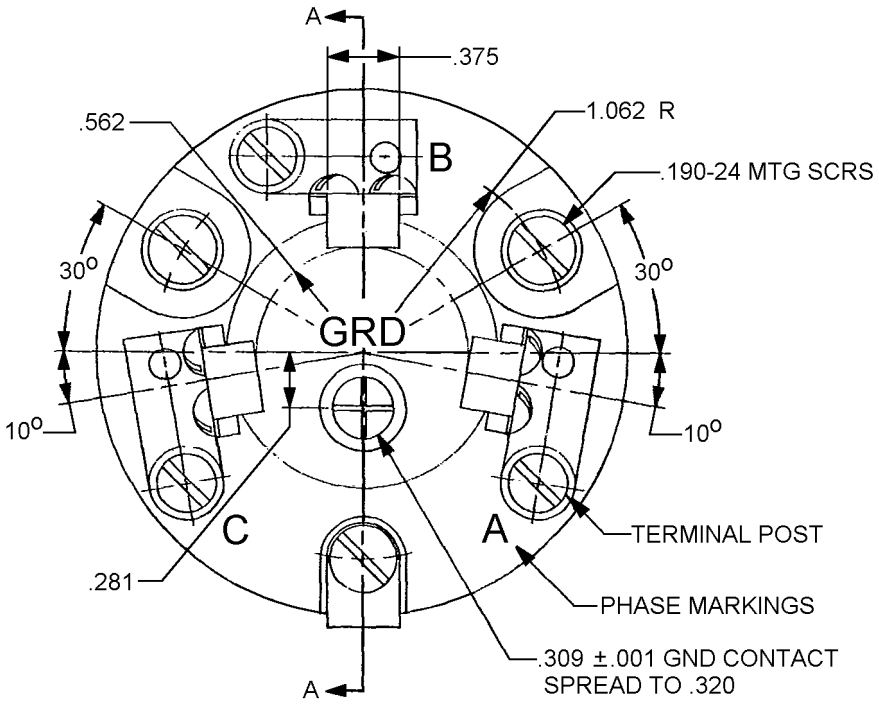


FIGURE 2. Receptacle fitting.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.

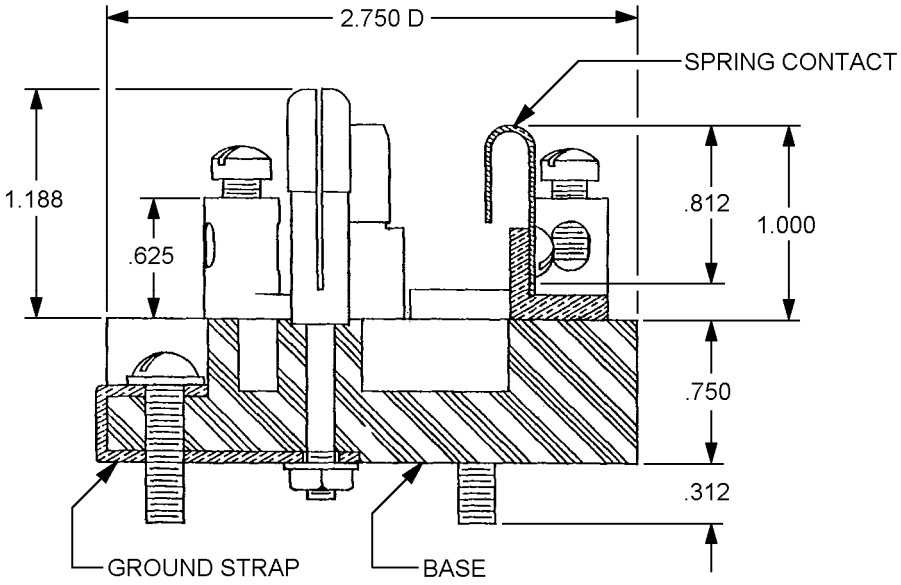

Inches	mm	Inches	mm
.001	0.03	.812	20.62
.190	4.83	1.000	25.40
.281	7.14	1.062	26.97
.309	7.85	1.188	30.18
.312	7.92	1.375	34.93
.320	8.13	1.94	49.3
.375	9.53	2.406	61.11
.38	9.7	2.750	69.85
.562	14.27	2.812	71.42
.625	15.88	4.375	111.13
.750	19.05	5.688	144.48

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for information only.
3. Unless otherwise specified, tolerances are ± .016 (0.41mm) and ± 0°30’ on angles.

FIGURE 2. Receptacle fitting – Continued

REQUIREMENTS

Dimensions and configurations: See figures 1 and 2.

Effectiveness of enclosure: Watertight in accordance with MIL-STD-108.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.

Receptacle material: Spring contact, phosphor bronze spring temper.
Base type MAI-60 In accordance with ASTM-D5948.
Ground screw shall be finished in a distinctive green color.

Enclosure: Material may be molded plastic type MAI-60 In accordance with ASTM-D5948.

Enclosure shall be in accordance with MIL-E-24142, Part or Identifying Number (PIN): M24142/5-002.

Design: Enclosure cover and receptacle assembly may be a one-piece molded unit.

Cap material: Brass or plastic. Intended use, maintain degree of enclosure when plug is removed.

Mating plug: MIL-DTL-2726/68, PIN M2726/68-001.

Electrical rating: 10-ampere, 125-volt, alternating current, 60-hertz.

PIN: M2726/67-001 (receptacle assembly).
M2726-67-002, (receptacle assembly).

VERIFICATION

Verification shall be as specified in MIL-DTL-2726 and table I herein. The first article and conformance inspections shall consist of the inspections as specified in table I, in the order shown.

TABLE I. First article and conformance inspection.

Inspection	First article	Conformance
Examination	X	X
Insulation resistance	X	X
Dielectric withstanding voltage	X	X
Contact resistance	X	X
Current load	X	
Endurance	X	
Salt spray	X	
Contact resistance	X	
Vibration	X	
Shock	X	
Effectiveness of enclosure	X	X
Dielectric withstanding voltage	X	

Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Referenced documents. In addition to MIL-DTL-2726, this document references the following:

ASTM-D5948
MIL-DTL-2726/68
MIL-E-24142
MIL-STD-108

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.

CONCLUDING MATERIAL

Custodians:
Army - CR
DLA - CC
Navy - SH

Review activities:
Army - AV, MI

Preparing activity:
DLA - CC

(Project 5935-4760-000)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T15:36Z
Check the source to verify that this is the current version before use.