
MILITARY SPECIFICATION SHEET

INSULATORS, FEEDTHRU
(STYLE 32)

The complete requirements for procuring the insulators described herein shall consist of this document and the latest issue of Specification MIL-I-23264.

This specification is mandatory for use by all Departments and Agencies of the Department of Defense.

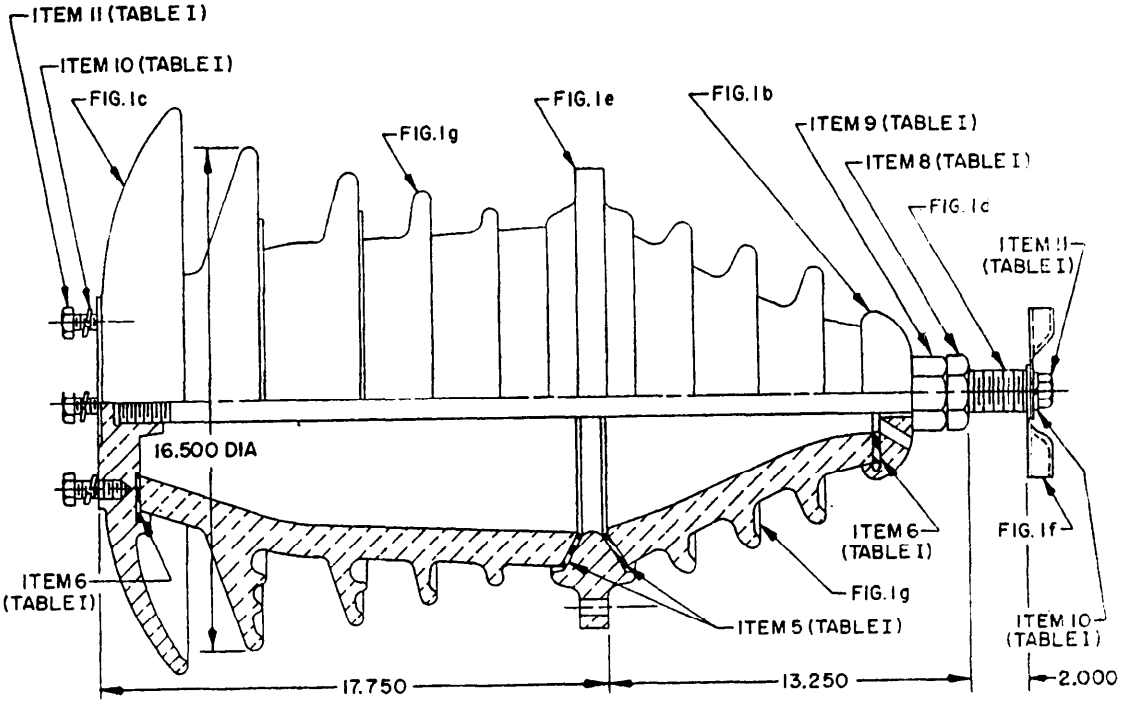


INCHES	MM
2.000	50.80
13.250	336.55
16.500	419.10
17.750	450.85

FIGURE 1a. Feedthru insulator assembly.

FIGURE 1. Style 32 feedthru insulator.

FSC 5970

Source: https://assist.dla.mil -- Downloaded: 20261O-19T16:07Z
Check the source to verify that this is the current version before use.

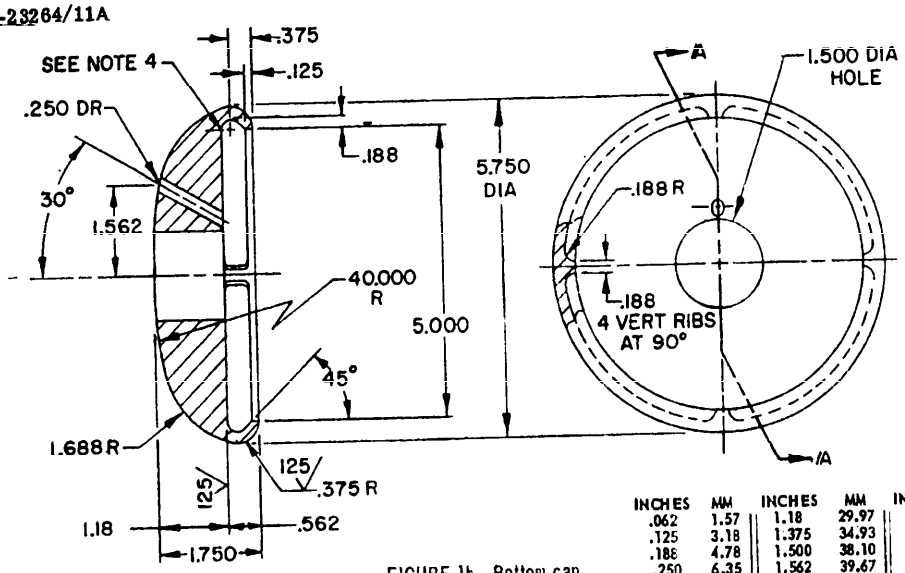

INCHES	MM	INCHES	MM	INCHES	MM
.062	1.57	1.18	29.97	5.000	127.00
.125	3.18	1.375	34.93	5.125	130.18
.188	4.78	1.500	38.10	5.750	146.05
.250	6.35	1.562	39.67	6.000	152.40
.312	7.92	1.625	41.28	7.250	184.15
.375	9.53	1.688	42.88	8.375	212.73
.500	12.70	1.750	44.45	10.000	254.00
.562	14.27	2.000	50.80	10.625	269.88
.750	19.05	2.312	58.72	19.500	495.30
.875	22.23	2.875	73.03	31.625	803.28
1.125	28.58	3.000	76.20	40.00	1016.00

FIGURE 1b. Bottom cap.
(Item 4, Table I)

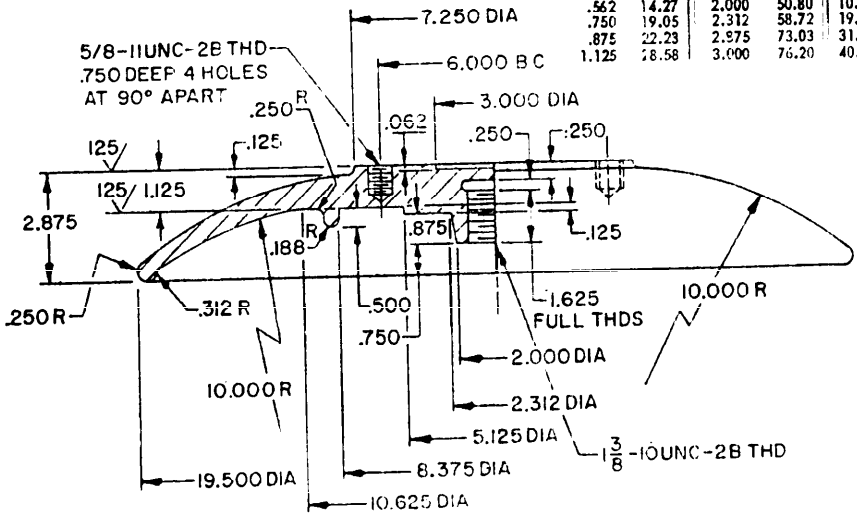


FIGURE 1c. Top cap.
(Item 3, Table I)


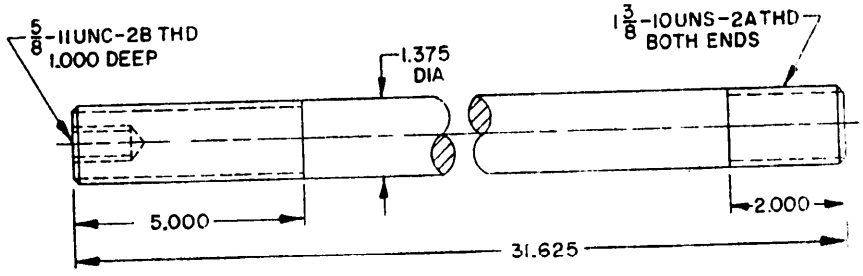


FIGURE 1d. Anchor rod.
(Item 7, Table I)

FIGURE 1. Style 32 feedthru insulator. - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T16:07Z
Check the source to verify that this is the current version before use.

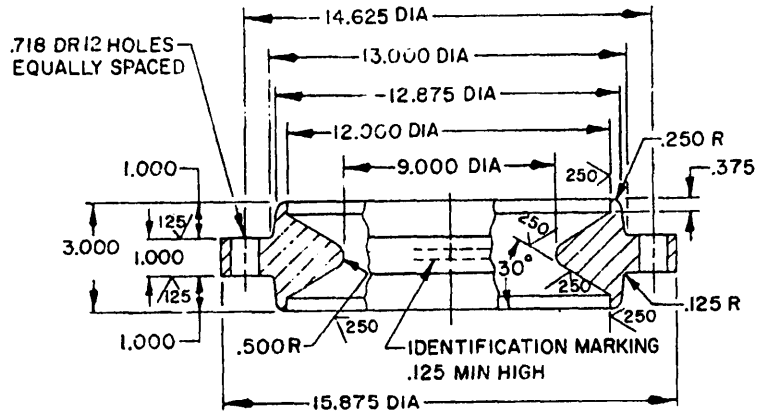

INCHES	MM
.125	3.18
.144	3.66
.250	6.35
.375	9.53
.500	12.70
.656	16.66
.669	16.99
.718	18.24
.750	19.05
1.000	25.40
1.200	30.48
3.000	76.20
3.188	80.98
9.000	228.60
12.000	304.80
12.875	327.03
13.000	330.20
14.625	371.48
15.875	403.23

FIGURE 1e. Flange.
(Item 2, Table I)


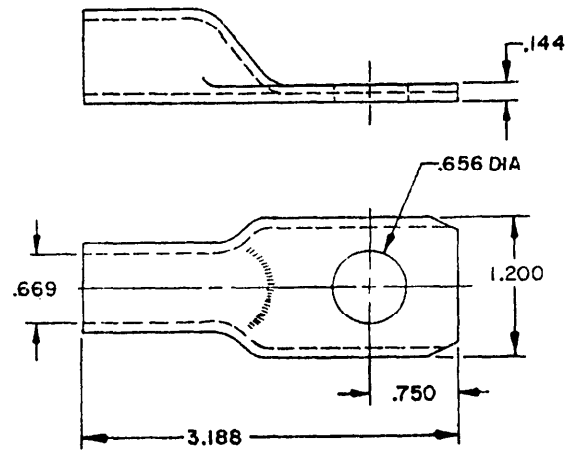



FIGURE 1f. Terminal lug.
(Item 12, Table I)

FIGURE 1. Style 32 feedthru insulator. - Continued.

Source: https://assist.dla.mil -- Downloaded: 202610-19T16:07Z
Check the source to verify that this is the current version before use.

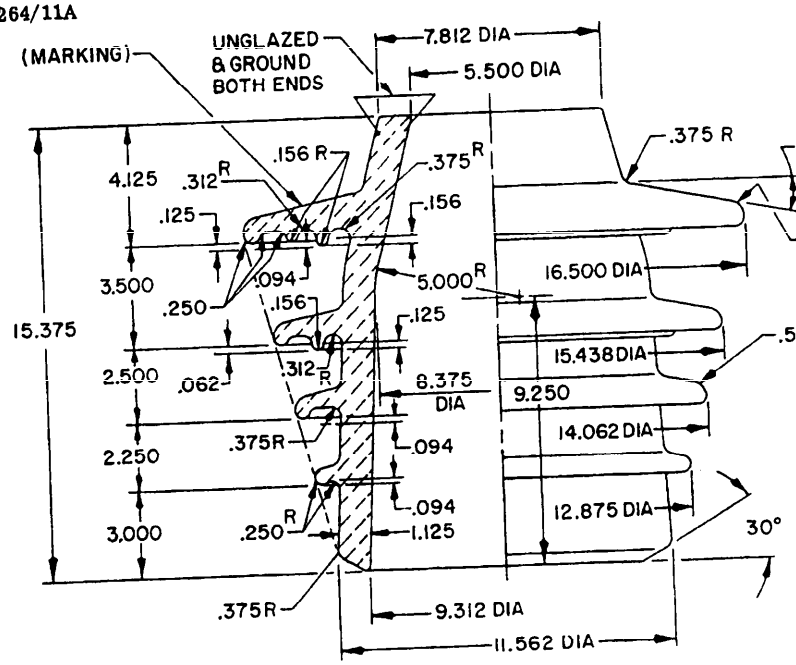

UPPER BOWL

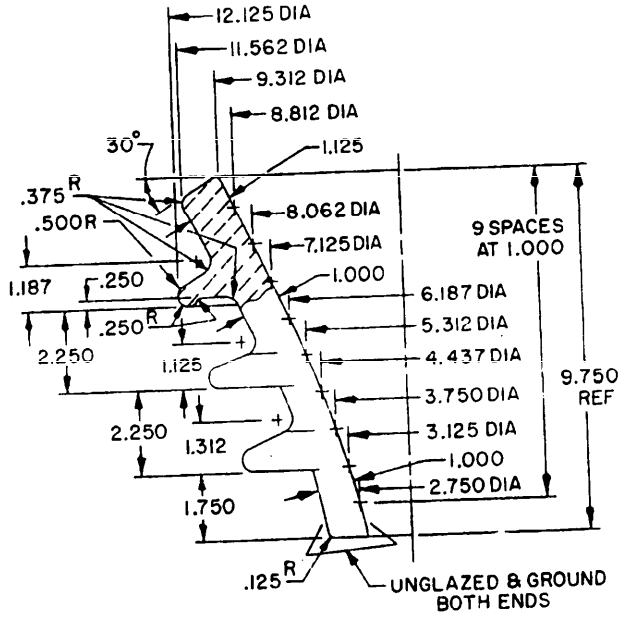

LOWER BOWL

INCHES	MM
.062	1.57
.094	2.39
.125	3.18
.156	3.96
.250	6.35
.312	7.92
.375	9.53
.500	12.70
1.000	25.40
1.125	28.58
1.187	30.15
1.312	33.32
1.750	44.45
2.250	57.15
2.500	63.50
2.750	69.85
3.000	76.20
3.125	79.38
3.500	88.90
3.750	95.25
4.125	104.78
4.437	112.70
5.000	127.00
5.312	134.92
5.500	139.70
6.187	157.15
7.125	180.98
7.812	198.42
8.062	204.77
8.375	212.73
8.812	223.82
9.250	234.95
9.312	236.52
9.750	247.65
11.562	293.67
12.125	307.98
12.875	327.03
14.062	357.17
15.375	390.53
15.438	392.13
16.500	419.10

FIGURE 1g. Insulator.
(Item 1, Table I)

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Prior to shipment, the hexagon nut shall be tightened with sufficient pressure to keep insulator bowls intact. The pressure applied shall not cause serious deformation to the gaskets.
4. Machine finish corners.

FIGURE 1. Style 32 feedthru insulator. - Continued.

Source: https://assist.dla.mil -- Downloaded: 20260-19T16:07Z
Check the source to verify that this is the current version before use.

TABLE I. Item description.

Item No.	Description	Material	No. per assembly
1	Insulator	Ceramic, grade 222 or better, per MIL-I-10	1
2	Flange	Galvanized steel per MIL-S-15083	1
3	Cap, top	Bronze per QQ-B-726	1
4	Cap, bottom		1
5	Gasket, 12.000 OD, 9.250 ID, .125 THK	Synthetic rubber per MIL-R-3065	2
6	Washer (gasket), 4.938 OD, 2.250 ID, .125 THK	Soft annealed copper per QQ-C-576	2
7	Anchor rod	Galvanized steel per MIL-S-890	1
8	Hexagon jam nut, 1-3/8-10UNS-2B	Brass per QQ-B-637	1
9	Hexagon nut, 1-3/8-10UNS-2B		1
10	Lock washer	Phosphor bronze per QQ-B-750	5
11	Cap screw, 5/8-11UNC-2B, 1.500 in. long	Brass per QQ-B-637	5
12	Terminal lug	Copper	2

TABLE II. Type designation.

Type designation	Dimensions
NL222B32-240	See figure 1

REQUIREMENTS:

Dimensions: See figure 1 and table I.

Tolerances:
Ceramic - Unless otherwise specified, the tolerances for ceramic parts shall be as specified in table IV of MIL-I-23264.
Metal - Unless otherwise specified, the tolerance for metal parts shall be ±.020 inch. Tolerances on angles shall be ±1°.

Component parts:
Ceramic parts - Ceramic per MIL-I-10 shall be grade 222 or better.
Metal parts - Unless otherwise specified, all bearing and exposed metal surfaces shall be machine finished to 125/.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T16:07Z
Check the source to verify that this is the current version before use.

Cantilever: Insulators shall have the 1-3/8-inch diameter hexagon nut tightened with sufficient pressure to elongate the anchor rod 0.018 inch. The jam nut shall then be tightened and the insulator flange shall be bolted to a rigid steel frame. An ultimate cantilever load of 100,000 inch-pounds, minimum, shall be applied at 90 degrees to the axis of the insulator and at the end of a 100-inch lever arm.

Custodians:
Army - EL
Navy - EC
Air Force - 85

Review activities:
Army - EL, MI, MU
Navy - SH, EC
Air Force - 85
DSA - ES

User activities:
Army - ME
Navy - MC, AS
Air Force -

Preparing activity:
Navy - EC

(Project 5970-0160)

Revision letters are not used to indicate changes due to the extensiveness of the changes.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T16:07Z
Check the source to verify that this is the current version before use.