[INCH-POUND]
A-A-55570/1
June 3, 1996
SUPERSEDING
A-A-55499
March 4, 1994

COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, EXTRACTOR POST, IN-LINE TYPE, ACCOMMODATES FAST ACTING, AUTOMOTIVE BLADE TYPE, INCLOSED LINK FUSES.

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for extractor post, in-line type fuseholders which accommodate fast acting, automotive blade type, inclosed link fuses. Fuseholders covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

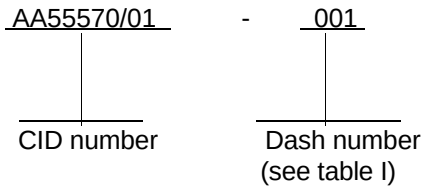

3. SALIENT CHARACTERISTICS.

3.1 Design and construction. Fuseholders supplied to this CID shall be as specified herein (see figure 1).

3.2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 32 V dc.

3.4 Ambient temperature. The ambient temperature shall be -40° C to +85° C.

3.5 Mounting. Fuseholders shall be capable of snap-mounting to panel from rear. Fuseholders shall also be capable of interlocking for multiple mounting (see figure I).

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN: DESC-ELDM 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.

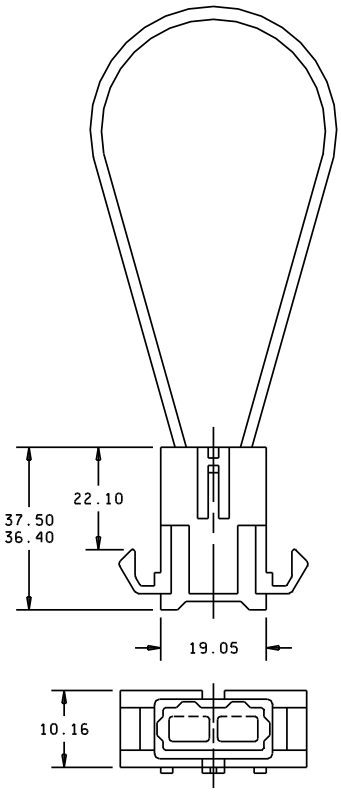

Recommended panel mounting hole
(1.02/1.98 thick panel)

Add 10.16 to width for each additional fuseholder.

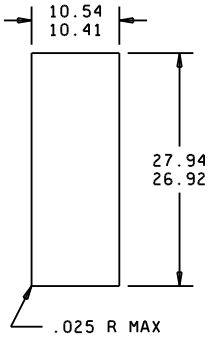

Typical multiple mounting
(fuseholders interlocked)

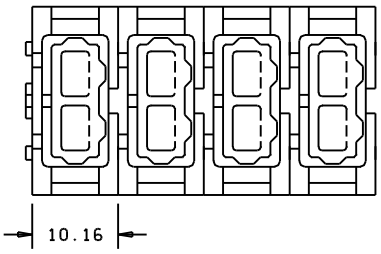

mm	Inches	mm	Inches	mm	Inches	mm	Inches
.025	.01	10.16	.400	19.05	.750	27.94	1.10
1.02	.04	10.41	.410	22.10	.870	30.23	1.19
1.98	.078	10.54	.415	26.92	1.06	37.08	1.46

NOTES:

1. Dimensions are in millimeters.
2. Tolerance is ±0.13 mm (.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

CID PIN AA55570/01-	Ampere rating	Wire size	Characteristics
001	20 amperes maximum	Supplied with a 203.2 mm (8 inch) 14 gauge (AWG) wire loop.	Accommodates CID AA55569/01-001 through AA55569/01-009 fuses. Fuse not supplied.
002	30 amperes maximum	Supplied with a 203.2 mm (8 inch) 10 gauge (AWG) wire loop.	Accommodates CID AA55569/01-010 and AA55569/01-011 fuses. Fuse not supplied.
003	3	Supplied with a 203.2 mm (8 inch) 14 gauge (AWG) wire loop.	Supplied with CID AA55569/01-003 fuse installed.
004	4		Supplied with CID AA55569/01-004 fuse installed.
005	5		Supplied with CID AA55569/01-005 fuse installed.
006	7.5		Supplied with CID AA55569/01-006 fuse installed.
007	10		Supplied with CID AA55569/01-007 fuse installed.
008	15		Supplied with CID AA55569/01-008 fuse installed.
009	20		Supplied with CID AA55569/01-009 fuse installed.
010	25	Supplied with a 203.2 mm (8 inch) 10 gauge (AWG) wire loop.	Supplied with CID AA55569/01-010 fuse installed.
011	30		Supplied with CID AA55569/01-011 fuse installed.

3.6 Molded parts material. The molded parts shall be black thermoplastic with a UL 94V2 flammability rating as a minimum.

3.7 Terminal plating. Terminals shall be tin plated brass. Use of pure tin plating is prohibited as a final finish and as an undercoat. Use of tin-lead (Sn-Pb) finishes are acceptable provided that the minimum lead content is 3 percent.

3.8 Marking. Fuseholders supplied to this CID shall be marked with the manufacturer's (MFGR) standard commercial PIN.

4. QUALITY ASSURANCE PROVISIONS. Quality assurance provisions shall be as specified in A-A-55570.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.

5. PACKAGING. Packaging shall be as specified in A-A-55570.

6. NOTES.

6.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format.

6.2 CAGE code. For ordering purposes, inventory control, and submission of these fuseholders to DESC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

6.3 Source of documents.

Commercial Item Description

A-A-55570	-	Fuseholder, Which Accommodates, Automotive Blade Type, Inclosed Link Fuses, General Requirements for.
A-A-55569/01	-	Fuse, Inclosed Link, Fast Acting, 1 Through 40 Amperes (A), Automotive Blade Type.

(Copies of commercial item descriptions are available from the Defense Printing Service Detachment Office, Building 4D (Customer Service), 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 94	-	Safety Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, Standard For.

(Application for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

6.4 Ordering data. Ordering data shall be as specified in A-A-55570.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.

6.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following MFGRs of commercial products. At the time of CID preparation and coordination, these MFGRs were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved MFGRs or be used to restrict procurement to only the MFGRs shown.).

MFGR's CAGE	MFGR's name and address
75915	Littelfuse Incorporated 800 E. Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

6.6 Part number (P/N) supersession data. This CID supersedes the following MFGRs P/N as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

CID dash number (see table I) AA55570/01-	MFGRs CAGE	MFGRs PIN 1/
001	75915	155320A
002	75915	155430A
003	75915	155303A
004	75915	155304A
005	75915	155305A
006	75915	15537.5A
007	75915	155310A
008	75915	155315A
009	75915	155320A
010	75915	155425A
011	75915	155430A

1/ The MFGR PIN shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID PIN shown.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.

6.7 CID number supersession data. This CID supersedes CID A-A-55499 and its dash numbers as shown.

CID dash number (see table I) AA55570/01-	Superseded CID dash number A-A-55499-
001	001
1/	002
002	003
1/	004
003	---
004	---
005	---
006	---
007	---
008	---
009	---
010	---
011	---

1/ Canceled without replacement.

6.8 Government users. To acquire information on obtaining these fuseholders from the Government inventory system, contact Defense Electronics Supply Center, ATTN: DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5519, or telephone (513) 296-5106.

MILITARY INTERESTS:

Custodians:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-ES

Project 5920-0537-01

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:54Z
Check the source to verify that this is the current version before use.