[INCH-POUND]
A-A-59462
31 January 2000
SUPERSEDING
MIL-I-23208A
24 May 1965

COMMERCIAL ITEM DESCRIPTION

INDICATOR, SIGHT, LIQUID, REFRIGERANT

The General Services Administration has authorized the use of this commercial item description as a replacement for MIL-I-23208A for all federal agencies.

1. SCOPE. This commercial item description (CID) covers liquid refrigerant sight flow indicators intended for use in systems using refrigerant type 12 or 22.

2. CLASSIFICATION. The indicators shall be of the following types and sizes. The type and size to be furnished shall be as specified (see 7.2(b)).

Type I - External flare connection SAE Male Flare end

Size 1 - 1/4-inch connection
Size 2 - 3/8-inch connection
Size 3 - 1/2-inch connection
Size 4 - 5/8-inch connection

Type II - External flare connection SAE Male - Female Flare end

Size 1 - 1/4-inch connection
Size 2 - 3/8-inch connection
Size 3 - 1/2-inch connection
Size 4 - 5/8-inch connection

Beneficial comments, recommendations, additions, deletions, clarifications, etc. and any other data which may improve this document should be sent to: Defense Supply Center Richmond (DSCR), ATTN: DSCR-VBD, 8000 Jefferson Davis Highway, Richmond, VA 23297-5610.

AMSC N/A FSC 6680

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:15Z
Check the source to verify that this is the current version before use.

Type III- Sweat joint connection end

Size 1 - 1/4-inch connection
Size 2 - 3/8-inch connection
Size 3 - 1/2-inch connection
Size 4 - 5/8-inch connection
Size 5 - 7/8-inch connection
Size 6 - 1 1/8-inch connection
Size 7 - 1 3/8-inch connection
Size 8 - 1 5/8-inch connection
Size 9 - 2 1/8-inch connection

3. SALIENT CHARACTERISTICS

3.1 General requirements. The indicator shall allow an unrestricted flow of refrigerant type 12 and 22 and shall be certified in accordance with Underwriters Laboratories, Inc. (UL) 207, "Refrigerant-Containing Components and Accessories, Nonelectrical". The indicator shall contain not less than 0.24 square inches of unrestricted viewing area.

3.2 Moisture indicating element. When required (see 7.2(c)), a moisture indicating element shall be provided for determination of a wet or dry refrigerant. A color comparison code or chart for refrigerant type 12 and type 22 shall accompany the indicator.

4. REGULATORY REQUIREMENTS

4.1 Recovered materials. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4.2 Environmental protection. The sight glass shall meet all applicable Environmental Protection Agency (EPA) restrictions in effect on the date of the contract. These regulations apply to the emission of materials hazardous to the environment or the user’s health and shall be adhered to during the manufacturing, service, transportation, storage, and operation/use of the sight glass.

5. QUALITY ASSURANCE PROVISIONS

5.1 Product conformance. The sight glasses shall meet the salient characteristics of this CID; conform to the manufacturer’s own drawings, specifications, standards, and quality assurance practices; and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:15Z
Check the source to verify that this is the current version before use.

5.1.1 Verification of conformance. Verification of conformance to UL 207 shall be either the manufacturer's standard certification of such conformance or by an accredited testing laboratory satisfactory to the Government.

5.1.2 Moisture element test. Each refrigerant shall have a maximum of 10 parts per million (ppm) moisture content when passed through and the indicating element shall indicate dry in accordance with the manufacturer's established code or chart. The moisture content shall be gradually increased to a maximum of 40 ppm. The element shall show a definite change to a wet condition. An intermediate change in the element shall be observed if manufacturer's design requires. The manufacturer's standard method for determining the moisture content of the refrigerant shall be acceptable.

6. PACKAGING

6.1 Preservation, packing, and marking. For acquisition purposes, the indicators shall be preserved, packed, and marked as specified in the acquisition order (see 7.5(d)).

7. NOTES

7.1 Sources of documents.

7.1.1 FAR. The FAR may be obtained from the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402-0001.

7.1.2 UL standards. Copies of UL standards may be obtained from Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

7.2 Ordering data. Acquisition documents must specify the following:

a. Title, number, and date of this document
b. Type and size of indicator as required in contract (see 2)
c. Moisture indicator, if required in contract (see 3.2)
d. Packaging requirements, as specified (see 6.1)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:15Z
Check the source to verify that this is the current version before use.

7.3 Part identification number (PIN). The following part identification numbering procedure is for government purposes and does not constitute a requirement for the contractor.

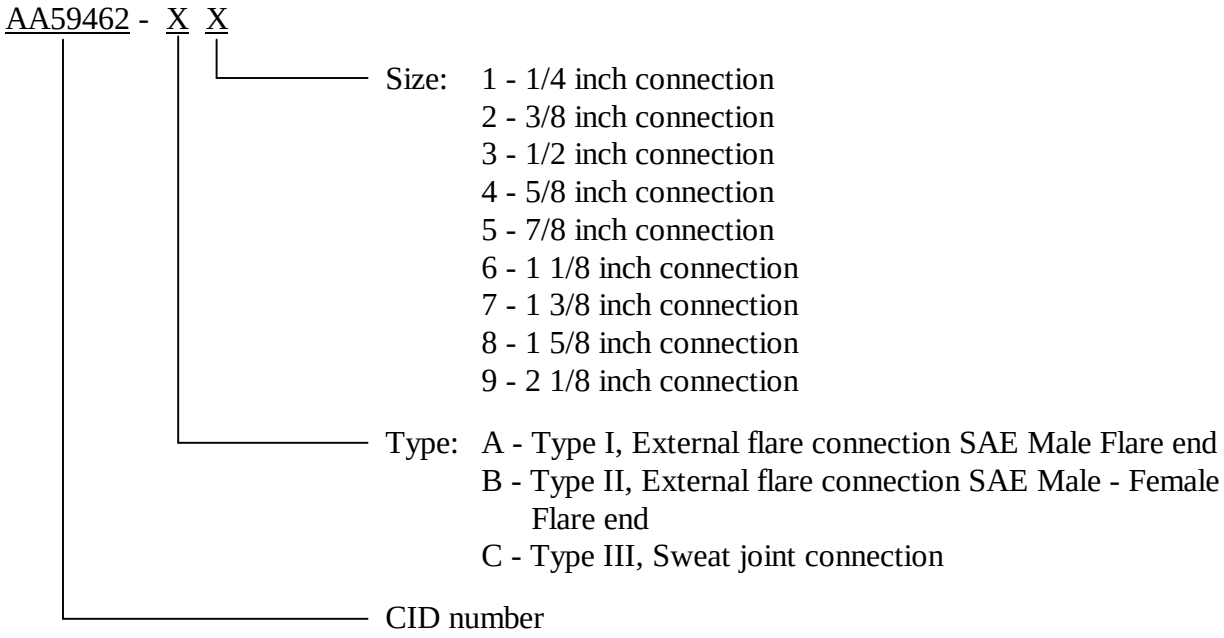

MILITARY INTERESTS:

Custodians:
Army - GL
Navy - YD
Air Force - 11

Reviewers:
Navy - MC, SH

CIVIL AGENCY
COORDINATING ACTIVITY:

GSA - 7FXE

Preparing activity:
DLA - GS

(Project 6680-0252)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:15Z
Check the source to verify that this is the current version before use.