[METRIC]
A-A-52600
March 6, 1996
SUPERSEDING
MIL-T-462E
16 September 1985

COMMERCIAL ITEM DESCRIPTION

TANK, LIQUID STORAGE, METAL: FUEL-OIL, HORIZONTAL

The General Services Administration has authorized the use of this Commercial Item Description (CID) for all federal agencies.

1. SCOPE. This CID covers a 1041 liter (L) (275 gallon (gal)) nominal capacity, horizontal, non-pressure type, above ground fuel oil storage tank. The tank is intended for unenclosed installation inside of buildings, primarily for the storage and supply of fuel oil for oil burners. Outdoor installation is not precluded.

2. SALIENT CHARACTERISTICS

2.1 Materials. Unless otherwise specified herein, materials shall be in accordance with the applicable requirements of Underwriters Laboratories, Inc., UL 80. The use of recovered material made in compliance with regulatory requirements is acceptable providing that all requirements of this CID are met (see 3.1).

2.1.1 Commercial grade steel. The tank shall be constructed of commercial grade steel having a carbon content of 0.25 percent or less. The minimum thickness of uncoated steel shall be not less than 1.70 millimeter (mm) (0.067 inches (in)) and for galvanized steel, 1.78 mm (0.070 in).

Beneficial comments, recommendations, additions, deletions clarifications, etc. and any other data which may improve this document should be sent by letter to: U.S. Army Tank-automotive and Armaments Command, ATTN: AMSTA-TR-E/BLUE, Warren, MI 48397-5000.

AMSC N/A FSC 5430

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2 Design and construction.

2.2.1 Design. The tank shall be fabricated in accordance with the requirements of Underwriters Laboratories Inc., UL 80. The tank shall have the form as shown in Figure 1.

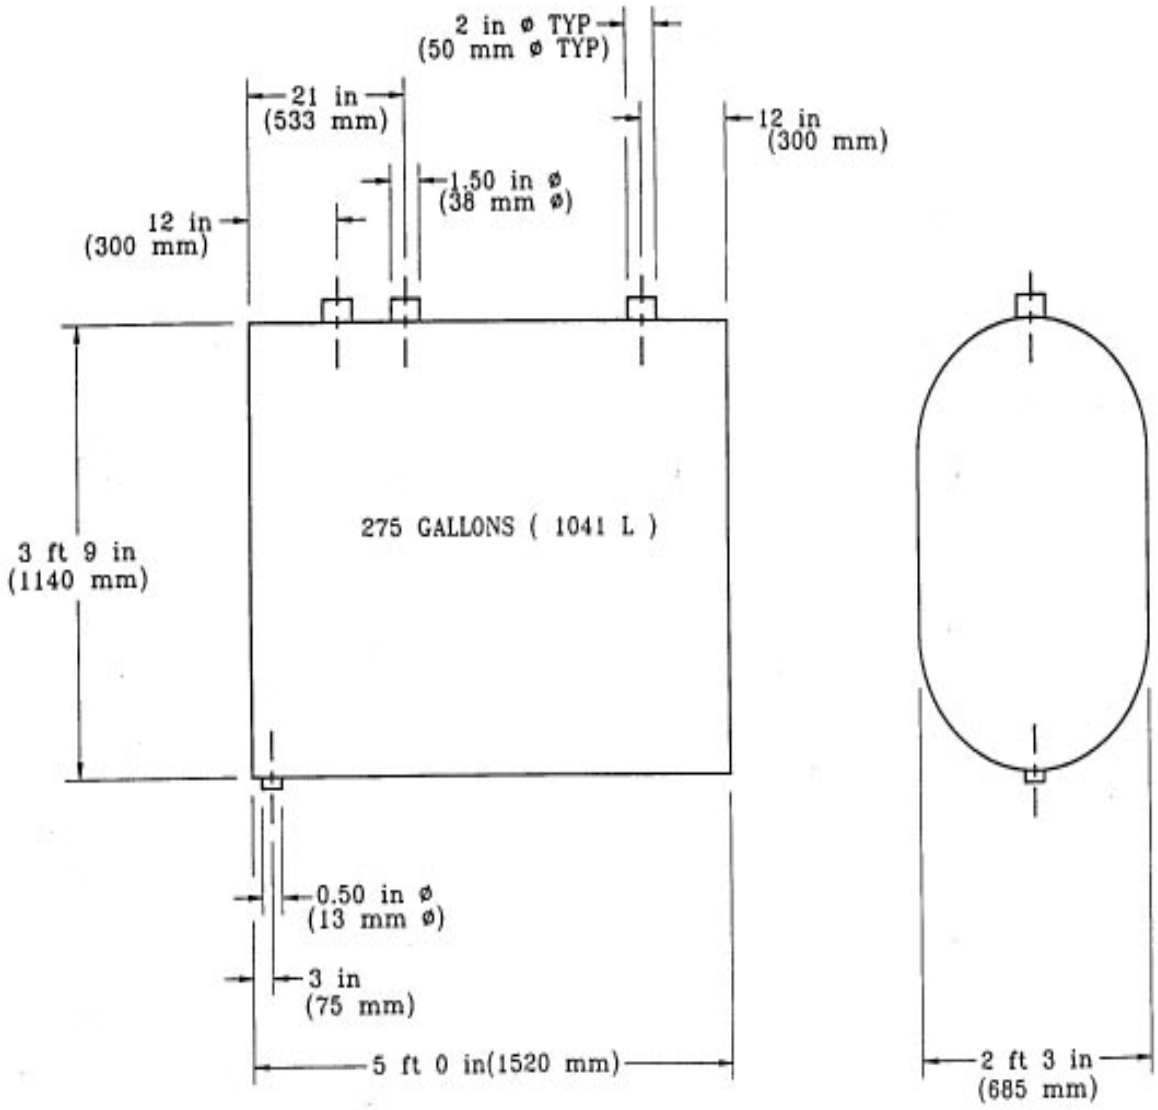

NOTES:

1. All openings internally threaded NPT.
2. Tolerance on dimensions locating openings is ±13 mm (0.50 in).

FIGURE 1. Tank.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2.2 Shell seams. Welding shall be of the continuous or lap type. All lap welds shall have a continuous full fillet the length of the seam.

2.2.3 Mounting brackets. Two 100 by 100 by 6.4 mm (4 by 4 by 0.25 in) steel angle brackets 100 mm (4 in) long shall be welded, with a continuous full fillet weld, on each side of the tank. The brackets shall be located 15 mm (6 in) from the ends of the tank. Each bracket shall be drilled and tapped for a 32 mm (1.25 in) pipe leg.

2.2.4 Fill, vent and gauge openings. Not less than three threaded openings shall be provided in the top of the tank for connection of fill and venting piping, and for installation of a liquid level gauge. All openings on the top of the tank shall be equal in size and not less than a nominal 50 mm (2 in) pipe size.

2.2.5 Top pipe connections. Stamped or forged steel pipe connections shall be furnished by welding threaded flanges to the tank openings. The connections shall be in accordance with the requirements of Underwriters Laboratories Inc., (UL) 80.

2.2.6 Burner supply connection. A threaded opening not less than 13 mm (0.50 in) pipe size shall be provided in the bottom of the tank shell for connection of piping supplying fuel to the oil burner. The center of this opening shall be located not more than 75 mm (3 in) from the end of the shell, and the opening shall be without internal projections to permit complete drainage. A burner supply connection shall not be located in a head.

2.2.7 Treatment and painting. The parts of the tank normally painted shall be cleaned, treated and painted in accordance with the contractor's commercial practice. Unless otherwise specified in the contract, the finish coat shall be camouflage green.

2.2.8 Identification marking number. Each tank shall be marked with the manufacturer's or private labeler's name or identifying symbol. This marking shall be embossed, etched or stamped on a metal nameplate that is permanently attached by welding or brazing. If a manufacturer produces tanks at more than one factory, each tank shall have a distinctive marking to identify it as the product of a particular factory. In addition, identification marking shall include the manufacturer's identification code (CAGE), manufacturer's part number and the part identification number (PIN), A-A-52600 (see 6.2).

2.2.9 Installation marking. Each tank shall be permanently marked with the following: "For proper operation, (1) Upon installation pitch tank longitudinally, toward drain, at least 6.4 mm (0.25 in) per foot of tank length; (2) Vent pipe diameter must be at least equal to fill pipe diameter. A signaling device installed in vent pipe shall not reduce venting capacity; and (3) Consult local authorities before installation of tank". The required marking shall be ink-stamped or paint-stenciled on the tank, or printed on an adhesive-backed label. Minimum letter

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

height shall be 2.4 mm (0.094 in). A contrasting background shall be provided for legibility. An adhesive-backed label shall comply with the applicable Underwriters Laboratories requirements for indoor use labels and exposure to No. 1 and No. 2 fuel oil.

2.2.10 Safety marking. The tank shall be stenciled in 50 mm (2 in) lusterless red letters on both sides of the tank “Flammable - Keep Fire Away”.

3. REGULATORY REQUIREMENTS

3.1 Recovered materials. The offeror/contractor is encouraged to use recovered materials to the extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. The contractor is responsible for the performance of all inspections (examinations and tests).

4.2 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID and that the product conforms to the producer’s own drawings, specifications, workmanship standards, and quality assurance practices. Items with known defects shall not be submitted for Government acceptance. The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

5. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order (see 6.2).

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful but is not mandatory.)

6.1 Addresses for obtaining copies of referenced documents.

6.1.1 Other Government documents. The Code of Federal Regulation (CFR) is available from the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

6.1.2 Non-Government publications. UL document “Steel Inside Tanks for Oil-Burner Fuel - UL80” is available from Underwriters Laboratories, Inc. (UL), 333 Pfingsten Road, Northbrook, IL 60062-2096.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

6.2 Acquisition data. Acquisition documents must specify the following:

a. Title, number, and date of this CID.
b. Issue of Department of Defense Index of Specifications and Standards (DODISS) to be cited in the solicitation, and if required, the specific issue of the individual documents referenced.
c. If painting other than as specified.
d. If marking other than as specified.
e. PIN and quantity of tanks required.
f. Preservation, packing, and marking not as specified in the contract.

6.3 Cross-reference data. Tanks conforming to this CID are interchangeable/substitutable with tanks conforming to MIL-T-462.

MILITARY INTERESTS:

Custodians:
Army - AT
Navy - YD1
Air Force - 99

Review Activities:
Air Force - 84
Navy - MC
DLA - CS

CIVIL AGENCY COORDINATING ACTIVITY:
GSA - FSS

Preparing Activity:
Army - AT

(Project 5430-0241)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.