FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND

SERVICE, TYPE I, SERIES TRIP, THREE POLE

(70 THRU 100 AMPERES)

The complete requirements for procuring the circuit breakers described herein shall consist of this document and the latest issue of Specification W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

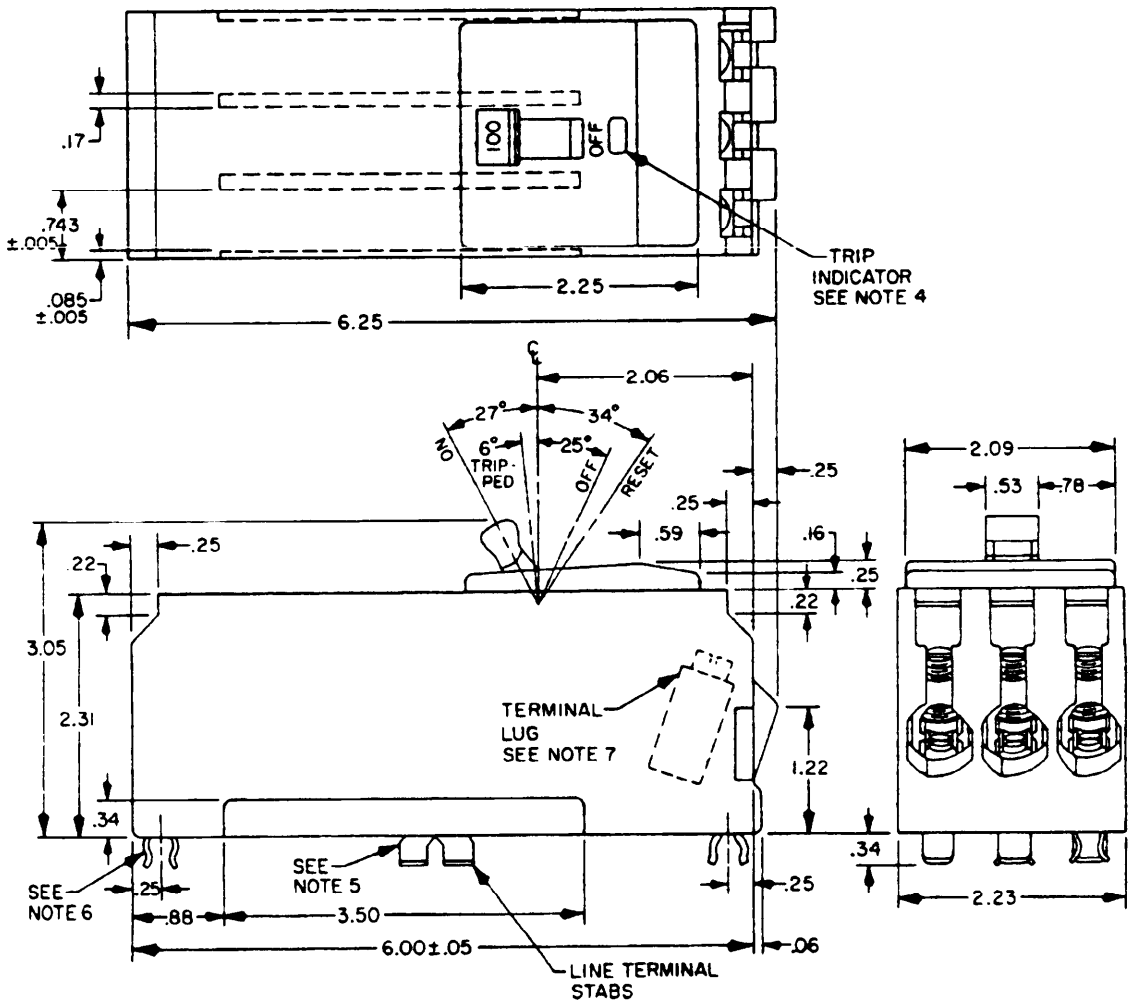


FIGURE 1.

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

INCHES	MM	INCHES	MM	INCHES	MM	INCHES	MM
.005	.13	.22	5.59	.78	19.81	2.25	57.15
.05	1.27	.25	6.35	.88	22.35	2.31	58.67
.06	1.52	.34	8.64	1.22	30.99	3.05	77.47
.085	2.16	.53	13.46	2.06	52.32	3.50	88.90
.16	4.06	.59	14.99	2.09	53.09	6.00	152.40
.17	4.32	.743	18.87	2.23	56.64	6.25	158.75

NOTES:

1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Unless otherwise specified, tolerances are ±.01 (.25 mm) on decimals and ±1° on angles.
4. Red luminescent trip indicator, visible only when breaker is tripped automatically. Window is dark when breaker is in ON or OFF position.
5. Line terminals shall grip a .250 (6.35 mm) wide and .125 (3.18 mm) thick buss bar.
6. Mounting clip shall grip a .250 (6.35 mm) diameter rail.
7. Load terminal lugs shall be suitable for either aluminum or copper wire size No. 6 to No. 0 AWG.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.
  Trip indication - See figure.
  Common trip - All poles shall make and break simultaneously when operated manually or automatically.

Electrical:
  Interrupting current rating - RMS symmetrical - 10,000 amperes.
  Voltage rating - 240 Vac or less.
  Trip current - See table I.
  Frequency - 60 hertz.
  Calibration - At 40°C.

Enclosure for overload, endurance, and short circuit tests - Square D load center Catalog No. Q0412-24, or equivalent.

TABLE I. Part numbers and current rating

Government part number	Current rating
WC375/04-001	70
-002	80
-003	90
-004	100

TABLE II. Supersession and cross reference

Government part number	Superseded number FSCM 56365
WC375/04-001	Q1370
-002	380
-003	390
-004	3100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Navy - YD
Air Force - 85

Review activities:

Air Force - 80
DSA - ES

User activities:

Navy - OS, MC

Civil Agency Coordinating Activity:

DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HEW - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - DMS

Preparing activity:

DSA - ES

Project No. 5925- 0091-4

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 25 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.