
MILITARY SPECIFICATION SHEET

CONNECTORS, RECEPTACLE, FIBER OPTIC, CIRCULAR, HERMAPHRODITIC, JAM-NUT MOUNTING, WITHOUT STRAIN RELIEF, 2 AND 4 POSITIONS

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-C-83526.

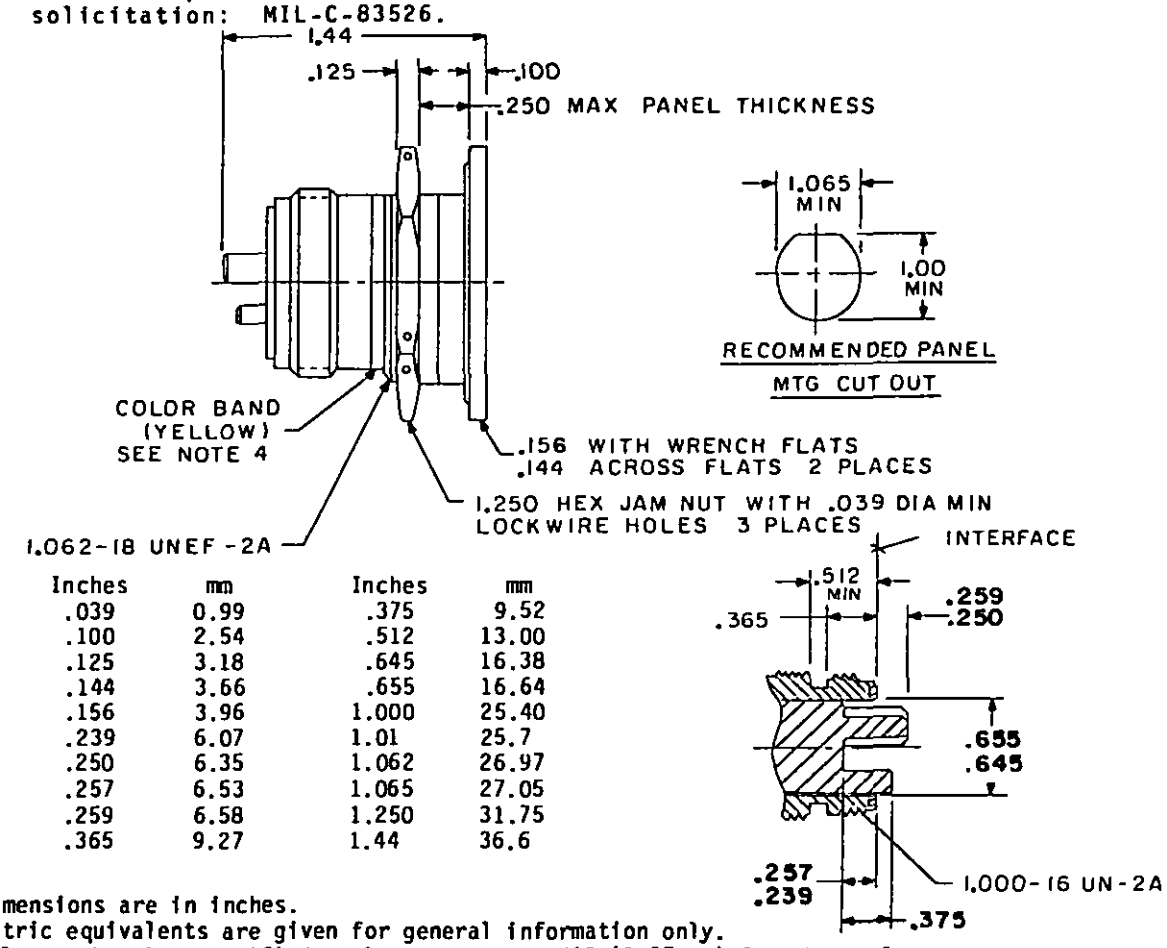


Inches	mm	Inches	mm
.039	0.99	.375	9.52
.100	2.54	.512	13.00
.125	3.18	.645	16.38
.144	3.66	.655	16.64
.156	3.96	1.000	25.40
.239	6.07	1.01	25.7
.250	6.35	1.062	26.97
.257	6.53	1.065	27.05
.259	6.58	1.250	31.75
.365	9.27	1.44	36.6

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.010 (0.25 mm) for three place decimals and ±.03 (0.8 mm) for two place decimals. Angular tolerances are ±0° 30'.
4. The phrase "Fiber-Optic" must be included within the yellow band.
5. Unless otherwise specified, dimensions are symmetrical about centerlines.

FIGURE 1. Jam-nut connector.


DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T08:37Z
Check the source to verify that this is the current version before use.

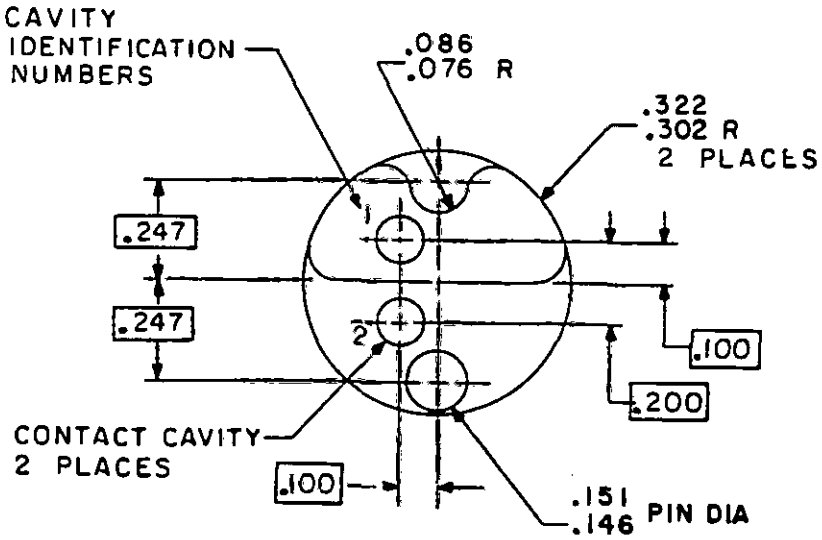

2 Termini connector type 11-01

Inches	mm
.076	1.93
.086	2.18
.100	2.54
.146	3.71
.151	3.84
.200	5.08
.247	6.27
.302	7.67
.322	8.18

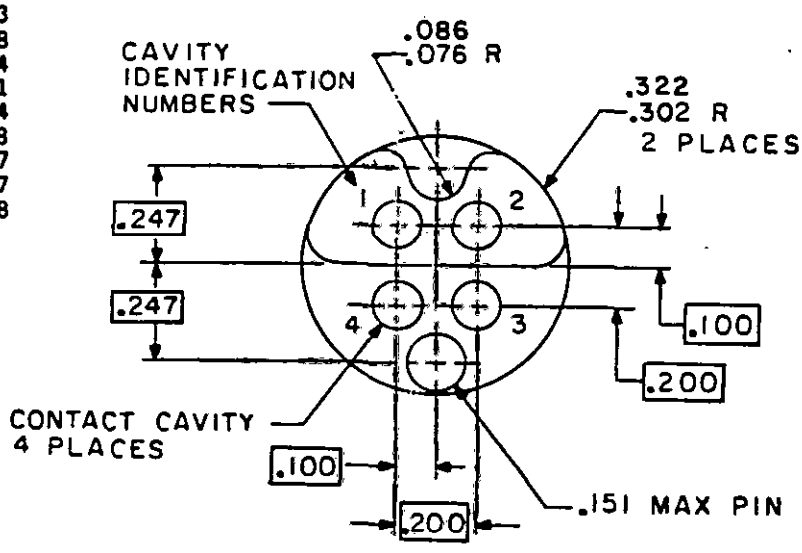

4 Termini connector type 11-02

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.

FIGURE 2. Terminal configuration face view.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T08:37Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction:

Dimensions and configuration: See figures 1 and 2.

Fiber optic cable:

Cable diameter: In accordance with DOD-C-85045.

Cable configuration: In accordance with DOD-C-85045.

Fiber diameter: In accordance with DOD-F-49291.

Fiber numerical aperture: In accordance with DOD-F-49291.

Fiber type: Multimode.

Fiber class: Graded index.

Fiber composition: Glass/glass.

Materials: The material requirements are listed in table I.

Connector termination and assembly tools: As specified in MIL-K-83533.

Cleaning procedures: The cleaning procedures for the connector shall be included with the assembly instructions of the connector.

Termini: The required number of termini shall be supplied with each connector unless otherwise specified (see table II). Style P(pin) or S(socket), see MIL-T-29504/11 and MIL-T-29504/12. For dummy terminus, see MIL-T-29504/3.

Weight: 4 ounces maximum.

Coupling forces: 11.0 pounds.

Coupling torques: 5 inch-pounds minimum.

Fiber optic cable requirements: See DOD-C-85045.

Identification marking:

Part or Identifying Number (PIN): See table II.

PIN: M83526/11-(dash number from table II) (marked on flange of connector.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T08:37Z
Check the source to verify that this is the current version before use.

TABLE I. Material description.

Parts description	Material	Finish
O-rings	Fluorosilicone rubber MIL-R-25988, type I, class 1	None
Dowel pin	CRES 303 Se condition in accordance with ASTM A581 or A582	Passivated QQ-P-35
Compression nut	Aluminum alloy 2011-T3 QQ-A-225/3	Iridite in accordance with MIL-C-5541
Jam nut		Anodized MIL-A-8625, type II, class 2 Color: Gray
Insert		
Connector shell		

TABLE II. PIN's and characteristics.

PIN M83526/11-	Insert arrangement	Cable PIN D85045/2-	Fiber PIN D49291	Termini supplied with connector
01A1	2 termini insert	B1A	/3	Yes
01A2	2 termini insert	C1A	/4	Yes
01B	2 termini insert	N/A	N/A	No
02A1	4 termini insert	B1A	/3	Yes
02A2	4 termini insert	C1A	/4	Yes
02B	4 termini insert	N/A	N/A	No

PIN:

M83526/11- 01 X A, B, or N

Basic specification

Terminus insert arrangement

Cable entry diameter (see table II)

Connector supplied with (A) 50/125 size termini, (B) 100/140 size termini, or (N) without termini

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T08:37Z
Check the source to verify that this is the current version before use.

For quality conformance and periodic inspection, dummy termini shall be used in all unused cavities.

Patent notice: The Government does not have a royalty free license under the following patent for the benefit of manufacturers of the item, either for the Government or for use in equipment to be delivered to the Government.

Patent number	Patent expiration date
US 3,994,564	11/30/1993
US 4,054,366	10/18/1994
US 4,060,308	11/29/1994

Revision letters are not used to denote changes due to the extensiveness of the changes.

CONCLUDING MATERIAL

Custodians:
Army - CR
Navy - EC
Air Force - 85

Review activities:
Army - MI
Navy - AS, SH
Air Force - 11, 17 19, 80, 90, 99
DLA - ES

User activities:
Navy - MC, OS, YD
Air Force - 13, 14

Preparing activity:
Air Force - 85

Agent:
DLA - ES

(Project 6060-0065-11)

☆U.S. GOVERNMENT PRINTING OFFICE: 1989 - 604-033/13092

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T08:37Z
Check the source to verify that this is the current version before use.