MIL-T-3700C
9 April 1979
SUPERSEDING
MIL-T-3700B
18 October 1968

MILITARY SPECIFICATION

TANKS, HOT WATER STORAGE,

(15 GALLON TO 120 GALLON CAPACITY)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers vertical hot water storage tanks.

1.2 Classification. The tanks shall be of the following types, classes and sizes as specified:

Type II - Cement lined steel.
Type III - Copper-silicon alloy.
Type IV - Glass lined steel.

FSC 4520
4410

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: US Army Mobility Equipment Research and Development Command, ATTN: DRDME-DS, Fort Belvoir, VA 22060 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

Class 1 - 100 psig working pressure.
Class 2 - 125 psig working pressure.
Class 3 - 150 psig working pressure.
Sizes:
15-gallon.
30-gallon.
40-gallon.
66-gallon.
82-gallon.
120-gallon.

2. APPLICABLE DOCUMENTS

2.1 Issues of documents. The following documents of the issue in effect on date of invitation for bids or request for proposal form a part of this specification to the extent specified herein:

SPECIFICATIONS

FEDERAL

W-H-196	- Heater, Water, Electrical and Gas Fired, Residential.
QQ-C-591	- Copper-Silicon, Copper-Zinc-Silicon, and Copper-Nickel-Silicon Alloys: Rod, Wire, Shapes, Forgings, and Flat Products, (Flat Wire, Strip, Sheet, Bar, and Plate).
SS-C-1960	- Cement and Pozzoland General Requirements For.
SS-C-1960/3	- Cement Portland.

MILITARY

MIL-T-704	- Treatment and Painting of Materiel.
MIL-B-3180	- Boilers and Related Equipment, Packaging of.

STANDARDS

FEDERAL

FED. STD. No. H28	- Screw-Thread Standards for Federal Services.

MILITARY

MIL-STD-130	- Identification Marking of US Military Property.

Source: https://assist.dla.mil -- Downloaded: 202610-16T21:16Z
Check the source to verify that this is the current version before use.

MIL-STD-889	- Dissimilar Metals.
MIL-STD-1188	- Commercial Packaging of Supplies and Equipment.

(Copies of specifications and standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless otherwise indicated, the issue in effect on date of invitation for bids or request for proposal shall apply.

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

Boiler and Pressure Vessel Code.
Section VIII - "Unfired Pressure Vessels."

(Application for copies should be addressed to the American Society of Mechanical Engineers, 345 East 47th Street New York, NY 10017.)

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

ASTM B88
ASTM B97
ASTM B107

(Application for copies should be addressed to American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103).

AMERICAN IRON AND STEEL INSTITUTE

Steel Products Manual - AISI Sheet Steel.

(Application for copies should be addressed to the American Iron and Steel Institute, 150 East 42nd Street, New York, NY 10017.)

AMERICAN WELDING SOCIETY, INC.

Standard Qualification Procedure
Welding Handbook

(Application for copies should be addressed to American Welding Society, Inc., 2501 NW 7th Street, Miami, FL 33125.)

Source: https://assist.dla.mil -- Downloaded: 202610-16T21:16Z
Check the source to verify that this is the current version before use.

(Technical society and technical association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

3. REQUIREMENTS

3.1 Description. The tanks shall consist of welded cylindrical shells constructed to meet the working pressure specified, (see 6.2) and conforming to Figure 1. Minus head on the tank bottom will be acceptable if this is the standard fabricating practice of the manufacturer. However, total tank volume must remain within the capacity tolerances specified (see 3.8). The tank(s) shall be provided with tappings, a circulating (or dip) tube, and a brass drain valve with threads for connection of an ordinary garden hose. A stand for vertical mounting of the tanks shall be provided by the tank manufacturer. The tanks shall be of the vertical type and be constructed, tested, and marked in accordance with the ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels, and as specified herein. Presence of the ASME Official Code U-symbol stamped or marked on the tank and the furnishing of a copy of the ASME data sheet (Form U-1) may be accepted as evidence that the tank conforms to the ASME rules for Construction of Unfired Pressure Vessels.

3.2 First article. When specified, (see 6.2, 6.3 and 6.7) the contractor shall furnish a tank for examination and test within the time frame specified, (see 6.2) to prove, prior to starting production, that his production methods and choice of design detail will produce tanks that comply with the requirements of this specification. Examination and tests shall be those specified herein.

3.3 Tappings. Unless otherwise specified, (see 6.2) the tanks shall have six nonferrous spud tappings of the size specified in Table I and shall be located as shown in Figure 1 except that the glass lined (Type IV) tanks shall be equipped with all additional 3/4 inch tapping in the center of the top head for the insertion of the anode for the cathodic protection system. The tappings and fittings for copper-silicon (Type III) tanks shall be of the same material as the tank shell. For cement lined (Type II) and for glass lined (Type IV) tanks, the tappings shall be of copper-silicon, brass, stainless steel or admiralty metal. The tappings shall be threaded in accordance with FED-STD-No. H28, shall be equipped with either plugs or caps of the same material alloy as the tapping itself. Threaded plastic plugs will be acceptable when specified (see 6.2). The tapping on top of the tank in which the circulating or dip tube is

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

installed shall be marked COLD WATER INLET. The other top tapping shall be marked HOT WATER OUTLET. The markings shall be stamped into the tank head or shall be on securely attached metal plates or decals.

Table I

Capacity (Gallons)	Tapping size (inches) NPT
15	3/4
30	3/4
40	3/4
66	1
82	1
120	1-1/2

3.4 Circulating or dip tube. Unless otherwise specified (see 6.2), each copper-silicon (Type III) tank shall be equipped with a 3/4-inch circulating tube made from Type "L" hard-drawn copper tubing conforming to ASTM B88. The circulating tube in cement lined (Type II) and in glass lined (Type IV) tanks shall be made of tinned copper or brass or stainless steel. In addition the outside surface of the dip tubes in the glass lined tanks shall be insulated with a polypropylene sheath. A 1/4-inch diameter hole shall be drilled through one wall of the tubing 5 inches from the connected end. The lengths of the dip tubes shall be 6 inches less than the length of the tank shells. Nonmetallic dip tubes will not be acceptable.

3.5 Unions. When specified (see 6.2), two straight unions shall be furnished with each tank. Unions for glass-lined steel tanks and cement-lined steel tanks shall be brass and for copper-silicon alloy tanks shall be of the same material alloy as used for the tanks and shall conform to ASTM B97.

3.6 Drain valve. When specified (see 6.2), a brass drain valve shall be provided with each tank by the tank manufacturer. One end of the drain valve shall be threaded for installation in the bottom tapping of the tank. The other end shall be threaded to accommodate a 3/4-inch garden hose coupling.

3.7 Mounting stand. When specified (see 6.2), a mounting stand shall be furnished with each tank. The stand shall be either steel, cast or malleable iron for vertical mounting of the water tank. The stand shall be

Source: https://assist.dla.mil -- Downloaded: 202640-16T21:16Z
Check the source to verify that this is the current version before use.

approximately 20 inches high and may be of either the fixed or the adjustable type. A ring base, angle iron base, or pipe legs with floor flanges are acceptable. The stand shall be painted black in the manufacturer's standard finish.

3.8 Capacity. The storage capacity of each tank shall be within plus or minus 7.5 percent of the nominal rated capacity.

3.9 Identification marking. When specified (see 6.2), each tank shall be identified in accordance with MIL-STD-130. Normally the manufacturer's standard commercial markings are acceptable. Each tank shall be marked with a decal stating: "THIS TANK IS EQUIPPED WITH AN INTERNAL DIP TUBE IN COLD WATER INLET FOR VERTICAL TANK INSTALLATION".

3.10 Treatment and painting. When specified (see 6.2), exterior surfaces of the tanks shall be cleaned, treated, and painted in accordance with MIL-T-704, Type A. Normally the manufacturer's standard commercial finish is acceptable.

3.11 Type II, cement lined steel tanks. The cement lined tanks shall be specified in the 82 gallon and 120 gallon sizes only. The tanks shall be constructed of sheet steel in accordance with AISI steel products manual. These tanks shall be completely assembled before the lining is applied. No welding will be permitted after the lining is installed. The minimum diameter of the Type II tanks shall be 24 inches and the bottom drain tapping shown in Figure 1 shall be replaced by a minimum size 11 inch by 15 inch manhole assembly. The manhole and cover shall be constructed in such a manner that only the lining and nonferrous metal is in contact with the water. The manhole cover shall be constructed of non-ferrous metal or hot dipped galvanized steel as specified (see 6.2 and 6.5).

3.11.1 Cement lining. The cement lining shall be a low-soluble hydraulic cement containing not more than 35 percent calcium oxide and not less than 25 percent silica. The remaining dry aggregate shall be cement conforming to SS-C-1960 and SS-C-1960/3 type optional. The lining material shall be applied in one or two coats. When two coats are used the first coat shall be 3/8- to 1/2-inch thick and the second coat shall be 1/8- to 1/4-inch thick to provide a uniform thickness of 5/8 inch. Both coats shall be applied the same day. Curing time of the first coat shall only be sufficient to insure a good bond between the lining and the steel surface of the tank, but shall not affect the bond between the two coats of lining. The lining material shall be cured, and shall adhere firmly

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

to and completely cover the interior of the tank. The joint between lining and tank at the tappings shall be sealed to prevent corrosion in back of the lining. The water absorption of the lining shall be not more than 17 percent of the dry weight.

3.12 Type III, copper-silicon-alloy tanks. The copper-silicon alloy tanks shall be fabricated of material conforming to QQ-C-591, Copper Alloy No. 655 soft temper, or ASTM B97, Copper Alloy UNS No. C65100 or C65500.

3.13 Type IV, glass-lined-steel tanks. The glass lined tanks shall be constructed of sheet steel with welded seams in accordance with AISI steel products manual. The tanks may be of two piece construction; i.e. the shell and one head may be lined in one operation and the single bottom shell in a second operation. The two pieces may be welded together after the lining is applied. In order to facilitate this construction a flat continuous metal ring may be inserted inside the shell or the head at the final joining weld. This ring shall be lined with glass on the parts which will be exposed to the water and shall have sufficient mass to dissipate the heat of the final welding operation and prevent damage to the glass lining. The ring shall be welded to either the shell or the separate single head before the final joining operation and receive its glass lining at the same time as the attaching piece. If a minus head is used for the tank bottom the ring described above may not be necessary.

3.13.1 Materials. Glass-lining formulation shall contain not less than 70 percent of refractory oxides such as silicon oxide, aluminum oxide, calcium oxide, magnesium oxide, titanium oxide, or zirconium oxide. The proportion of silicon oxide shall be not less than 70 percent of the refractory oxides and shall be not less than 49 percent of the total quantity of the components of the glass lining formulation. The glass lining shall be fused to the steel base by firing at not less than 1500° F.

3.13.2 Metal preparation. All interior surfaces of tanks, including welds and manhole and handhole covers, when applicable, shall be prepared for glass coating by sand blasting, grit blasting or by pickling in a acid bath.

3.13.3 Glass lining. The glass lining shall be continuous over the entire interior surface of the tank including handhole and manhole covers. The lining may be applied with a primer coat. Holidays or voids in the lining that expose steel surfaces shall average not more than 0.02 square inch per square foot of the interior surface with no single defect larger than 0.0625 square inch. The thickness of the glass lining shall

Source: https://assist.dla.mil -- Downloaded: 202610-16T21:16Z
Check the source to verify that this is the current version before use.

be not less than 0.006 inch or greater than 0.015 inch. The solubility of the glass lining shall be in accordance with the test and requirements specified in W-H-196.

3.14 Cathodic protection. Cathodic protection shall be provided for each Type IV tank. With the tank filled with water having a specific conductance in the range of 400 to 600 micromhos, the tank wall potential shall be not more than minus 0.85 volt in reference to a standard copper sulphate cell located inside the tank adjacent to but not in contact with the tank shell and at a maximum distance from the anode or anodes. The anode or anodes shall be located so as to insure equal protection to all interior parts of the vessel. An electrical connection shall be established and maintained between the anode and the metal tank shell. Magnesium anodes employed for cathodic protection shall be fabricated from material conforming to ASTM B107 Alloy AZ31B, with the following exceptions:

Copper - percent maximum 0.01
Nickel - percent maximum 0.001
Iron - percent maximum 0.002

Shape of anodes shall be as applicable and anodes shall be reinforced with steel wire not less than 0.091 inch in diameter. The weight of the anode or anodes in each tank shall be not less than 25 grams per square foot of surface within the tank shell. Anodes constructed with an integral hot water outlet for insertion into a single tank tapping are acceptable for tanks with outlet tappings no larger than 3/4 inch.

3.15 Standard product. Except as otherwise specified herein, the tank shall be the standard product of the manufacturer and shall be identifiable by the manufacturer's model number, figure number, or equivalent designation. The equipment shall be new and unused except to the extent required to perform the tests specified herein.

3.16 Interchangeability. All parts having the same part number shall be functionally and dimensionally interchangeable. Interchangeable parts are defined as two or more like parts possessing such functional and physical characteristics as to be equivalent in performance and durability, and capable of being exchanged one for the other without alteration of the parts themselves or of adjoining parts, except for adjustment, and without selection for fit or performance.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

3.17 Threaded parts. All threaded parts shall conform to FED-STD-No. H28.

3.18 Dissimilar metals. There shall be no contact between dissimilar metals which could cause deterioration, galvanic corrosion, seizure, or warpage through differential contraction or expansion except as specified. Nonpermissible galvanic couples (dissimilar metals) as defined in MIL-T-704 and MIL-STD-889 shall be insulated as specified in MIL-T-704.

3.19 Workmanship. All parts, components and assemblies of the tanks including castings, forgings, molded parts, stamping, bearings, seals, machined surfaces, and welded parts shall be clean and free from sand, dirt, fins, pits, sprues, scales, or any damaging extraneous material. The tanks shall be free of any defect that could impair operation and serviceability.

3.19.1 Fabrication. Steel, brass, copper and copper-silicon used in the fabrication of the tanks shall provide original quality surface finish and shall be free from kinks and sharp bends. The forming of the material shall be done by methods that will not cause damage to the metal. Shearing and chipping shall be done neatly and accurately. Corners shall be square and true, and sharp edges and burrs shall be removed. Flame-cutting may be employed instead of shearing and sawing. Burned surfaces of flame-cut material shall be ground or machined sufficiently to remove ash and cooling checks. Precautions shall be taken to avoid overheating, and heated metals should be allowed to cool slowly. All bends of a major character shall be made with metal dies or fixtures to insure uniformity of size and shape.

3.19.2 Welding. The surfaces of parts being welded shall be free of scale, paint, grease, and other foreign matter. Welds shall transmit stress without permanent deformation or failure when the parts connected by the welds are subjected to test and service loading. All welds shall be in accordance with American Welding Society Standard Qualification Procedure.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsiblity for inspection. Unless otherwise specified in the contract, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

Source: https://assist.dla.mil -- Downloaded: 202640-16T21:16Z
Check the source to verify that this is the currentversion before use.

4.1.1 Component and material inspection. The contractor is responsible for insuring that components and materials used are manufactured, examined and tested in accordance with referenced specifications and standards.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

(a) First article inspection (see 4.3).
(b) Quality conformance inspection (see 4.4).
(c) Inspection of packaging (see 4.7).

4.3 First article inspection.

4.3.1 Examination. The first article shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.3.2 Tests. The first article tank(s) shall be tested as specified in 4.5.2 as applicable for the type and class to be furnished. Failure of any test shall be cause for rejection. A test log shall be furnished to the Government.

4.4 Quality conformance inspection.

4.4.1 Examination. Each tank shall be examined as specified in 4.5.1.

4.4.2 Samples. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1. Acceptable Quality Level (AQL) shall be 2.5 percent defective.

4.5 Inspection procedure.

4.5.1 Examination. The tanks shall be examined for the following defects:

Major

101. Type of tank and materials and lining not as specified.
102. Components missing, damaged or not as specified.
103. Tappings not provided or not as specified or of improper size and material.
104. Components comprising cement or glass lining material not as specified.
105. Areas with no lining, lining not dry, evidence of rust, corrosion, and runs and sags.
106. Lack of ASME stamp.
107. Size of tank not as specified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

108. Tank mounting stand not provided.
109. Treatment and painting not as specified.
110. Missing or improper identification markings.
111. Sharp edges, points, or corners, welding burrs, excessively long tappings, yokes and fastening devices.

4.5.2 Tests.

4.5.2.1 Capacity. Determine the storage capacity of the tank by weighing the empty tank and then fill the tank with water and reweigh. Convert the liquid capacity of the tank to U. S. gallons. Nonconformance to 3.3 and 3.8 shall constitute failure of this test.

4.5.2.2 Cement lining thickness. Determine the thickness of the lining by spear measurements with a hardened steel point not larger than 1/16 inch in diameter. Take not less than three measurements at random locations immediately after application of each coat and before the lining has set. Nonconformance of any measurement to 3.11.1 shall constitute failure of this test.

4.5.2.3 Cement lining absorption. Determine the water absorption of cement lining materials by immersing dry specimens of the materials in water and comparing the weights of the specimens before and after the immersion. The test specimens shall be approximately 4-inch squares of clean, dry tank steel, lined on one side with cement lining that is identical in mix, thickness, method of application, and curing process to the linings used. Accurately determine and record the weight of each steel square before the lining is applied. Determine the dry weight of the lining material as follows: Heat the lined test specimens at a temperature of not less than 230° F for a period of not less than 2 hours, cool to room temperature and weigh. The difference between the weights of corresponding unlined steel squares and the heated specimens is the dry weight of the lining material. Determine the water absorption of the lining in the following manner. Immediately after heating and weighing, immerse the test specimens for a period of 5 hours in distilled water that is maintained at a temperature of 180° F to 190° F. At the end of this period, cool the specimens in water to room temperature, remove from the water, wipe dry, and immediately weigh. The difference between the weights of the test specimens before and after immersion is the weight of the water absorbed and shall be reported as a percentage of the dry weight of the lining material. Use the mean value of at least two specimens to determine the weight of the water absorbed. A water absorption of more than 17 percent of the dry weight shall constitute failure of this test.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

4.5.2.4 Cathodic protection. Measure the tank wall potential relative to a standard copper sulphate half cell before and after installation of the anode or anodes. Locate the copper sulphate half cell inside the tank adjacent to the tank shell at maximum distance from the anode or anodes. Use a portable potentiometer or high-resistance voltmeter to measure the potential. Nonconformance to 3.14 shall constitute failure of this test.

4.5.2.5 Glass lining thickness. Measure the thickness of glass lining at not less than 20 representative points on the shell and heads of the tank using a calibrated magnetic or similar thickness gage. Nonconformance to 3.13.3 shall constitute failure of this test.

4.5.2.6 Glass lining continuity. Test the entire glass-lined surface of the tank using a thin film detector. Nonconformance to 3.13.3 shall constitute failure of this test.

4.5.2.7 Hydrostatic tests. Each tank shall be subject to such hydrostatic tests as required by the ASME Code, Section VIII, "Unfired Pressure Vessels". These tests may be carried out prior to installation of the tank lining. If this procedure is followed, the tank must be retested at the specified working pressure to prove the suitability of the lining and the test pressure must be maintained for a period of 30 minutes. Damage to the lining such as cracking or deformation shall constitute failure of this test.

4.6 Inspection comparison. The Government may select tanks at any time during the contract production period and subject these tanks to the examination and tests specified herein to determine that the quality of the selected tanks is equal to the quality standards established during quality conformance inspection. The inspection will be performed by the Government at a site selected by the Government. Tanks will be selected at random from those which have been accepted by the Government and will not include the previously inspected first article and quality conformance units. Failure of any tanks may be considered cause for refusal by the Government to continue acceptance of tanks until objective evidence furnished by the contractor reveals that corrective action has been taken to eliminate the condition which caused the rejection.

4.7 Inspection of packaging. Level A or Level B preservation, packing, and marking shall be examined and tested in accordance with the Quality Assurance Provisions of MIL-B-3180. Commercial preservation, packing and marking shall be examined for conformance to MIL-STD-1188. Level A, Level B

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

and Commercial shall be examined for conformance to the additional requirement specified herein in 5.1 for Type II tanks.

5. PACKAGING

5.1 Preservation, packing, and marking. Preservation, packing and marking shall be Level A, Level B or Commercial as specified (see 6.2). Level A or Level B shall be in accordance with MIL-B-3180. Commercial shall be in accordance with MIL-STD-1188. In addition, all cement lined tanks (Type II) processed for Level A, Level B or Commercial shall be shipped and stored sealed with 6 to 12 inches of water in the tank to prevent deterioration to the lining.

6. NOTES

6.1 Intended use. The tanks are intended for storing potable service hot water. The tanks are primarily intended for vertical installation and must be connected to a separate heater.

6.2 Ordering data. Procurement documents should specify the following:

(a) Title, number, and date of this specification.
(b) Type, class and size required (see 1.2 and 3.1).
(c) When a first article is required and time frame required for submission (see 3.2).
(d) Tappings required if other than as specified (see 3.3).
(e) When threaded plastic plugs are acceptable for tank tappings (see 3.3).
(f) When circulating or dip tube is not required or if other than as specified (see 3.4).
(g) When unions are required (see 3.5).
(h) When brass drain valves are required (see 3.6).
(i) When a mounting stand is required (see 3.7).
(j) When identification markings in accordance with MIL-STD-130 is required (see 3.9).
(k) Whether treatment and painting of exterior surfaces shall be in accordance with MIL-T-704 (see 3.10).
(l) Whether nonferrous or hot dipped galvanized steel manholes are desired (see 3.11 and 6.5).
(m) Degree of preservation and degree of packing required (see 5.1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

6.3 First article. When first article tank is specified, any changes or deviations of production tanks from the approved first article during production will be subject to the approval of the contracting officer. Approval of the first article will not relieve the contractor of his obligation to furnish tanks conforming to this specification.

6.4 General information. The most popular hot water storage tank in use today is Type IV, glass lined tank with cathodic protection. These tanks are relatively low in price and with cathodic protection will have a reasonably long service life. The cathodic protection feature is an important part of a glass lined tank and will insure maximum life. No glass lining is without imperfections and the anode of the cathodic protection system protects the exposed or unlined metal parts. For tanks larger than 120 gallons or for tanks made from different materials, refer to MIL-T-12295. These storage tanks are a standard commercial product readily available from many manufacturer's. Therefore, it is advisable from an economic point of view not to impose special military requirements for components, tests, shipping, marking and finishing unless definite special requirements exist.

6.5 Cement lined tanks. Cement lining is not practical for tanks with diameters smaller than 24 inches. An access opening in the form of a manhole must be provided in such tanks to facilitate the application of the lining. The minimum size of the manhole should be 11 inches by 15 inches and the minimum tank diameter for acceptance of this size opening is 24 inches. Therefore, only the two larger tank sizes should be specified for this type of lining. Note also that cement lining is susceptible to damage in shipment. When water conditions are known to be noncorrosive, hot dipped galvanized manhole covers may be specified for cement lined tanks. Generally, however, nonferrous covers are necessary and preferred.

6.6 Copper-silicon tanks. Copper-silicon tanks are excellent for corrosive water service and may last as long as the building in which installed. This offsets the high initial cost.

6.7 First article test. When first article tests are required, appropriate provisions should be included in the contract, to allow the contracting officer to waive completely or in part the first article tests and reduce the bid price accordingly if the successful bidder has previously performed any or all of the first article tests in recent procurements, or if quantities involved are less than 10. When the

Source: https://assist.dla.mil -- Downloaded: 202640-16T21:16Z
Check the source to verify that this is the current version before use.

contract allows for waiver of first article tests, the contract should require that the successful bidder seeking such a waiver submit satisfactory evidence, including test and inspection reports that the tests have been performed successfully in the past and additional information such as the contract identification, the procuring activity, the date, and other pertinent data deemed necessary by the contracting officer. If the first article tests are desired, the contracting officer will normally elect to have these performed at the manufacturer's plant. He may also elect to have these tests performed at a Government laboratory, or at an independent private test organization. Note that deletion of first article tests does not delete the tests required by Section VIII of the ASME Code.

6.8 Recycled material. It is encouraged that recycled material be used when practical as long as it meets the requirements of the specification.

Custodians:
Army - ME
Air Force - 99

Review activities:
Army - CE
DLA - CS

Preparing activity:
Army - ME

Project 4520-0227

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

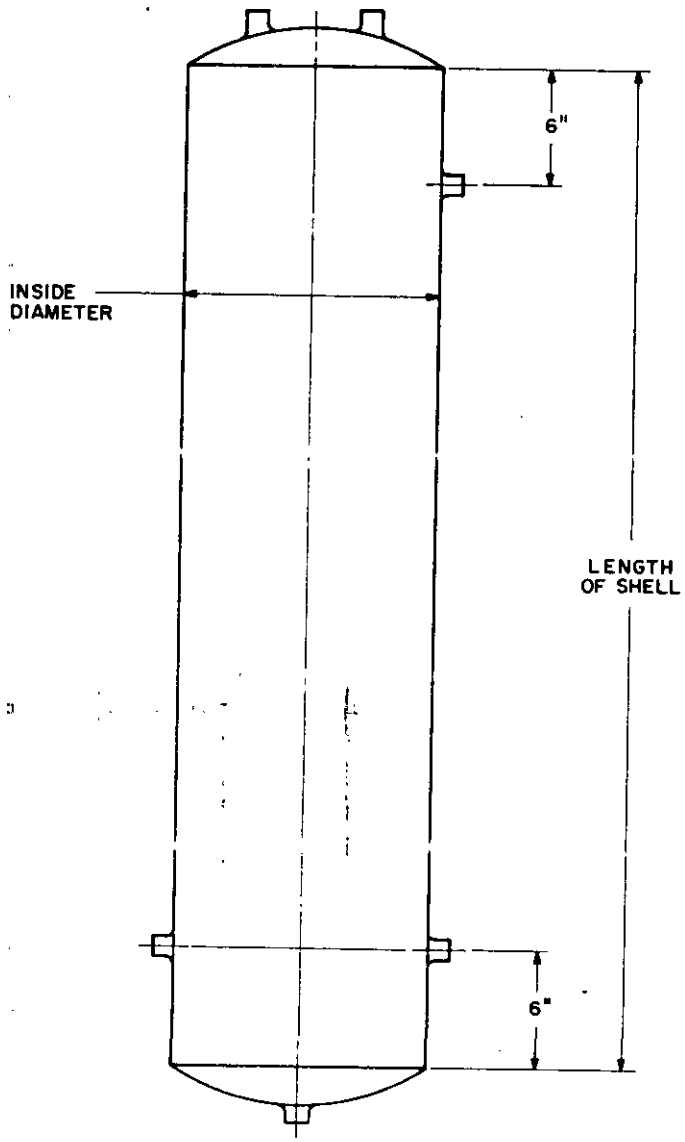


FIGURE 1. TANK, VERTICAL, STORAGE, HOT WATER. LOCATION OF SPUD TAPPINGS.
DX-1316

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

FOLD

POSTAGE AND FEES PAID
DEPARTMENT OF THE ARMY
DOD – 314

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

Commander
US Army Mobility Equipment Research
and Development Command
ATTN: DRDME-DS
Ft. Belvoir, VA 22060

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T21:16Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

OMB Approval
No. 22-R255

INSTRUCTIONS: The purpose of this form is to solicit beneficial comments which will help achieve procurement of suitable products at reasonable cost and minimum delay, or will otherwise enhance use of the document. DoD contractors, government activities, or manufacturers/vendors who are prospective suppliers of the product are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity.

DOCUMENT IDENTIFIER AND TITLE: MIL-T-3700C Tanks, Hot Water Storage, (15 Gallon to 120 Gallon Capacity)

NAME OF ORGANIZATION AND ADDRESS	CONTRACT NUMBER
	MATERIAL PROCURED UNDER A ☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?
   A. GIVE PARAGRAPH NUMBER AND WORDING.

   B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2. COMMENTS ON ANY DOCUMENT REQUIREMENT CONSIDERED TOO RIGID

3. IS THE DOCUMENT RESTRICTIVE?
   ☐ YES ☐ NO *(If "Yes", in what way?)*

4. REMARKS

SUBMITTED BY *(Printed or typed name and address - Optional)*	TELEPHONE NO.
	DATE

DD FORM 1 JAN 72 1426 REPLACES EDITION OF 1 JAN 66 WHICH MAY BE USED

Source: https://assist.dla.mil -- Downloaded: 202610-16T21:16Z
Check the source to verify that this is the current version before use.