INCH-POUND

A-A 55509
July 4, 1994

COMMERCIAL ITEM DESCRIPTION

FUSE, INDICATOR ALARM

The General Services Administration has authorized the use of this commercial item description (CID)

Abstract This CID covers the general requirements for indicator, alarm fuses Fuses covered by this CID are intended for commercial/industrial applications.

Part or Identifying Number (PIN) The PIN for the CID shall be as shown in the following example

A-A-55509	-	001
CID number		Dash number (see table I)

Salient characteristics

Ampere rating The ampere rating shall be as specified in table I

Voltage rating The voltage rating shall be 125 V ac, 60 V dc

Blow time The blow time shall be as specified in table II

Design and construction Fuses supplied to this CID shall be as specified herein (see figure 1)

Fuse body The fuse body shall be black phenolic with UL 94HB flammability rating as a minimum

Contacts Contacts shall be bright alloy plated beryllium copper


Corresponding fuseholder The corresponding fuseholder is specified in CID A-A-55510

Marking Fuses supplied to this CID shall be marked with the manufacturer's standard commercial PIN

Regulatory requirements This section is not applicable to this CID

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

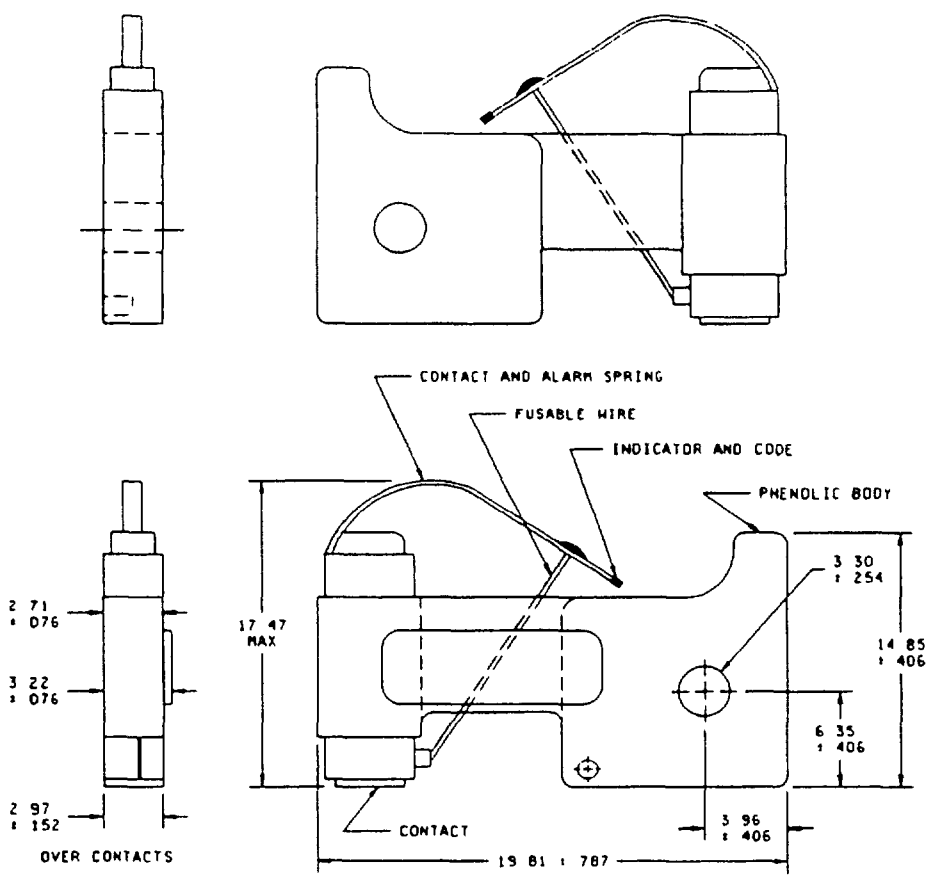

mm	Inches	mm	Inches
0 076	003	3 22	127
0 152	006	3 30	130
0 254	010	3 96	156
0 406	016	6.35	.250
0 787	031	14 85	585
2.71	107	17 47	.688
2 97	117	19.81	780

NOTES:
1 Dimensions are in millimeters
2 Tolerance is ±0 13 millimeter (005 inch)
3 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Figure 1 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

TABLE I Electrical characteristics.

A-A-55509	Ampere rating	Flag color code 1/
001	18	Yellow
002	.25	Violet
003	.5	Red
004	.65	Black
005	.75	Brown
006	1	Gray
007	1 33	White
008	1.5	White/Yellow
009	2	Orange
010	2.5	White/Orange
011	3	Blue
012	3 5	Blue/White
013	4	Brown/White
014	5	Green
015	7 5	Black/White
016	10	Red/White
017	12	Yellow/Green
018	15	Red/Blue

1/ Indicator flag is color-coded for easy amperage identification

TABLE II Rating versus blow time.

Rating	Blow time
100 percent	10 minutes, minimum
150 percent	5 minutes, maximum

Quality assurance provisions.

Responsibility for inspection Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection, examination, and test requirements specified herein Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the inspection requirements specified herein, unless disapproved by the Government The Government reserves the right to perform any of the inspections, examinations, or tests set forth in this description where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

Contractor certification statement The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract

Certificate of compliance A certificate of compliance shall accompany all indicator alarm fuses supplied to this CID The letter of certification shall state that the indicator alarm fuse meets all the requirements of this CID

Packaging

Preservation, packaging, packing, labeling, and marking Preservation, packaging, packing, labeling, and marking shall be as specified in the contract or purchase order.

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory.

Government users. To acquire information on obtaining these indicator alarm fuses from the Government inventory system, please contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106.

Referenced documents. The following documents, of the issue in effect on date of invitation for bids for request for proposal, form a part of this CID to the extent specified herein

Commercial Item Description

A-A-55510 - Fuseholder, Block For Indicator Alarm Fuses

(Copies of the Commercial Item Description are available from the Defense Printing Service Detachment Office, Building 4D, (Customer Service), 700 Robbins Avenue, Philadelphia, PA 19111-5094)

Other publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 94HB - Safety Tests for Flammability of Plastic Materials for Parts in Devices in Appliances, Standard For

(Applications for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096)

Ordering data The contract or purchase order should specify the following

a. CID document number and revision and CID PIN.

b Quality assurance provisions

c. Packaging requirements

Comments Comments on this CID should be directed to Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

Suggested sources of supply Suggested sources of supply are listed herein Additional sources will be added as they become available

CID dash number (see table I) A-A-55509-	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	GMT 18/100	401 180
002	GMT 1/4	401.250
003	GMT1/2	401 500
004	GMT 65/100	401 650
005	GMT3/4	401.750
006	GMT 1	401001
007	GMT 1-1/3	4011 33
008	GMT 1-1/2	40101.5
009	GMT 2	401002
010	GMT 2-1/2	40102.5
011	GMT 3	401003
012	GMT 3-1/2	40103.5
013	GMT 4	401004
014	GMT 5	401005
015	GMT 7-1/2	40107 5
016	GMT 10	401010
017	GMT 12	---
018	GMT 15	---

Vendor CAGE number	Vendor name and address
71400	Bussmann P O Box 14460 St Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

Project 5920-D228

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.