COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK FOR INDICATOR ALARM FUSES

The General Services Administration has authorized the use of this commercial item description (CID)

Abstract. This CID covers the general requirements for a fuseholder block which accommodates indicator alarm fuses. Fuseholders covered by this CID are intended for commercial/industrial applications

Part or Identifying Number (PIN) The PIN for the CID shall be as shown in the following example.

A-A-55510 - 001

A-A-55510: CID number

001: Dash number (see table I)

Salient characteristics

Design and construction Fuseholders supplied to this CID shall be as specified herein (see figure 1)

Ampere rating The ampere rating shall be 15 amperes maximum.

Voltage rating The voltage rating shall be 125 V ac, 60 V dc

Fuseholder characteristics Fuseholder characteristics shall be as specified in table I.

TABLE I Characteristics

CID PIN A-A-55510-	Configuration (see figure 1)
001	A
002	B

Marking. Fuseholders supplied to this CID shall be marked with the manufacturer's standard commercial PIN


Fuseholder body The fuseholder body shall be black phenolic with UL 94HB flammability rating as a minimum

Fuse accommodation. This fuseholder accommodates CID A-A-55509 indicator alarm fuses

Regulatory requirements This section is not applicable to this CID.

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited


Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

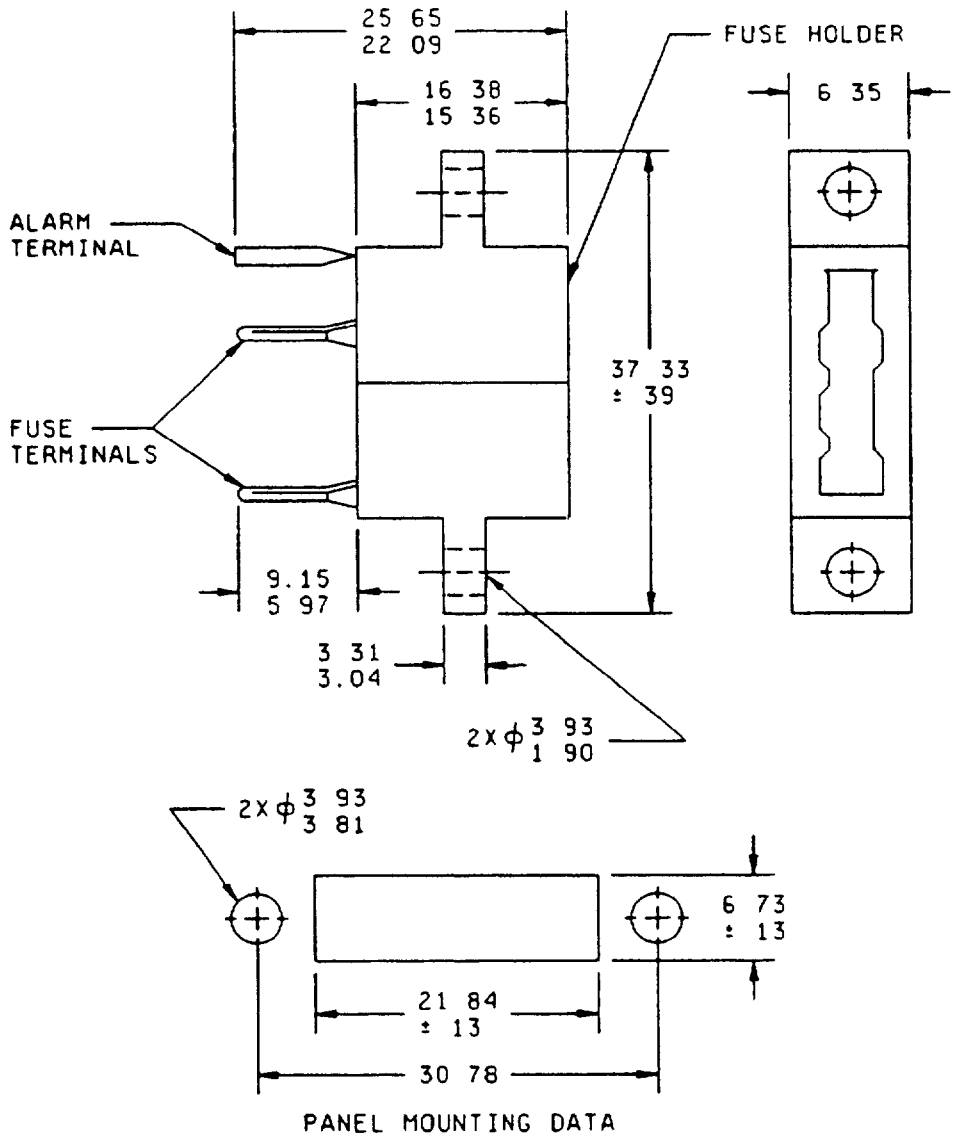

Configuration A

Figure 1 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

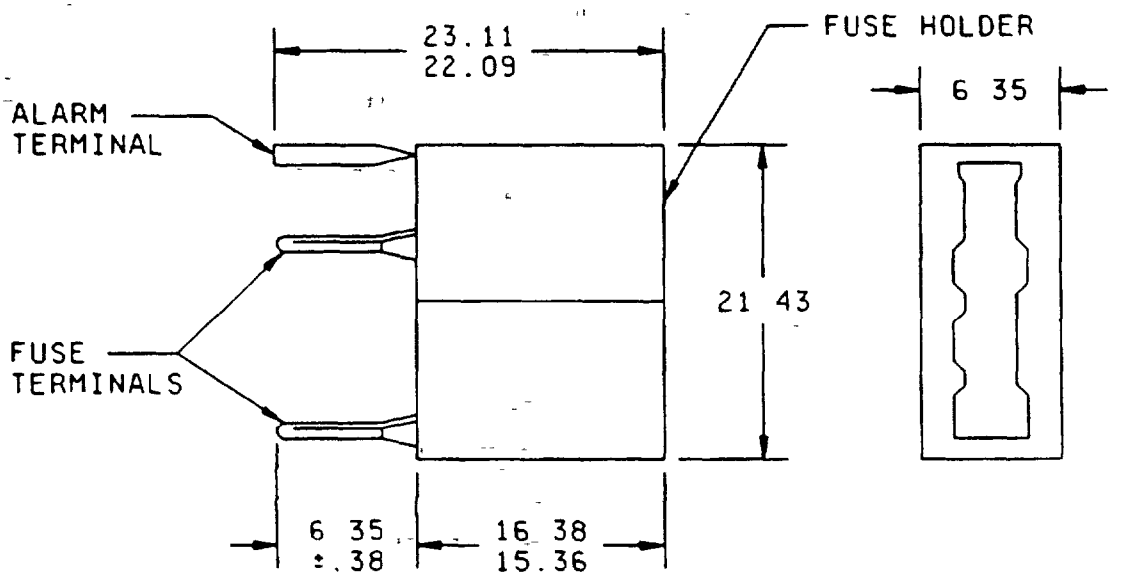

Configuration B

mm	Inches	mm	Inches
0 13	005	9 15	360
0.38	.014	15.36	605
0.39	.015	16.25	.640
1 90	.075	16.38	.645
3 04	120	21 43	844
3 31	.130	21.84	.860
3 81	.150	22.09	.870
3 93	.155	23 11	910
5.97	.235	25.65	1.01
6 35	.250	30 78	1 21
6 73	.265	37.33	1 47

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ±0 13 mm (.005 inch)
3 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Figure 1 Configuration and dimensions Continued

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

Quality assurance provisions

Responsibility for inspection The contractor is responsible for the performance of all inspection, examination, and test requirements specified in the contract or purchase order The contractor may use his own or any other facilities suitable for inspection requirements specified in the contract or purchase order, unless otherwise disapproved by the acquiring activity The acquiring activity reserves the right to perform any of the inspections set forth in the contract or purchase order where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements

Contractor certification statement. The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample The acquiring activity reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract

Certificate of compliance A certificate of compliance shall accompany all fuseholder blocks supplied to this CID The letter of certification shall state that the fuseholder block meets all the requirements of this CID.

Packaging

Preservation, packaging, packing, labeling, and marking Preservation, packaging, packing, labeling, and marking shall be as specified in the contract or purchase order

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory

Government users To acquire information on obtaining these fuseholder blocks from the Government inventory system, please contact Defense Electronics Supply Center, ATTN. DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106.

Referenced documents. The following documents, of the issue in effect on date of invitation for bids for request for proposal, form a part of this CID to the extent specified herein

Commercial Item Description

A-A-55509 - Fuse, Indicator Alarm

(Copies of the Commercial Item Description are available from the Defense Printing Service Detachment Office, Building 4D, (Customer Service), 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 94V0 - Safety Tests for Flammability of Plastic Materials for Parts in Devices in Appliances, Standard For.

(Applications for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096)

Ordering data The contract or purchase order should specify the following

a CID document number and revision and CID PIN

b Quality assurance provisions

c Packaging requirements

Comments Comments on this CID should be directed to Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

Suggested sources of supply. Suggested sources of supply are listed herein. Additional sources will be added as they become available

CID dash number (see table I) A-A-55510	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	HLT-01-ML	402001
002	HLS-01-ML	---

Vendor CAGE number	Vendor name and address
71400	Bussmann P.O Box 14460 St Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

Project 5920-D229

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.