[INCH-POUND]
A-A-55493
February 3, 1995


COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, SEMICONDUCTOR TYPE, 150 VOLTS

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE. This CID covers the general requirements for 150 volt semiconductor fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2 CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

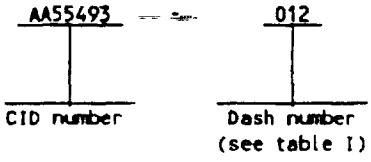

3 SALIENT CHARACTERISTICS

3 1 Design and construction. Fuse cartridges supplied to this CID shall be as specified herein (see figure 1).

3 2 Ampere rating The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 150 V ac maximum.

3 4 Short circuit interrupt rating The short circuit interrupt rating shall be 100,000 amperes RMS symmetrical.

3.5 Maximum current clearing I^2t. The maximum current clearing I^2t shall be as specified in table I.


3 6 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

AMSC N/A
FSC 5920

DISTRIBUTION STATEMENT A Approved for public release; distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

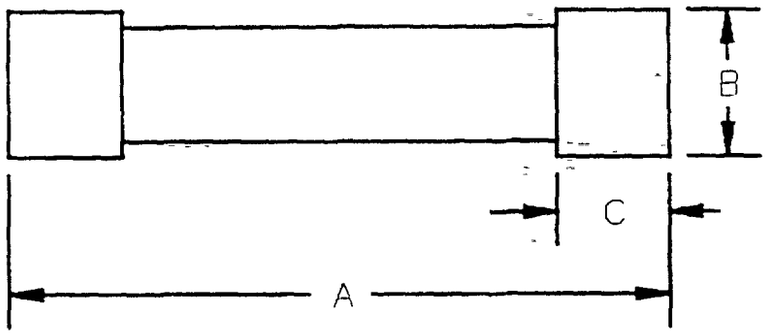


AA55493-	Dimensions		
	A	B	C
001 through 006	38.10 (1.500)	10.30 (.406)	9.50 (.374)
007 through 011	50.80 (2.000)	20.65 (.813)	20.83 (.820) 12 57 (495)

Configuration I

NOTES
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

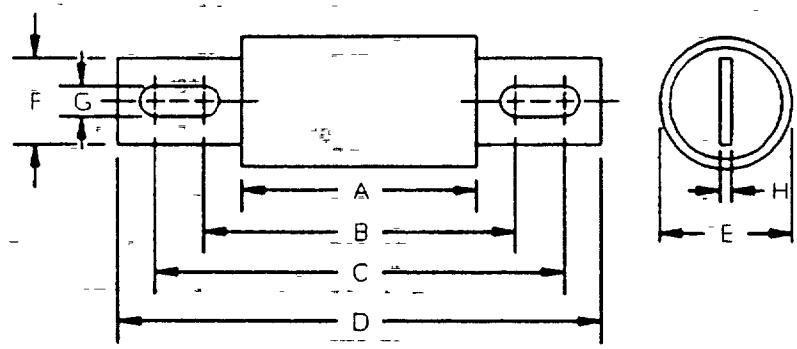

AA55493-	Dimensions							
	A	B	C	D	E	F	G	H
012 through 014	29.53 (1.626) 21.27 (.837)	48.54 (1.911) 47.47 (1.869)	55.73 (2.194) 54.64 (2.151)	67.48 (2.657)	28.71 (1.130) 20.57 (.810)	22.36 (.880) 18.92 (.745)	7.92 (.312)	4.78 (.188)
015 through 021					28.71 (1.130) 25.27 (.995)	22.36 (.880) 18.92 (.745)		
022 through 023	31.88 (1.255) 21.27 (.837)	60.43 (2.379) 49.07 (1.932)	65.23 (2.568) 63.37 (2.495)	88.90 (3.50)	38.23 (1.505) 27.97 (1.101)	25.40 (1.0)	10.31 (.406)	6.38 (.251)
024	31.93 (1.257) 24.47 (.963)				40.63 (1.6) 27.97 (1.101)			

Configuration II

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 2 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

AA55493-	Ampere rating	I^2t (A^2s)	AA55493-	Ampere rating	I^2t (A^2s)
001	5	150	013	80	41,000
002	10	255	014	100	75,000
003	15	310	015	125	110,000
004	20	330	016	150	175,000
005	25	372	017	200	210,000
006	30	400	018	250	355,000
007	35	975	019	300	460,000
008	40	1,200	020	350	570,000
009	45	1,570	021	400	640,000
010	50	1,810	022	500	710,000
011	60	2,150	023	600	875,000
012	70	25,000	024	800	950,000

4 QUALITY ASSURANCE PROVISIONS

4.1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

4.2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all fuse cartridges supplied to this CID.

4.3 Market acceptability. The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID.

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b. The company must have sold 1,000 units meeting this CID in the commercial market place over the past 2 years.

5 PACKAGING

5.1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6 NOTES

6 1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format example

6.2 Government users To acquire information on obtaining these semiconductor fuses from the Government inventory system, please contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106

6 3 Ordering data. The contract or order should specify the following.

a CID document number, revision, and CID PIN

b Quality assurance provisions.

c. If a bid sample is required.

d. Packaging requirements

6 4 Suggested sources of supply. Suggested sources of supply are listed below. Additional sources will be added as they become available The vendors listed have submitted a certificate of compliance to DESC-ELDM and meet the market acceptability requirements of this CID.

CID dash number (see table I) AA55493-	Vendor commercial PIN CAGE 12092	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	A015F005	---	L15S5
002	A015F010	---	L15S10
003	A015F015	---	L15S15
004	A015F020	---	L15S20
005	A015F025	---	L15S25
006	A015F030	---	L15S30
007	A015F035	---	L15S35
008	A015F040	---	L15S40
009	A015F045	---	L15S45
010	A015F050	---	L15S50
011	A015F060	---	L15S60
012	A015R070	FWA 70	L15S70
013	A015R080	FWA 80	L15S80
014	A015R100	FWA 100	L15S100
015	A015R125	FWA 125	L15S125
016	A015R150	FWA 150	L15S150
017	A015R200	FWA 200	L15S200
018	A015R250	FWA 250	L15S250
019	A015R300	FWA 300	L15S300
020	A015R350	FWA 350	L15S350
021	A015R400	FWA 400	L15S400
022	A015R500	FWA 500	L15S500
023	A015R600	FWA 600	L15S600
024	A015R700	FWA 800	L15S800

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Vendor CAGE number	Vendor name and address
12092	Carbone Lorraine, Incorporated 14 Eastmans Road Parsippany, NJ 07054-3703 (201) 428-8400
71400	Bussmann P.O Box 14460 St Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

Project 5920-D215

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.