[INCH-POUND]
A-A-55496
February 3, 1995


COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, SEMICONDUCTOR TYPE, 700 VOLTS

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE. This CID covers the general requirements for 700 volt semiconductor fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

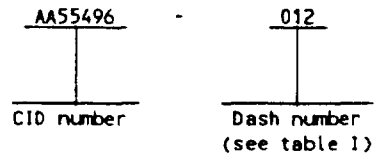

3 SALIENT CHARACTERISTICS

3 1 Design and construction Fuse cartridges supplied to this CID shall be as specified herein (see figure 1)

3 2 Ampere rating The ampere rating shall be as specified in table I

3.3 Voltage rating The voltage rating shall be 700 V ac maximum.

3 4 Short circuit interrupt rating. The short circuit interrupt rating shall be 200,000 amperes RMS at symmetrical.


3.5 Maximum current clearing I^2t. The maximum current clearing I^2t shall be as specified in table I

3.6 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN

Beneficial comments, recommendations, additions, deletions, clarifications, etc , and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN. DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868

AMSC N/A
FSC 5920
DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

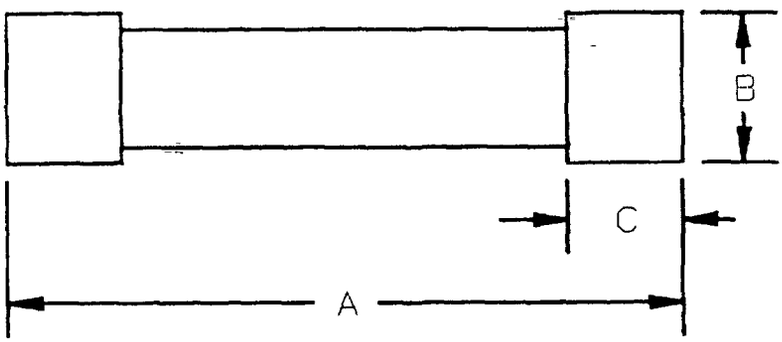


AA55496-	Dimensions		
	A	B	C
001 through 006	50.80 (2.0)	14.29 (.563)	12.70 (.500)

Configuration I

NOTES
1. Dimensions are in millimeters
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

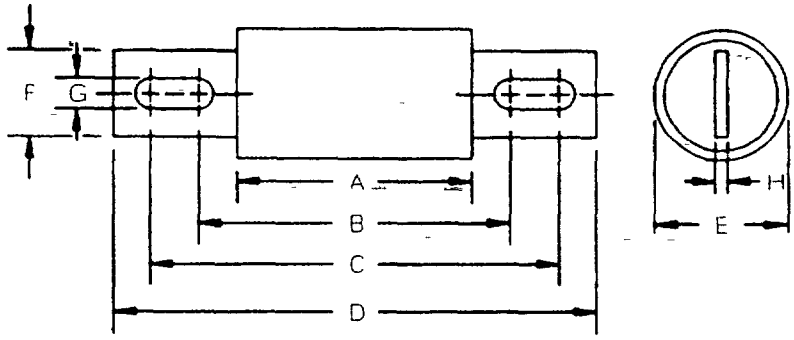

AA55496-	Dimensions							
	A	B	C	D	E	F	G	H
007 through 011	73.13 (2.879) 58.61 (2.307)	90.63 (3.568) 87.17 (3.432)	96.13 (3.784) 93.55 (3.683)	111 12 (4.375)	25.53 (1.005) 22.10 (870)	19.08 (.751)	8.86 (.349) 7.79 (.307)	3 19 (126)
012 through 014	73.16 (2 880) 72.07 (2.837)	90.63 (3 568) 87.17 (3.432)	96.13 (3.785) 93.53 (3.674)	111 12 (4 375)	30.98 (1.220)	25.53 (1 005) 18.92 (.745)	8.83 (.348) 7.77 (.306)	4 78 (188)
015 through 017	72.22 (2.843)	93.00 (3.661) 88.77 (3.495)	106.53 (4 194) 105.43 (4 151)	129 39 (5 094)	38.10 (1.5)	25.40 (1.0)	10.31 (.406)	6.38 (.251)
018 through 021	72.22 (2.843)	93.00 (3.661) 88.77 (3.495)	108.83 (4.285) 105.43 (4.151)	129.39 (5.094)	50.80 (2.0)	38.10 (1.5)	10.31 (.406)	6.38 (.251)
022 through 023	72.22 (2.843)	124.75 (4.911) 106.27 (4 184)	145.43 (5.726) 133.22 (5.245)	180.19 (7 094)	63.50 (2.5)	50.80 (2.0)	13.50 (.531)	9.52 (.375)

Configuration II

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 2 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I Electrical characteristics

AA55496-	Ampere rating	I^2t (A^2s)	AA55496-	Ampere rating	I^2t (A^2s)
001	5	750	013	80	15,000
002	10	1,150	014	100	17,000
003	15	1,500	015	125	31,000
004	20	1,800	016	150	50,000
005	25	2,000	017	200	70,000
006	30	2,800	018	250	100,000
007	35	3,500	019	300	130,000
008	40	4,500	020	350	200,000
009	45	6,100	021	400	280,000
010	50	8,000	022	500	360,000
011	60	10,000	023	600	460,000
012	70	12,500			

4 QUALITY ASSURANCE PROVISIONS

4 1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

4.2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all fuse cartridges supplied to this CID.

4.3 Market acceptability. The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID

a The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b The company must have sold 1,000 units meeting this CID in the commercial market place over the past 2 years.

5 PACKAGING

5 1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6 NOTES

6 1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format example.

6 2 Government users To acquire information on obtaining these semiconductor fuses from the Government inventory system, please contact Defense Electronics Supply Center, ATTN: DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106.

6 3 Ordering data. The contract or order should specify the following:

a CID document number, revision, and CID PIN.

b Quality assurance provisions.

c. If a bid sample is required.

d Packaging requirements

6 4 Suggested sources of supply. Suggested sources of supply are listed below. Additional sources will be added as they become available. The vendors listed have submitted a certificate of compliance to DESC-ELDM and meet the market acceptability requirements of this CID.

CID dash number (see table I) AA55496-	Vendor commercial PIN CAGE 12092	Vendor commercial PIN CAGE 71424	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	A070F005	---	FWP 5A	---
002	A070F010	A70P10-4	FWP 10A	L70S10
003	A070F015	A70P15-4	FWP 15A	L70S15
004	A070F020	A70P20-4	FWP 20A	L70S20
005	A070F025	A70P25-4	FWP 25A	L70S25
006	A070F030	A70P30-4	FWP 30A	L70S30
007	A070F035	A70P35-4	FWP 35A	L70S35
008	A070F040	A70P40-4	FWP 40A	L70S40
009	A070F045	A70P45-4	FWP 45A	L70S45
010	A070F050	A70P50-4	FWP 50A	L70S50
011	A070F060	A70P60-4	FWP 60A	L70S60
012	A070F070	A70P70-4	FWP 70A	L70S70
013	A070F080	A70P80-4	FWP 80A	L70S80
014	A070F100	A70P100-4	FWP 100A	L70S100
015	A070F125	A70P125-4	FWP 125A	L70S125
016	A070F150	A70P150-4	FWP 150A	L70S150
017	A070F200	A70P200-4	FWP 200A	L70S200
018	A070F250	A70P250-4	FWP 250A	L70S250
019	A070F300	A70P300-4	FWP 300A	L70S300
020	A070F350	A70P350-4	FWP 350A	L70S350
021	A070F400	A70P400-4	FWP 400A	L70S400
022	A070F500	A70P500-4	FWP 500A	L70S500
023	A070F600	A70P600-4	FWP 600A	L70S600

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Vendor CAGE number	Vendor name and address
12092	Carbone Lorraine, Incorporated 14 Eastmans Road Parsippany, NJ 07054-3703 (201) 428-8400
71424	Gould Shawmut , Incorporated 374 Merrimac Road Newburyport, MA 01950-1930 (508) 462-6662
71400	Bussmann P.O Box 14460 St Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project 5920-0218

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.