MIL-T-24552A(SH)
3 November 1986
SUPERSEDING
MIL-T-24552(SH)
23 March 1977
(See 6.7)

MILITARY SPECIFICATION

TERMINALS AND SEALS, PLUGS AND SWITCH, CASUALTY POWER SYSTEMS, RECEPTACLE TYPE, GENERAL SPECIFICATION FOR


This specification is approved for use within the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers terminals, plugs, and switches that provide emergency electric power connections for casualty power systems. The capacity of these devices is 450 volts alternating current (Vac), three-phase, 100 and 200 amperes for use on Naval ships.

1.2 Part number. The part number shall consist of the letter "M" followed by the basic specification sheet number, and a sequentially assigned dash number (see 3.1 and 6.2.1).

Example:

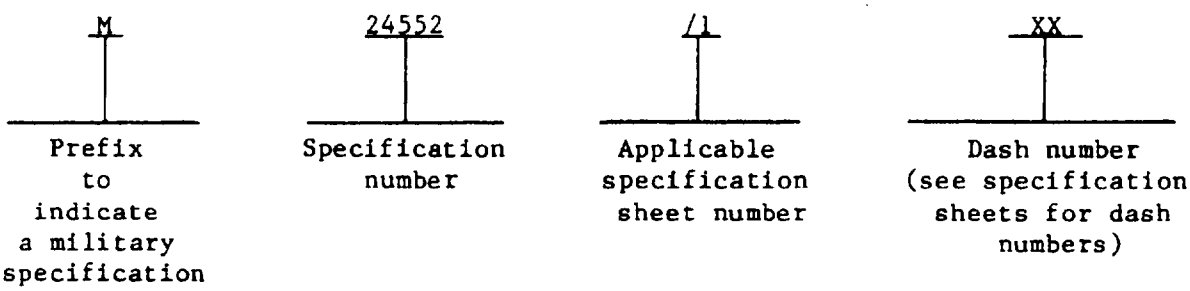

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commander, Naval Sea Systems Command, SEA 55Z3, Department of the Navy, Washington, DC 20362-5101 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A
FSC 5940
DISTRIBUTION STATEMENT A Approved for public release; distribution unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and
ards form a part of this specification to the extent specified herein.
s otherwise specified, the issues of these documents shall be those listed
e issue of the Department of Defense Index of Specifications and Standards
SS) and supplement thereto, cited in the solicitation.

SPECIFICATIONS

FEDERAL

QQ-B-650	- Brazing Alloys, Copper, Copper-Zinc, and Copper-Phosphorus.
QQ-B-654	- Brazing Alloys, Silver.
QQ-S-365	- Silver Plating, Electrodeposited: General Requirements for.
PPP-B-636	- Boxes, Shipping, Fiberboard.

MILITARY

MIL-M-14	- Molding Plastics and Molded Plastic Parts, Thermosetting.
MIL-P-116	- Preservation, Methods of.
MIL-R-900	- Rubber Gasket Material, 45 Durometer Hardness.
MIL-S-901	- Shock Tests, H.I. (High-Impact); Shipboard Machinery, Equipment and Systems, Requirements for.
MIL-C-915	- Cable and Cord, Electrical, for Shipboard Use, General Specification for.
MIL-C-915/6	- Cable, Electrical, 600 Volts, Types SHOF, DHOF, THOF, and FHOF.
MIL-E-917	- Electric Power Equipment, Basic Requirements (Naval Shipboard Use).
MIL-T-5624	- Turbine Fuel, Aviation, Grades JP-4 and JP-5.
MIL-R-6855	- Rubber, Synthetic, Sheets, Strips, Molded or Extruded Shapes.
MIL-T-7928	- Terminals, Lug: Splices, Conductor: Crimp Style, Copper, General Specification for.
MIL-P-15024	- Plates, Tags and Bands for Identification of Equipment.
MIL-P-15024/5	- Plates, Identification.
MIL-W-16878	- Wire, Electrical, Insulated, General Specification for.
MIL-W-16878/8	- Wire, Electrical, Silicone Rubber Insulated, 200°C, 1000 Volts.
MIL-F-16884	- Fuel, Naval Distillate.
MIL-C-17361	- Circuit Breakers, Air Electric, Insulated Housing (Shipboard Use).
MIL-C-22520	- Crimping Tools, Terminal, Hand or Power Actuated, Wire Termination, and Tool Kits General Specification for.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

MILITARY (Continued)

MIL-I-23053 - Insulation Sleeving, Electrical, Heat Shrinkable, General Specification for.

MIL-I-23053/4 - Insulation Sleeving, Electrical, Heat Shrinkable, Polyolefin, Dual-Wall, Outer Wall Crosslinked.

MIL-T-24552/1 - Terminals and Seals, Plugs and Switch, Casualty Power, Receptacle Type, Back Connected, 200 Ampere, 450-Volt, Alternating Current, Three-Phase Symbol No. 1046.

MIL-T-24552/2 - Terminals and Seals, Plugs and Switch, Casualty Power, Receptacle Type, Upper and Lower Riser, 200-Ampere, 450-Volt, Alternating Current, Three-Phase, Symbol No. 1047.

MIL-T-24552/3 - Terminals and Seals, Plugs and Switch, Casualty Power, Seal, Symbol No. 1048.

MIL-T-24552/4 - Terminals and Seals, Plugs and Switch, Casualty Power, Plug, 100-Ampere, 450-Volt, Alternating Current, Three-Phase, Symbol No. 1049.

MIL-T-24552/5 - Terminals and Seals, Plugs and Switch, Casualty Power, Switch, Portable 100-Ampere, 450-Volt, Alternating Current, Three-Phase, Symbol No. 1041.1.

MIL-C-24643 - Cable and Cord, Electrical, Low Smoke, for Shipboard Use, General Specification for.

MIL-C-24643/16 - Cable, Electrical, 1000 Volts, Type LSTSGU (Including Variation LSTSGA).

MIL-C-39029 - Contacts, Electrical Connector, General Specification for.

STANDARDS

FEDERAL

FED-STD-H28 - Screw-Thread Standards for Federal Services.

FED-STD-H28/2 - Screw-Thread Standards for Federal Services, Section 2, Unified Inch Screw Threads - UN and UNR Thread Forms.

FED-STD-595 - Colors.

MILITARY

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.

MIL-STD-108 - Definitions of and Basic Requirements for Enclosures for Electric and Electronic Equipment.

MIL-STD-129 - Marking for Shipment and Storage.

MIL-STD-167-1 - Mechanical Vibrations of Shipboard Equipment (Type I - Environmental and Type II - Internally Excited).

MIL-STD-202 - Test Methods for Electronic and Electrical Component Parts.

MIL-STD-454 - Standard General Requirements for Electronic Equipment.

MIL-STD-810 - Environmental Test Methods and Engineering Guidelines.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

MILITARY (Continued)

MIL-STD-889 - Dissimilar Metals.
MIL-STD-1344 - Test Methods for Electrical Connectors.
MS17339 - Cable, Safety (Wire Rope).

(Copies of specifications and standards required by contractors in connec- with specific acquisition functions should be obtained from the contracting vity or as directed by the contracting activity.)

2.2 Other publications. The following documents form a part of this speci- tion to the extent specified herein. Unless otherwise specified, the issues he documents which are DoD adopted shall be those listed in the issue of the SS specified in the solicitation. Unless otherwise specified, the issues of ments not listed in the DoDISS shall be the issue of the nongovernment docu- s which is current on the date of the solicitation.

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

A 313 - Standard Specification for Chromium-Nickel Stainless and Heat-Resisting Steel Spring Wire. (DoD adopted)
A 569 - Standard Specification for Steel, Sheet and Strip, Carbon (0.15 Maximum Percent), Hot Rolled, Commerical Quality. (DoD adopted)
B 187 - Standard Specification for Copper Bus Bar, Rod, and Shapes.
B 633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel. (DoD adopted)
D 2240 - Standard Test Method for Rubber Property - Durometer Hardness. (DoD adopted)

(Application for copies should be addressed to the American Society for ing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

UNIFORM CLASSIFICATION COMMITTEE AGENT

Uniform Freight Classification Ratings, Rules and Regulations

(Application for copies should be addressed to the Uniform Classification ittee Agent, Tariff Publication Officer, Room 1106, 222 South Riverside a, Chicago, IL 60606.)

(Nongovernment standards and other publications are normally available the organizations which prepare or which distribute the documents. These ments also may be available in or through libraries or other informational ices.)

2.3 Order of precedence. In the event of a conflict between the text of specification and the references cited herein (except for associated detail ifications, specification sheets or MS standards), the text of this specifi- on shall take precedence. Nothing in this specification, however, shall rsede applicable laws and regulations unless a specific exemption has been ined.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

3. REQUIREMENTS

3.1 Specification sheets. The individual item requirements shall be as specified herein and in accordance with the applicable specification sheet. In the event of any conflict between the requirements of this specification and the specification sheet, the latter shall govern.

3.2 Qualification. The casualty power terminals, plugs, and seals furnished under this specification shall be products that are qualified for listing on the applicable qualified products list at the time set for opening of bids (see 4.4 and 6.3).

3.2.1 First article (casualty power switch only). When specified in the contract or purchase order, a sample shall be subjected to first article inspection (see 4.4.1 and 6.4).

3.3 Materials and processes. Materials and processes shall be as specified herein and in 3.1. When not specified, they shall be selected from those listed in MIL-E-917.

3.3.1 Metals. Metals shall be in accordance with MIL-STD-889 to provide corrosion resistance. Metals that are not inherently corrosion resistant shall be processed (treated, plated, or painted) to provide corrosion resistance. Cadmium treatments shall not be used.

3.3.1.1 Selection of metals in direct contact. In order to minimize corrosion attack due to electrolytic action between dissimilar metals in contact with each other, metal-to-metal contact shall be limited to those metals which, when coupled, are in accordance with MIL-STD-889.

3.3.2 Nonmetallic materials. Nonmetallic materials shall be nonflamable and nontoxic in accordance with MIL-E-917. Materials containing asbestos shall not be used.

3.3.2.1 Thermosetting insulating material. Thermosetting molded insulating parts shall be type MAI-60 in accordance with MIL-M-14 or one of the following: Fiberite No. 5064, Glaskyd No. 1902, Plaskon No. 446, or equal.

3.3.2.2 Gaskets and seals. Material for gaskets and seals shall be in accordance with MIL-R-6855, class 2, type B or in accordance with MIL-R-900.

3.3.3 Recovered materials. Unless otherwise specified herein, all equipment, material, and articles incorporated in the products covered by this specification shall be new and may be fabricated using materials produced from recovered materials to the maximum extent practicable without jeopardizing the intended use. The term "recovered materials" means materials which have been collected or recovered from solid waste and reprocessed to become a source of raw materials, as opposed to virgin raw materials. None of the above shall be interpreted to mean that the use of used or rebuilt products is allowed under this specification unless otherwise specifically specified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

3.4 Parts.

3.4.1 Contacts. The contact pins and contact sockets shall be of a copper or copper alloy material that will provide the required electrical characteristics. The contacts shall be silver plated with not less than 0.0002-inch of silver in accordance with QQ-S-365.

3.4.1.1 Contact pins. Plug mounted contact pins shall meet physical, electrical and performance requirements of MIL-T-7928 for a nominal wire size of AWG 4. Plug contacts shall be suitable for crimping using standard tools in accordance with MIL-C-22520.

3.4.1.2 Contact sockets. The terminal contact sockets shall be sized to accept the contact pins and meet the performance requirements. Socket contact springs, if required for mechanical strength, shall be corrosion-resistant steel wire in accordance with ASTM A 313. The spring shall not form a part of the electrical circuit.

3.4.2 Terminal lugs. Unless otherwise specified (see 3.1), terminal lugs shall be crimp style, insulated, in accordance with MIL-T-7928. Lugs shall be sized for attachment to 0.250 inch studs and to accept conductors of LSTSGU-75 cable in accordance with MIL-C-24643 and MIL-C-24643/16 and size American Wire Gauge (AWG) 2 wire in accordance with MIL-W-16878 and MIL-W-16878/8. Lugs accepting LSTSGU-75 conductors shall be formed to a 45-degree angle.

3.4.3 Hardware. Unless otherwise specified (see 3.1), all hardware (bolts, nuts, screws, washers, and miscellaneous hardware) shall be of a good commercial grade material compatible with that of the basic unit. Steel (corrosion-resisting steel excepted) hardware shall be zinc plated in accordance with ASTM B 633.

3.5 Design and construction. Terminals, plugs, seals, and switches shall be of the design, construction, and physical dimensions specified (see 3.1).

3.5.1 Mounting. The size and location of mounting holes shall be as specified (see 3.1). Mounting hardware will be furnished by the installing activity.

3.5.2 Housings. Housings for terminals, plugs, and covers shall be of a glass fiber reinforced molded thermosetting insulating material. The color shall be red (color No. 11105 or 11136 in accordance with FED-STD-595). Switch enclosures shall be fabricated from sheet steel as specified (see 3.1).

3.5.2.1 Housing-terminal. The terminal housing shall have a removable access cover and a cavity of sufficient size to enable ease of making internal electrical connections and shall have three-phase outlets containing bus, assembled socket contacts, and protective covers. The socket contacts shall be removable, rigidly mounted, and shall allow for a radial misalignment of plus or minus 0.020 inch. The outlets shall be polarized to prevent cross-phasing and shall contain threaded inserts for retaining plugs and covers.

3.5.2.2 Housing-plug. The plug housing shall protrude beyond and afford protection for the contacts. The plugs shall have male contact pins, retaining devices that mate with the terminal housing threaded inserts, and shall be

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

polarized to prevent cross-phase engagement. To facilitate self-alignment of mating contacts, the contact pins shall be retained such that the individual contact shall have an overall sideplay of 0.002 to 0.006 inch.

3.5.2.3 Protective covers. The protective covers shall provide a spray tight seal at the terminal or switch interface when fully engaged and retained with devices specified in 3.5.3. The protective covers shall be held captive to the terminal housing or switch enclosure by means of a flexible, plastic coated stainless steel cable in accordance with MS17339.

3.5.2.4 Enclosure-switch. The switch enclosure, when assembled, shall be totally enclosed in accordance with MIL-STD-108.

3.5.3 Retaining devices. The protective covers shall contain captive retaining devices. The retaining devices shall provide positive closure and release without the use of tools. The retaining devices shall not be used as an aid for mating or separating plugs or covers to and from terminals.

3.5.4 Plug engaging and separating. Lubricants, tools, retaining, or coupling devices shall not be required for engaging or separating a plug from the receptacle.

3.5.5 Cables and wire. The plugs and terminals shall be capable of being used with the following types of cable and wire:

(a) Plugs - Cable type THOF-42 in accordance with MIL-C-915 and MIL-C-915/6.
(b) Terminals - Cable type LSTSGU-75 in accordance with MIL-C-24643 and MIL-C-24643/16, interconnecting wire size AWG 2 in accordance with MIL-W-16878 and MIL-W-16878/8.

3.5.6 Cable entry boot-plug. A removable flame-retardant polyetherurethane cable entry boot shall be provided with each plug. The shore A hardness change of the boot shall be not greater than 10 after being subjected to the humidity test of 4.7.8. The boot shall be held in place with a stiffener plate to prevent water leakage into the cable end of the plug housing.

3.5.7 Cable entry seal - upper and lower terminal riser. A nylon stuffing tube, when specified (see 3.1), shall be furnished with each upper and lower terminal riser.

3.5.8 Screw threads for fastening devices. Screw threads for all threaded fastening devices shall be in accordance with FED-STD-H28. Unless otherwise specified (see 3.1), the threads shall be right hand, coarse-thread series, unified form, class 2A or 2B in accordance with FED-STD-H28/2. Unless otherwise specified (see 3.1), when a screw mates with a plastic part, a threaded metal insert, bushing type or helical type, shall be molded therein. The bushing type is the preferred type.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

3.5.8.1 Thread locking. Nuts, bolts, studs, and screws used for electrical connections shall be secured by lockwashers. Bolts, nuts, and screws used for mechanical connections shall be secured by locking devices, as required, to ensure compliance with the requirements specified (see 3.1).

3.5.9 Welding. Welding and allied processes used in fabrication shall be in accordance with requirement 13 of MIL-STD-454.

3.5.10 Brazing. Brazing shall be in accordance with requirement 59 of MIL-STD-454. Brazing alloys for electrical connections shall be in accordance with QQ-B-650 or QQ-B-654.

3.5.11 Electrical rating. The electrical rating of the terminals shall be 200 ampere per phase, 450 Vac, three-phase. Rating of plugs and switches shall be 100 ampere per phase, 450 Vac, three-phase.

3.5.12 Phase identification. Phase identification (A, B, and C) shall be permanently and legibly marked on the plugs and terminal outlets in characters at least 0.12 inch high. Phase orientation shall be A, B, and C, respectively, front to rear and right to left (as viewed from front) as specified (see 3.1).

3.5.13 Electrical creepage and clearance distances. Clearance distance in air between energized parts or between an energized part and ground shall be not less than 0.500 inch. Creepage distance between energized parts or between an energized part and ground shall be not less than 0.875 inch.

3.5.14 Bus bar. Terminal and switch bus bars shall be copper, hard temper in accordance with ASTM B 187. The bus shall be solid and shall have a cross sectional area of not less than 0.0625 square inch (in^2).

3.5.14.1 Plating. Bus bars shall be silver plated in areas of current carrying contact with bus ties, contacts, and terminals. The plating shall be in accordance with QQ-S-365, with the exception that the silver plate shall be not less than 0.0002 inch thick. Silvering a 0.125 inch wide band on the surface area surrounding each hole used for retaining an electrical carrying contact will be acceptable; however, the entire bus may be silver surfaced at the discretion of the manufacturer. Threaded surfaces used as electrical contact surfaces shall have silver thickness of at least 0.0002 inch.

3.6 Performance.

3.6.1 Dielectric withstanding voltage. When plugs and terminals, or switches are tested as specified in 4.7.1, there shall be no arcing, breakdown, corona (audible or visible), or punctured insulation.

3.6.2 Insulation resistance. With plugs and terminals or switches unmated, the insulation resistance between electrical conductors and between electrical conductors and ground shall be not less than the values indicated, when tested as specified in 4.7.2.

(a) 500 megohms - Terminals and plugs
(b) 1 megohm - Switches

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

3.6.3 Contact engaging and separating forces. The required engaging force shall be not greater than 100 ounces and the separation force shall be not less than 10 ounces when individual contacts are tested as specified in 4.7.3.

3.6.4 Plug engaging and separating forces. The required force for engaging or separating a plug from a receptacle (see 3.5.4) shall be not greater than 20 pounds, when tested as specified in 4.7.4.

3.6.5 Cable pull-out. Cables shall not pull out of their respective plugs when a 360 pound load is applied as specified in 4.7.5.

3.6.6 Ambient temperature extremes. When tested as specified in 4.7.6, plugs and terminals shall withstand ambient temperature extremes of minus 20 degrees Celsius (°C) to plus 125°C without showing evidence of mechanical damage as follows:

(a) Cracking or delamination of finish.
(b) Mechanical displacement or rupture of conductors or insulating materials.

Following the test, terminals and plugs shall pass tests specified in 4.7.1 and 4.7.2, respectively. Bulkhead terminals shall also pass the test specified in 4.7.16.

3.6.7 Contact resistance. When tested as specified in 4.7.7, terminals which have not undergone the salt spray test shall exhibit a voltage drop not greater than 40 millivolt (mV) when 100 amperes are passed through each connector. Following the salt spray test, voltage drop shall be not greater than 50 mV.

3.6.8 Humidity. When tested as specified in 4.7.8, mated plugs and terminals shall pass the tests specified in 4.7.1 and 4.7.2 following a 4-hour drying period.

3.6.9 Fluid immersion. The plugs shall be properly mated with the terminal (see 3.5.4) after having been immersed in fuel oil or turbine fuel as specified in 4.7.9.

3.6.10 Electrical load. When subjected to the load specified in 4.7.10 a mated plug and terminal or plug and switch shall operate for 4 hours without evidence of electrical or mechanical damage. Following this test, the items shall pass the test specified in 4.7.1 and 4.7.2 respectively.

3.6.11 Endurance (durability). The plugs and receptacles shall be serviceable and perform their function by passing the test specified in 4.7.7 after completion of the test specified in 4.7.11.

3.6.12 High-impact shock. Terminals with plugs mated shall be in accordance with HI shock requirement, type A, grade A, class I, lightweight of MIL-S-901 (see 4.7.12). The items being tested shall be considered as failing the test if one or more of the following occurs:

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

(a) There is evidence of contact of live parts with each other.
(b) Structural parts are damaged or loosened.
(c) Functional parts are damaged or loosened.
(d) The housing is cracked or warped.
(e) The circuit breaker trips (switches only).
(f) Failure to pass the test specified in 4.7.1 or the test specified in 4.7.2 upon completion of the high-impact shock test.

3.6.13 Mechanical abuse (impact). When plugs are tested as specified in 4.7.13, there shall be no evidence of mechanical damage or electrical failure that would prevent the plug from performing its intended function.

3.6.14 Vibration. When tested as specified in 4.7.14, terminals, switches and plugs shall conform to the type I vibration requirements of MIL-STD-167-1. The items being tested shall be considered as failing the test if they fail to perform their principal functions during or after testing or if one or more of the deficiencies in 3.6.12(a) through 3.6.12(e) occurs. Following the vibration tests, the items shall pass the tests specified in 4.7.1 and 4.7.2.

3.6.15 Salt spray. When terminals, switches, or plugs are tested as specified in 4.7.15, there shall be no evidence of excessive corrosion. Excessive corrosion is defined as that which interferes with electrical or mechanical performance, or in the case of plated metals, corrosion which has migrated through the plating and attacked the base metal. After the test, the plugs and terminal shall pass the test specified in 4.7.7.

3.6.16 Watertightness. Back connected terminals with seals shall withstand a water gauge pressure test as specified in 4.7.16.

3.6.17 Spraytightness. Terminals shall withstand the test specified in 4.7.17.

3.6.18 Totally enclosed. Switch enclosures shall be examined to ensure they meet the design requirements in accordance with MIL-STD-108 for totally enclosed degree of enclosure.

3.7 Finish.

3.7.1 Molded parts. Molded parts shall have surfaces which are not warped, cracked, chipped, or blistered either initially or as a result of tests specified herein.

3.7.2 Painting. Painting and protection against corrosion shall be in accordance with MIL-E-917, or as specified in the specification sheet (see 3.1).

3.8 Marking. The following information shall be permanently installed on the terminals and plugs by molding on to the items or by installing identification and information plates in accordance with types A, B, C, D, and H of MIL-P-15024:

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

(a) Military part number.
(b) Symbol number.
(c) Manufacturer's name, logo, or Federal Supply Code Number (FSCN).
(d) Contract number.

3.8.1 Service. Identification and information plates, when used, shall conform to the severe service requirements of MIL-P-15024 and MIL-P-15024/5. Where required, additional information shall be as specified (see 6.2.1).

3.9 Workmanship. Workmanship shall be in accordance with requirement 9 of MIL-STD-454. The plugs and receptacles shall be manufactured and processed in such a manner as to be uniform in quality and free from cracked, loose, displaced parts, burrs, sharp edges, and other defects that will affect life or serviceability.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of assuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling in quality conformance does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

(a) Qualification inspection (see 4.4).
(b) First article inspection (see 4.4.1).
(c) Quality conformance inspection (see 4.5).

4.3 Inspection conditions. Unless otherwise specified herein, all inspections shall be performed in accordance with the test conditions as specified in MIL-STD-202. Except for the tests specified in 4.7.1 and 4.7.7, the plugs and terminals shall be terminated using cable and wire in accordance with 3.5.5.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

4.4 Qualification inspection. Qualification inspection shall be con-
ed at a laboratory satisfactory to the Government (see 6.3), on sample
s produced with equipment and procedure normally used in production.

4.4.1 First article inspection (casualty power switch only). First
cle inspection shall be performed on sample switches which have been
uced with equipment and procedures normally used in production.

4.4.1.1 First article inspection report. When specified in the contract
rder, a first article inspection report shall be prepared (see 6.2.2).

4.4.2 Sample size. The contractor shall submit two sample units of the
for which qualification or first article inspection is desired (see 4.4.4).
mple unit shall consist of: One terminal and three plugs for riser types;
terminal, three plugs, and one seal for back connected types; and one switch
two plugs for switch assemblies.

4.4.3 Inspection routine. The sample shall be subjected to the inspections
pecified in table I in the order shown.

TABLE I. Qualification inspection.

Examination/test	Sample 1	Sample 2	Requirement	Test method
General examination	X	X	3.1, 3.3, 3.4, 3.5, 3.6.18, 3.7, 3.8 and 3.9	4.6.1
Dielectric withstanding voltage		X	3.6.1	4.7.1
Insulation resistance	X	X	3.6.2	4.7.2
Contact engaging and separating force	X	X	3.6.3	4.7.3
Plug engaging and separating force	X	X	3.6.4	4.7.4
Cable pull-out 1/	X	X	3.6.5	4.7.5
Ambient temperature extremes 2/	X	X	3.6.6	4.7.6
Contact resistance	X		3.6.7	4.7.7
Humidity 2/		X	3.6.8	4.7.8
Fluid immersion 1/		X	3.6.9	4.7.9
Electrical load 2/		X	3.6.10	4.7.10
Durability		X	3.6.11	4.7.11
High impact shock	X		3.6.12	4.7.12
Mechanical abuse 1/	X		3.6.13	4.7.13
Vibration	X		3.6.14	4.7.14
Salt spray 2/	X		3.6.15	4.7.15
Watertightness 3/	X		3.6.16	4.7.16
Spraytightness 4/	X	X	3.6.17	4.7.17

footnotes at top of next page.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

1/ Plugs only.
2/ Not applicable for switches.
3/ Bulkhead terminals only (see 6.1).
4/ Riser terminals only.

4.4.4 Extension of qualification. Except for the cable entrance, quali-tion approval of back connected terminals may be extended to cover the r and lower riser terminals, provided they are of the same design and truction, and that qualification testing for high-impact shock and vibration accomplished without the use of a bulkhead seal.

4.4.5 Retention of qualification. Retention of qualification approval shall redicated on receiving requalification examinations and tests as specified able I every 5 years.

4.5 Quality conformance inspection.

4.5.1 Inspection of product for delivery. Inspection of product for deliv-shall consist of groups A and B inspection.

4.5.1.1 Inspection lot. An inspection lot shall consist of all the plugs, inals, switches, or seals of the same part number produced under essentially same conditions and offered for delivery at one time.

4.5.2 Group A inspection. Group A inspection shall consist of the inspec-s as specified in table II.

TABLE II. Group A inspection.

Inspection	Requirement	Test method
Visual and dimensional examination	3.1, 3.3, 3.4, 3.5, 3.6.18, 3.7, 3.8, and 3.9	4.6.1

4.5.2.1 Sampling plan. Sample plugs, terminals, and switches shall be cted in accordance with MIL-STD-105, inspection level I, for the examina-specified in 4.6. The Acceptable Quality Level (AQL) shall be 1.0 percent major defects and 4.0 percent for minor defects. If the number of defective s in the sample exceeds the acceptance number for that sample, the lot repre-ed by the sample shall be rejected. Classification of defects shall be as ified in table III.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

TABLE III. Classification of defects.

Categories	Characteristics
Critical:	
None	
Major:	
101	Inability to mate with counterpart
102	Incorrect contact construction
103	Incorrect dimensions which affect mating
104	Burrs capable of cutting
105	Incorrect marking
106	Cracked, loose, or displaced parts
107	Piece part missing or not as specified
108	Material incorrect
109	Dimensions incorrect
Minor:	
201	Poor exterior finish
202	Molding flash
203	Workmanship not up to standards

4.5.3 Group B inspection. Group B inspection shall consist of the inspec-ons as specified in table IV with samples selected from inspection lots that ve passed group A inspection.

TABLE IV. Group B inspection.

Inspection	Requirement	Test method
Dielectric withstanding voltage	3.6.1	4.7.1
Insulation resistance	3.6.2	4.7.2
Contact engaging and separating force	3.6.3	4.7.3
Plug engaging and separating force	3.6.4	4.7.4
Ambient temperature extremes	3.6.6	4.7.6
Contact resistance	3.6.7	4.7.7
Watertightness 1/	3.6.16	4.7.16
Spraytightness 2/	3.6.17	4.7.17

1/ Bulkhead terminals only.
2/ Riser terminals only.

4.5.3.1 Sampling plan. The sampling plan shall be in accordance with -STD-105 for inspection level I. The AQL shall be 2.5 percent defective.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

4.5.4 Noncompliance. If a sample fails to pass group B inspection, the facturer shall notify the qualifying activity and the cognizant inspection ity of such failure and take corrective action on the materials or processes, oth, as warranted, and on all units of product which can be corrected and are manufactured under essentially the same materials and processes, and are considered subject to the same failure. Acceptance and shipment of product shall be discontinued until corrective action acceptable to the fying activity has been taken. After the corrective action has been taken, B inspection shall be repeated on additional sample units (all tests and nations, or the test which the original sample failed, at the option of the fying activity). Groups A and B inspections may be reinstituted; however, acceptance and shipment shall be withheld until the group B inspection shown that the corrective action was successful. In the event of failure reinspection, information concerning the failure shall be furnished to the zant inspection activity and the qualifying activity.

4.6 Examination.

4.6.1 Visual and dimensional examination. Plugs, terminals, switches, seals shall be visually examined to verify that the materials, design, con- tion, physical dimensions, marking, and workmanship are as specified in pplicable requirements (see 3.1, 3.3, 3.4, 3.5, 3.6.18, 3.7, 3.8 and 3.9).

4.7 Tests.

4.7.1 Dielectric withstanding voltage. Plugs and terminals or switches be subjected to a dielectric withstanding voltage test in accordance with od 301 of MIL-STD-202. The following details shall apply:

(a) Nature of potential - 60 hertz (Hz) root mean square (rms) ac and shall approximate a true sine wave.
(b) Magnitude of test voltage - 2500 volts rms (terminals and plugs), 2000 volts rms (switches).
(c) Points of application - When testing terminals, the potential shall be applied between each phase and the metal mounting plate and between each phase and all adjacent phases. When testing plugs, the potential shall be applied between each phase and between each phase and any metallic parts.
(d) Rejection criteria - Failure to be in accordance with 3.6.1.

4.7.2 Insulation resistance. Insulation resistance shall be measured in dance with method 302 of MIL-STD-202. The test voltage (500 volts direct nt (dc)) shall be applied between electrical conductors and between electri- conductors and ground. When switches are present, they shall be in the ized (closed) position. A resistance of less than the values specified in 2 shall be cause for rejection.

4.7.3 Contact engaging and separating forces. Individual terminal sockets be tested for initial contact engaging and separating force in accordance the requirements of MIL-C-39029 for size 4 contacts (see 3.6.3).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

4.7.4 Plug engaging and separating forces. Mated plugs and terminals or tches shall be tested in accordance with method 2013 of MIL-STD-1344. Exceed- the force specified in 3.6.4 shall be cause for rejection.

4.7.5 Cable pull-out. Three plugs shall individually be placed in a ten- testing machine. Tests shall be made at room temperature and with a speed travel of head of 1/2 inch per minute, until load specified in 3.6.5 has been lied. Evidence of discontinuity or relative movement between any conductor its termination shall be cause for rejection.

4.7.6 Ambient temperature extremes. A terminal with one cabled plug and covers mated shall be subjected to a high and low temperature test in rdance with method 501.2, procedure II and method 502.2 procedure II, of -STD-810, except that the high temperature shall be 125°C and the low temper- e shall be minus 20°C (see 3.6.6). The samples shall then be subjected he dielectric withstanding voltage test of 4.7.1 and the insulation resis- e test of 4.7.2. Failure of these tests or evidence of mechanical damage pecified in 3.6.6 shall be cause for rejection.

4.7.7 Contact resistance. Mated terminals and test plugs shall be con- ed to a power supply and circuitry as needed to pass 100 amperes through contact during the test. Test leads shall be a minimum of 5 feet. A ntial drop greater than that specified in 3.6.7, when measured at the eme ends of the contacts (see figure 1), shall be cause for rejection.

4.7.8 Humidity. Mated plugs and terminal shall be subjected to a moisture stance test, method 103, condition C in accordance with MIL-STD-202. Upon letion and after a 4-hour drying period, the plugs and terminal shall be ected to the tests of 4.7.1 and 4.7.2. Boot (plug) shall be subjected to rdness test in accordance with ASTM D 2240 prior to and following the dity test. Change in shore A hardness greater than specified in 3.5.6 l be cause for rejection.

4.7.9 Fluid immersion. One plug shall be immersed fully for a period of ours at 60 ± 2°C in fuel oil in accordance with MIL-F-16884 and one in ine fuel in accordance with MIL-T-5624. Plugs shall be wiped free of the ds and connected to a terminal to determine proper mating as specified in 9.

4.7.10 Electrical load. Two plugs shall be mated to a terminal as shown igure 2 and each plug lead shall be connected to a 100-ampere load. A power ly capable of supplying 200 amperes through all phases simultaneously shall onnected to the terminal bus bar. The test current shall be applied for urs. Upon completion of the test, the terminal and plug shall be subjected he tests of 4.7.1 and 4.7.2.

4.7.11 Endurance (durability). Plugs and receptacles shall be subjected he durability test in accordance with method 2016 of MIL-STD-1344 to meet requirements specified in 3.6.11. The following details shall apply:

(a) Number of mating and unmating cycles: 500.
(b) Cycle rate: 5 cycles per minute minimum.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

(c) Plug retention devices may be removed for this test.
(d) Rejection criteria: Evidence of damage in accordance with method 2016 of MIL-STD-1344 or failure to be in accordance with 3.6.7.

4.7.12 High-impact shock. The terminals or switch, with plugs mated as ated, shall be energized and subjected to high-impact shock tests in dance with MIL-S-901 for grade A, class I, lightweight, type A equipment. anner of mounting shall simulate the actual mounting on shipboard. ctions shall be as follows:

(a) Bulkhead terminal (see figure 3) - Three plugs, each with 6- to 10-foot lengths of unsupported cable attached, installed to one side. One plug, with a 6- to 10-foot length of unsupported cable attached, and two covers installed on the opposite side.
(b) Terminal risers - Two plugs, each with a 6- to 10-foot length of unsupported cable attached and one cover.
(c) Switch - Two plugs, each with a 6- to 10-foot length of unsupported cable attached.

ample being tested shall not be reconditioned or adjusted during the testing. ving the test, the samples shall be subjected to tests of 4.7.1 and 4.7.2. :ems tested shall be considered as failing the test if damage specified 3.12 is evident, or if they fail to pass the tests specified in 4.7.1 and

4.7.13 Mechanical abuse (impact). A cabled plug shall be subjected to the .n accordance with method 2015 of MIL-STD-1344 to verify compliance with the ·ements specified in 3.6.13. The following details and exceptions shall

(a) Service class: Severe
(b) Drop height: As specified for severe service class
(c) Drop surface: 0.50 inch minimum steel plate, or 4 inch maximum concrete slab.
(d) Rejection criteria: Evidence of damage in accordance with method 2015 of MIL-STD-1344 or failure to pass the dielectric withstanding voltage test specified in 4.7.1 or the insulation resistance test specified in 4.7.2.

.7.14 Vibration. The terminals or switches with cabled plugs mated shall rgized and shall, while mounted to simulate a shipboard installed condi- be subjected to the type I vibration test in accordance with MIL-STD-167-1. ability criteria shall be as specified in 3.6.14. Following this test, mples shall be subjected to the tests specified in 4.7.1 and 4.7.2.

.7.15 Salt spray. Unmated plugs and terminals, with covers secured, be subjected to the salt spray test, method 101, condition A in accordance IL-STD-202. The salt solution shall be 5 percent. The equipment shall energized during the test. Upon completion, the plugs shall be examined ermine conformance with 3.6.15 and shall be subjected to the test speci- 4.7.7. (Prior to making electrical measurements, the test samples be cleaned in accordance with MIL-STD-202.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

4.7.16 Watertightness (bulkhead terminals). A back connected terminal with
shall be mounted to simulate one side of a bulkhead terminal assembly as
n on figure 3. The terminal, with covers removed and with wiring connected
he terminal, through the seal and a simulated bulkhead, shall be subjected
water gauge pressure of 6.5 pounds per square inch (lb/in^2) for 2 hours to
rmine its watertightness as specified in 3.6.16. The following details and
ptions shall apply:

(a) Rejection criteria: Evidence of water leakage through the bulkhead.
(b) Water seepage through the conductor shall not be considered failure of the test.

4.7.17 Spraytightness (riser and bulkhead terminals). A terminal with
rs installed and cable entrance blanked off shall be subjected to the
ytightness test in accordance with MIL-STD-108 to meet the requirements
ified in 3.6.17. Entrance of water into the interior of the enclosure
l be cause for rejection.

4.8 Inspection of packaging. Except when industrial packaging is speci-
, the sampling and inspection of the preservation and interior packaging
l be in accordance with groups A and B quality conformance inspection
irements of MIL-P-116. The sampling and inspection of the packing and
ing for shipment and storage shall be in accordance with the quality assur-
provisions of the applicable container specification shown in section 5
the marking requirements of MIL-STD-129. The inspection of industrial
aging shall be as specified in the contract (see 6.2.1).

5. PACKAGING

(The packaging requirements specified herein apply only for direct Govern-
acquisition. For the extent of applicability of the packaging requirements
eferenced documents listed in section 2, see 6.5.)

5.1 Packaging. Packaging shall be level A or C, as specified (see 6.2.1).

5.1.1 Level A. Each terminal, plug, switch and seal shall be packaged in
rdance with MIL-P-116.

5.1.2 Level C. Each terminal, plug, switch and seal shall be individually
erved and packaged in accordance with the manufacturer's commercial practice
ssure carrier acceptance and adequate protection against physical damage dur-
shipment from the supply source to the first receiving activity.

5.2 Packing. Packing shall be level A or C as specified (see 6.2.1).

5.2.1 Level A. Each terminal, plug, switch, and seal preserved and pack-
in accordance with 5.1 and as specified (see 6.2.1) shall be packed in
rboard boxes in accordance with type CF, class weather resistant, variety
grade W5C or W6C, style RSC of PPP-B-636. Box enclosure and reinforcement
l be accomplished in accordance with PPP-B-636.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

5.2.2 Level C. Each terminal, plug, switch, and seal preserved and packin accordance with 5.1 and as specified (see 6.2.1), shall be packed in rdance with the contractor's commercial practice to assure carrier acceptance adequate protection against physical damage during shipment from the supply ce to the first receiving activity. Minimum requirements shall be in accore with Uniform Freight Classification Ratings, Rules and Regulations.

5.3 Marking. In addition to any special marking required (see 6.2.1) or pecified herein, interior and exterior shipping containers shall be marked ccordance with MIL-STD-129.

5.4 Use of polystyrene (loose-fill).

5.4.1 Level A preservation-packaging and packing. Use of polystyrene se-fill) material is prohibited for level A preservation-packaging and ls A and B packing applications such as cushioning, filler, and dunnage.

5.4.2 Level C preservation-packaging and packing. Unless otherwise approved he contracting activity (see 6.2.1), use of polystyrene (loose-fill) material rohibited for level C preservation-packaging and packing applications such ushioning, filler, and dunnage. When approved, interior packages (unit and rmediate) and shipping containers shall be marked and labeled as follows:

"CAUTION

Contents cushioned, and so forth, with polystyrene (loose-fill) material. Not to be taken aboard ship. Remove and discard loose-fill material before shipboard storage. If required, recushion with cellulosic material, bound fiber, fiberboard, or transparent flexible cellular material."

6. NOTES

6.1 Intended use. Terminals, plugs, switches, and seals covered by this ification are intended for use with the casualty power system on Naval ships. e items are part of the casualty power interconnect system that is installed oard ship to provide temporary transmission of power to span damaged areas.

(a) Upper and lower riser terminal (for use with cable type LSTSGU-75 in accordance with MIL-C-24643/16). Used to provide transmission of power between decks.
(b) Back-connected terminal (for use with interconnecting wire, size AWG 2 in accordance with MIL-W-16878/8). Used to provide transmission of power through nonwatertight bulkheads and from switchboards or equipment enclosures.
(c) Bulkhead terminal, watertight (for use with two back-connected terminals and seals, and interconnecting wire size AWG 2 in accordance with MIL-W-16878/8). Used to provide transmission of power through watertight bulkheads. The bulkhead terminal installation consists of two back connected terminals and two rubber seals in accordance with MIL-T-24552/3 to prevent water leakage through the bulkhead without the aid of mated plugs or covers. Bulkhead terminal is mounted as shown on figure 3.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

(d) Switches are used with connectorized cable type THOF-42 in accordance with MIL-C-915/6. The cables provide a means of supplying and interrupting power to loads that may require intermittent power from the casualty power system.
(e) Plugs are used with the terminals and switches and are furnished unterminated. When completely assembled, the plugs form part of the THOF-42 cable assembly.

6.2 Ordering data.

6.2.1 Acquisition requirements. Acquisition documents should specify the owing:

(a) Title, number, and date of this specification.
(b) Title, number, and date of the applicable specification sheet, and the part number (see 1.2 and 3.1).
(c) Marking if other than as specified (see 3.8.1 and 5.3).
(d) Method of inspecting industrial packaging (see 4.8).
(e) Level of preservation-packaging and level of packing required (see 5.1 and 5.2).
(f) When use of polystyrene (loose-fill) material is approved (see 5.4.2).

6.2.2 Data requirements. When this specification is used in an acquisi- and data are required to be delivered, the data requirements identified w shall be developed as specified by an approved Data Item Description (DD 1664) and delivered in accordance with the approved Contract Data Require- s List (CDRL), incorporated into the contract. When the provisions of DoD Supplement, Part 27, Sub-Part 27.410-6 (DD Form 1423) are invoked and the orm 1423 is not used, the data specified below shall be delivered by the ractor in accordance with the contract or purchase order requirements. verable data required by this specification are cited in the following graph.

ragraph no.	Data requirement title	Applicable DID no.	Option
4.4.1.1	First article inspection report	DI-T-4902	--

(Data item descriptions related to this specification, and identified in ion 6 will be approved and listed in such DoD 5010.12-L., AMSDL. Copies ata item descriptions required by the contractors in connection with spec- acquisition functions should be obtained from the Naval Publications and s Center or as directed by the contracting officer.)

6.2.2.1 The data requirements of 6.2.2 and any task in sections 3, 4, or 5 his specification required to be performed to meet a data requirement may be ed by the contracting/acquisition activity upon certification by the offeror identical data were submitted by the offeror and accepted by the Government r a previous contract for identical items acquired to this specification. does not apply to specific data which may be required for each contract rdless of whether an identical item has been supplied previously (for example, reports).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

6.3 Qualification. With respect to products requiring qualification, awards will be made only for products which are, at the time set for opening of bids, qualified for inclusion in Qualified Products List QPL-24552 whether or not such products have actually been so listed by that date. The attention of the contractors is called to these requirements, and manufacturers are urged to arrange to have the products that they propose to offer to the Federal Government tested for qualification in order that they may be eligible to be awarded contracts or purchase orders for the products covered by this specification. The activity responsible for the Qualified Products List is the Naval Sea Systems Command, SEA 55Z3, Department of the Navy, Washington, DC 20362-5101, and information pertaining to qualification of products may be obtained from that activity. Application for qualification tests shall be made in accordance with "Provisions Governing Qualification SD-6" (see 6.3.1).

6.3.1 Copies of "Provisions Governing Qualification SD-6" may be obtained upon application to Commanding Officer, Naval Publications and Forms Center, 5801 Tabor Avenue, Philadelphia, PA 19120.

6.4 First article. When a first article inspection is required, the item should be a first article sample. The first article should consist of two units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of first article test results and disposition of first articles. Invitations for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract.

6.5 Sub-contracted material and parts. The packaging requirements of referenced documents listed in section 2 do not apply when material and parts are acquired by the contractor for incorporation into the equipment and lose their separate identity when the equipment is shipped.


6.6 Subject term (key word) listing.

Electrical power connections
Plugs
Power system, casualty
Seals
Switches
Terminals

6.7 Changes from previous issue. Asterisks are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.


Preparing activity:
Navy - SH
(Project 5940-NB02)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

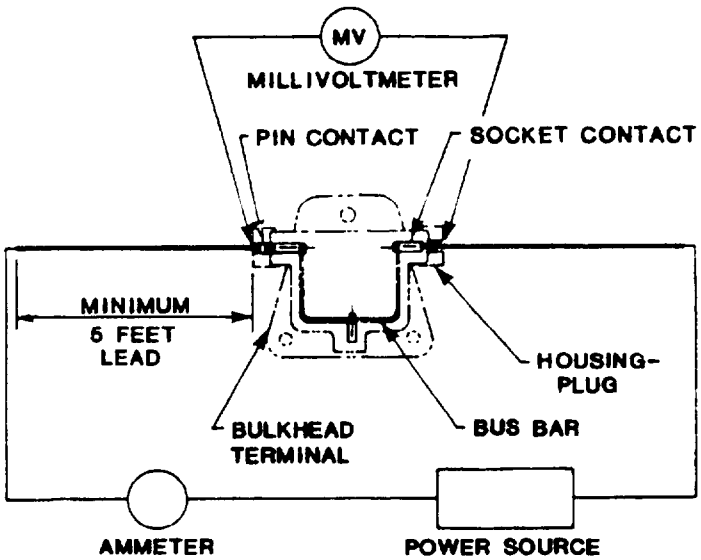

SH 11137


FIGURE 1. Socket contact bus assembly.

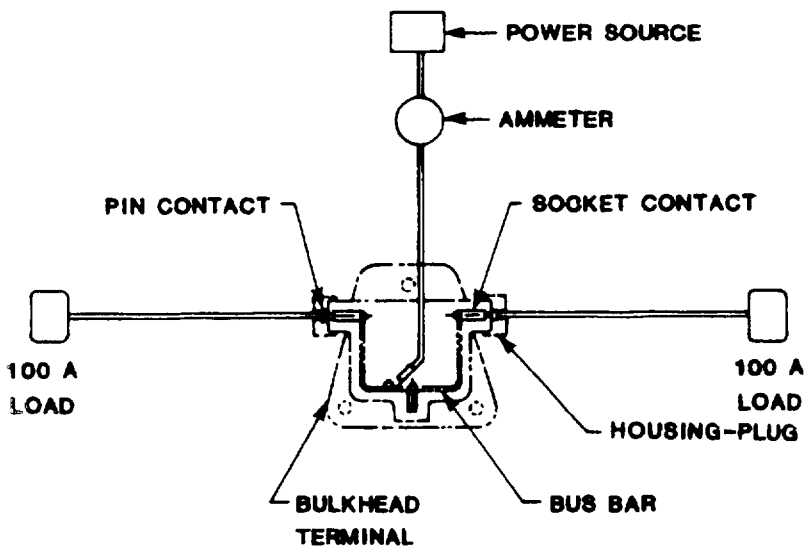

11138

FIGURE 2. Electrical load test configuration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

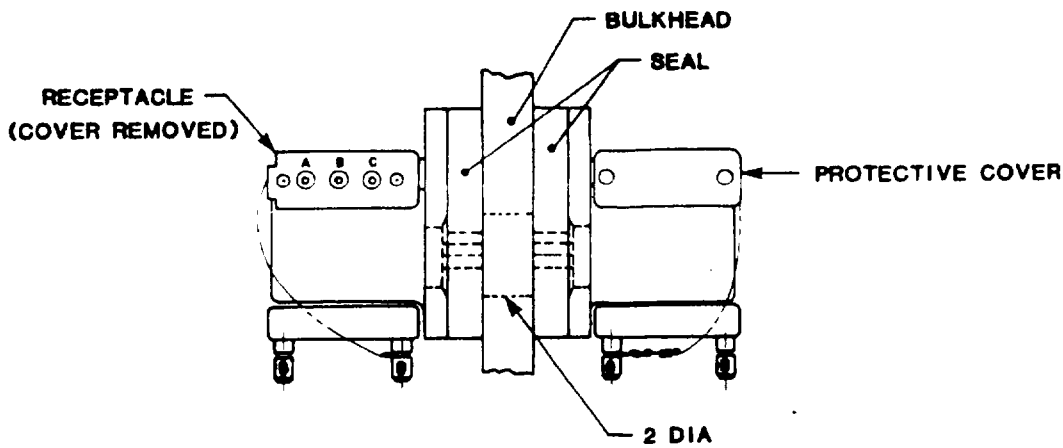

SH 11139

FIGURE 3. Typical bulkhead terminal installation.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document*(s)* or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE NAVY

MANDER
AL SEA SYSTEMS COMMAND (SEA 55Z3)
ARTMENT OF THE NAVY
HINGTON, DC 20362

OFFICIAL BUSINESS
ENALTY FOR PRIVATE USE $300

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATES

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 12503 WASHINGTON D. C.
POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE NAVY

COMMANDER
NAVAL SEA SYSTEMS COMMAND (SEA 55Z3)
DEPARTMENT OF THE NAVY
WASHINGTON, DC 20362

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-T-24552A(SH)	TERMINALS AND SEALS, PLUGS AND SWITCH, CASUALTY POWER SYSTEMS, RECEPTACLE TYPE, GENERAL SPECIFICATION FOR

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR ☐ USER ☐ MANUFACTURER ☐ OTHER *(Specify)*:
b. ADDRESS *(Street, City, State, ZIP Code)*	

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

DD FORM 82 MAR 1426 PREVIOUS EDITION IS OBSOLETE

Source: https://assist.dla.mil – Downloaded: 2026-10-19T22:31Z
Check the source to verify that this is the current version before use.