
MILITARY SPECIFICATION SHEET

TERMINALS AND SEALS, PLUGS AND SWITCH, CASUALTY POWER, SWITCH, PORTABLE 100-AMPERE, 450-VOLT, ALTERNATING CURRENT, THREE-PHASE, SYMBOL NO. 1041.1

This specification is approved for use within the Naval Sea Systems Command, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the terminal described herein shall consist of this specification and the latest issue of MIL-T-24552.

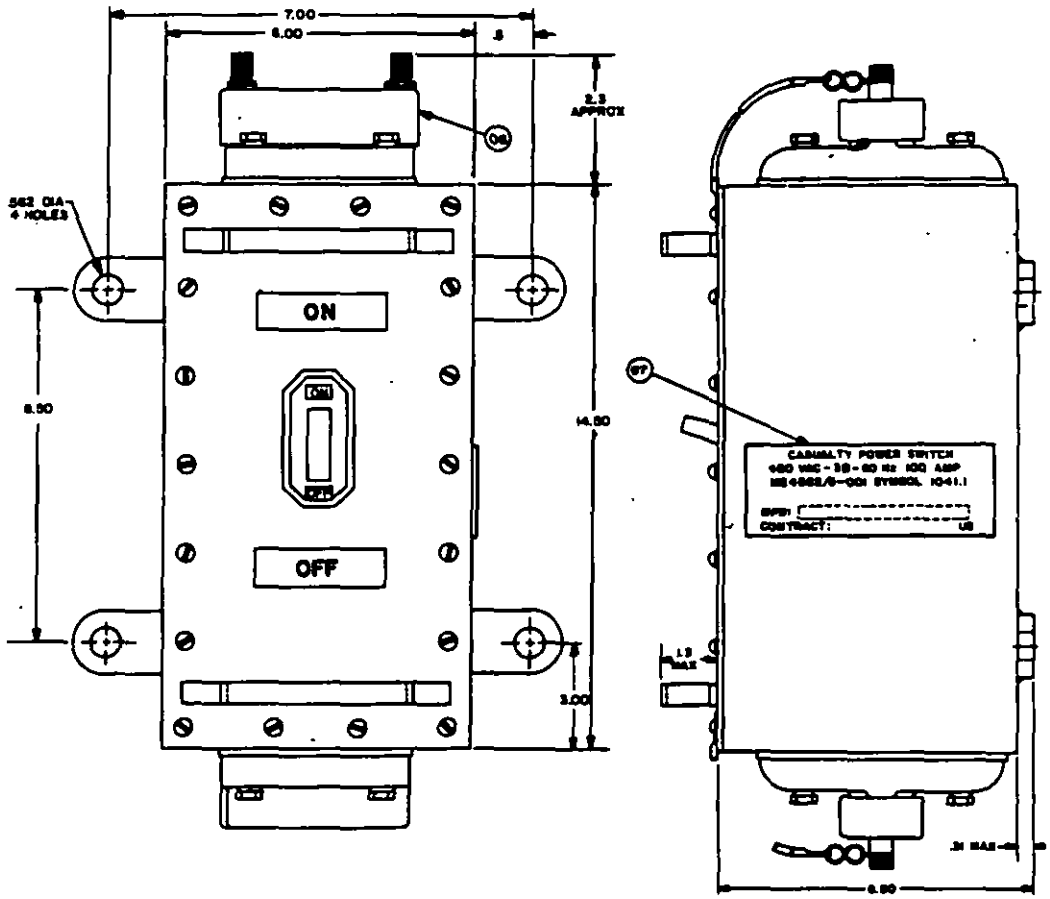


SH 131809

FIGURE 1. Casualty power switch.


AMSC N/A
DISTRIBUTION STATEMENT A Approved for public release; distribution unlimited

FSC 5940

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:32Z
Check the source to verify that this is the current version before use.

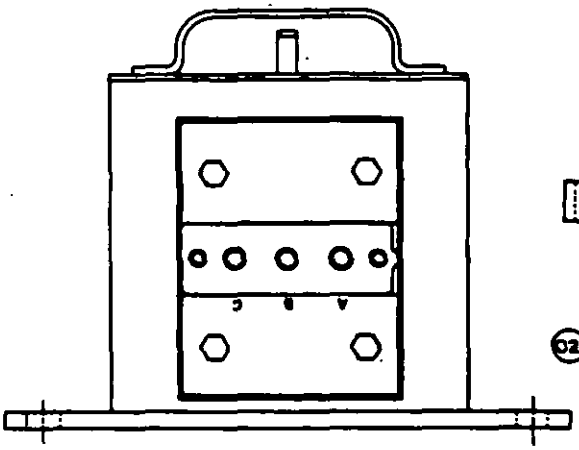


Switch assembly, bottom view.

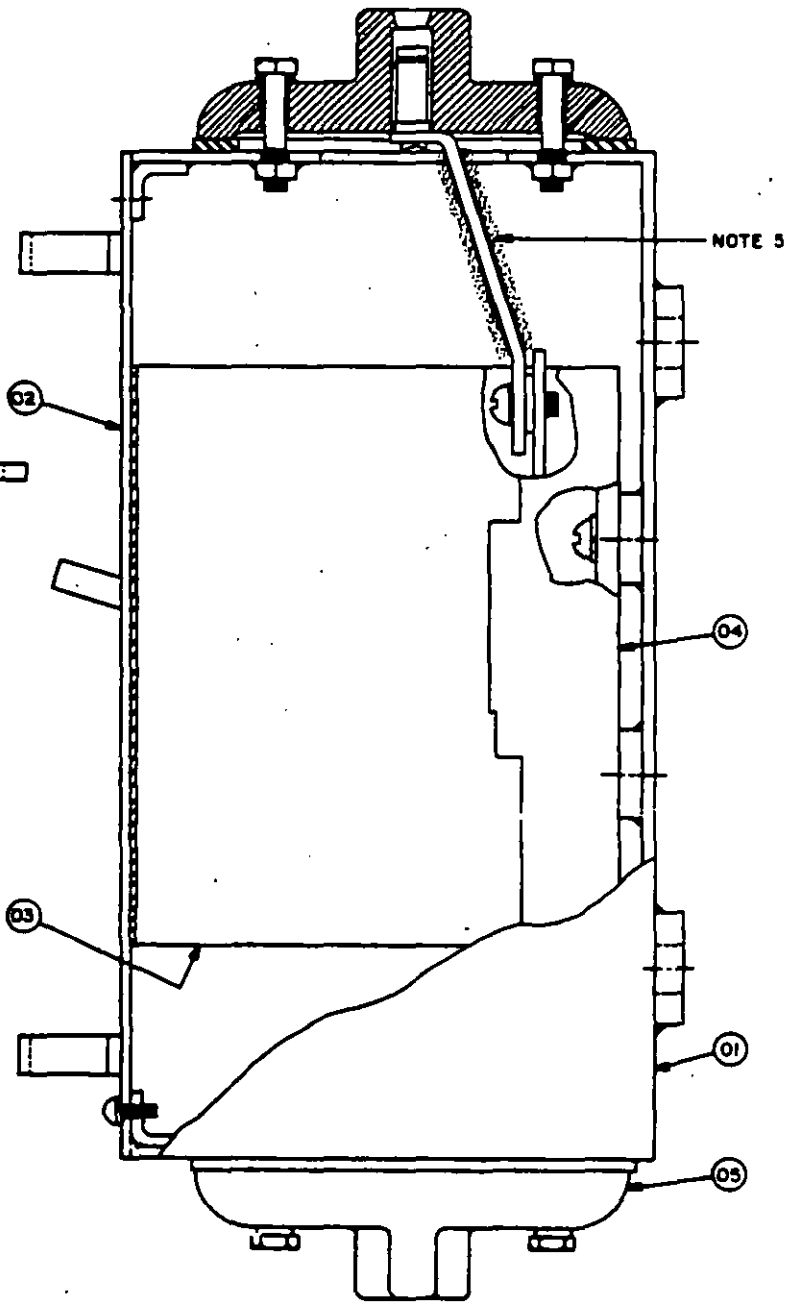



SH 131810

FIGURE 2. Side and bottom views.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:32Z
Check the source to verify that this is the current version before use.

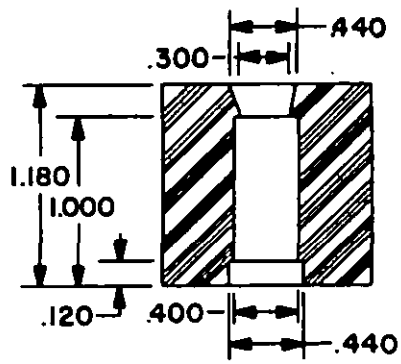

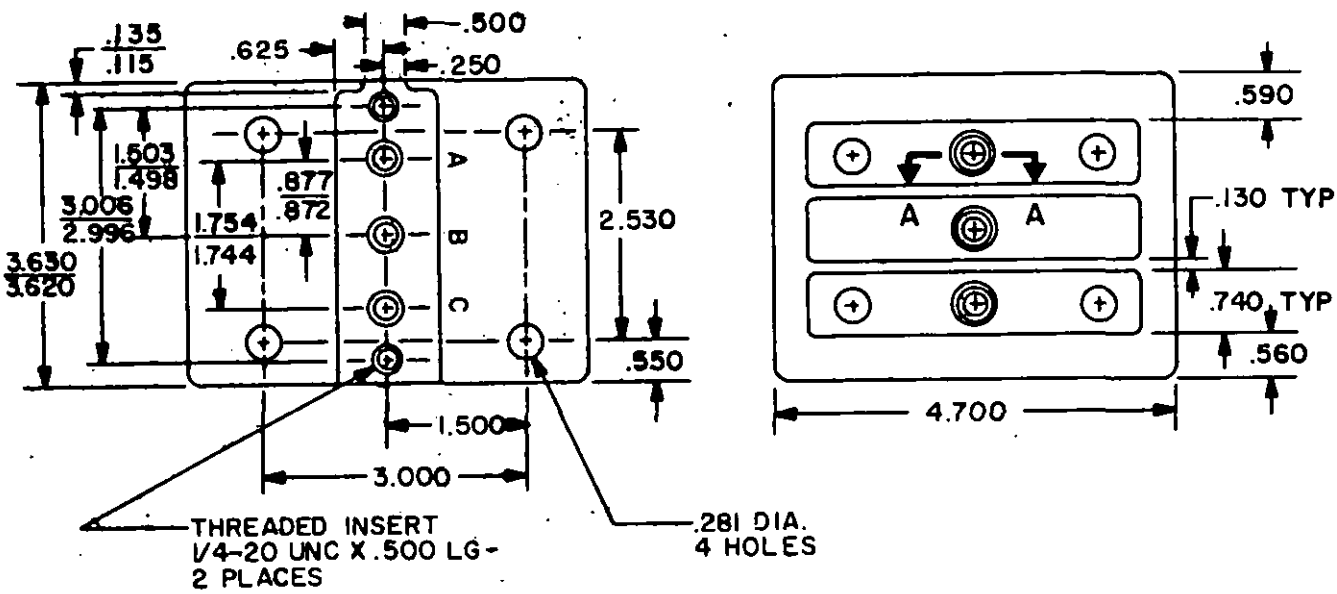


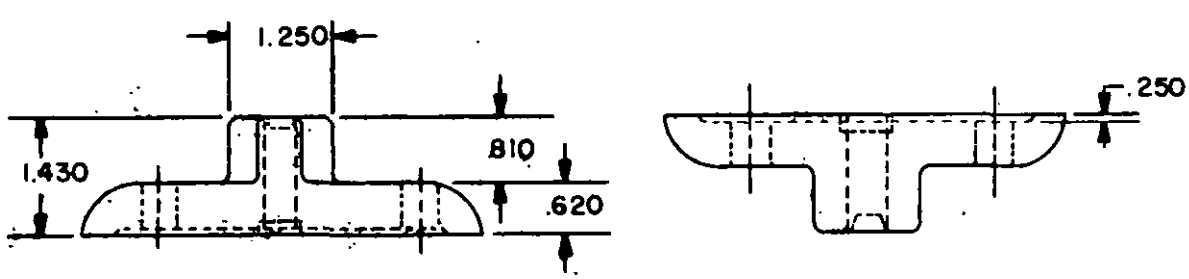

SH 131811

FIGURE 3. Receptacle. (05)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:32Z
Check the source to verify that this is the current version before use.

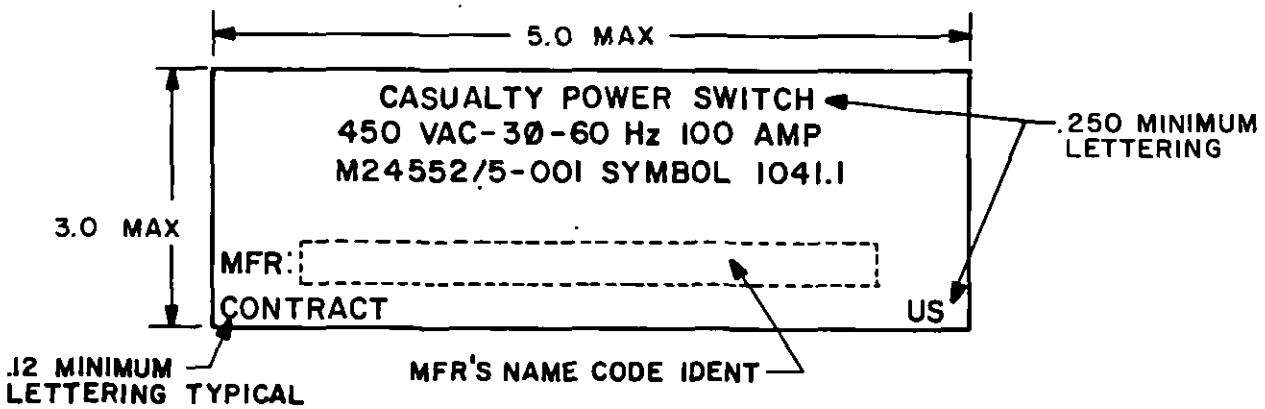

SH 131812


FIGURE 4. Typical identification plate. (07)

TABLE I. List of parts.

Item no.	Description	Qty	Material, specification	Remarks
01	Enclosure	1	Steel, ASTM A 569	
02	Cover	1	Steel, ASTM A 569	
03	Circuit breaker	1	1/	
04	Base, circuit breaker	1	2/	
05	Receptacle	2	Glass reinforced plastic	Figure 3
06	Cover, protective	2	3/	
07	Plate, identification	1	Severe service, MIL-P-15024 MIL-P-15024/5	Figure 4

1/ Disconnect switch (item 03) shall be a type NQB-A101 circuit breaker in accordance with MIL-C-17361.
2/ Base (item 04) shall be of the rear connected type, Gould Electrical Products Division part number ETN-2767 or equal, and in accordance with MIL-C-17361. The rear studs shall be removed and discarded prior to installation in enclosure.
3/ Protective covers shall be the same as the covers used on Casualty Power Terminals (MIL-T-24552/1 and MIL-T-24552/2) complete with securing cable.

Source: https://assist.dla.mil -- Downloaded: 20261O-19T22:32Z
Check the source to verify that this is the current version before use.

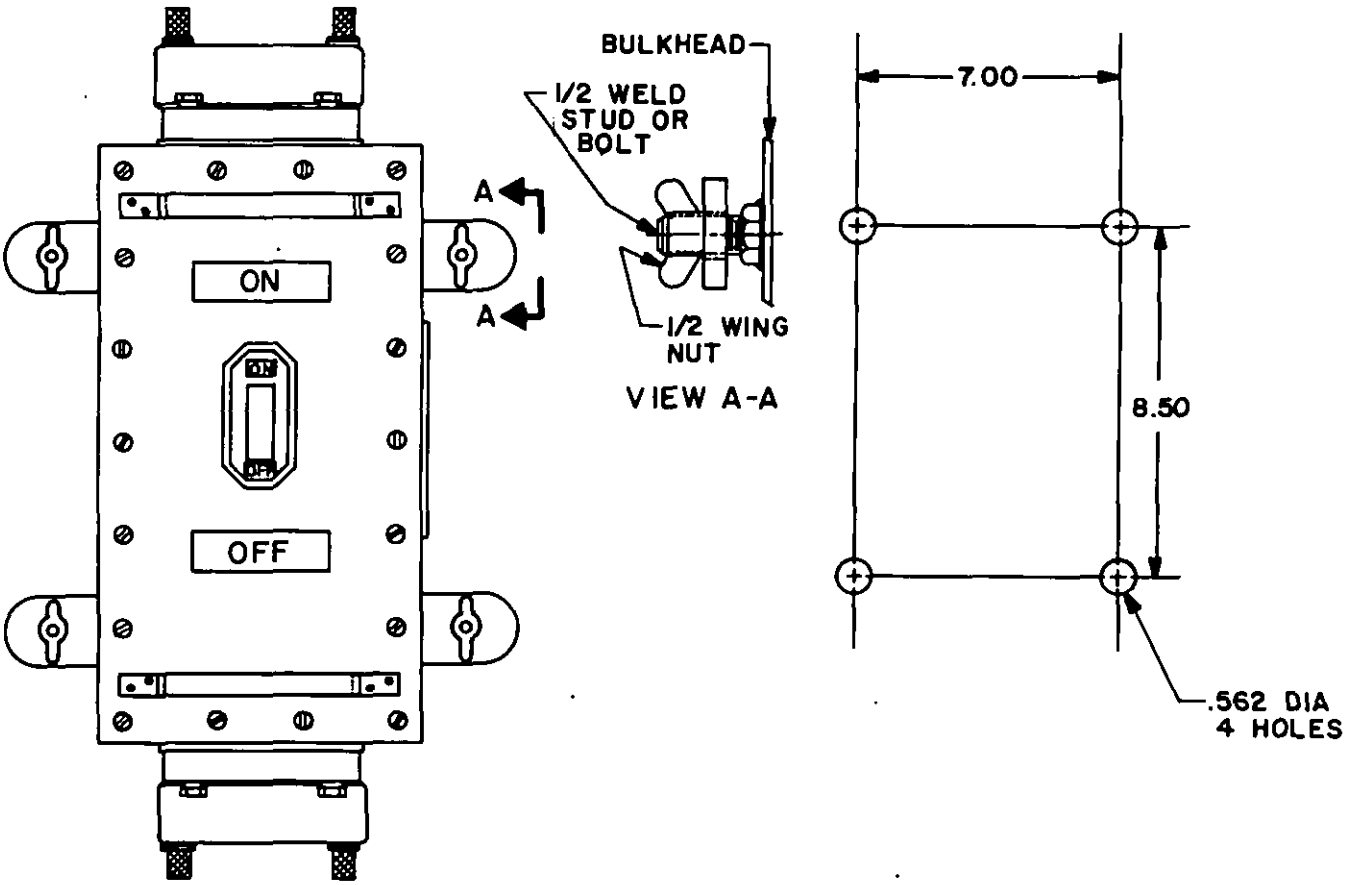

SH 131813

FIGURE 5. Typical installation.

NOTES:

1. All dimensions are in inches.
2. All tolerances, unless otherwise specified, are: plus or minus 0.1 for one place decimals, plus or minus 0.03 for two place decimals and plus or minus 0.005 for three place decimals. Angular tolerances are plus or minus 1/2 degrees.
3. Mating plug: Military Part No. M24552/4-001 (not furnished).
4. Military Part No. M24552/5-001.
5. Shrink tubing in accordance with MIL-I-23053 and MIL-I-23053/4, class 2, may be utilized to provide adequate creepage and clearance distances.

REQUIREMENTS:

1. Electrical rating: 100 amperes per phase (maximum).
2. Finish: The metal enclosure shall be completely painted in accordance with the requirements of MIL-E-917.
3. Qualification: Not required.
4. First article: First article inspection shall consist of the tests specified in table I of MIL-T-24552.

Preparing activity:
Navy
(Project 5940-NB02-05)

Source: https://assist.dla.mil -- Downloaded: 202610-19T22:32Z
Check the source to verify that this is the current version before use.