[INCH-POUND]
A-A-52592A
29 March 2024
SUPERSEDING
A-A-52592
15 March 1996

# COMMERCIAL ITEM DESCRIPTION

# PIPE FITTINGS: ONE OR MORE ENDS GROOVED

The General Services Administration has authorized the use of this commercial item description by all federal agencies.

1. SCOPE. This commercial item description (CID) covers requirements for grooved and combination type pipe fittings. Grooved-type pipe fittings are intended for use as components of portable pipelines conveying light petroleum products or water.

2. SALIENT CHARACTERISTICS

2.1 Materials. Unless otherwise specified, materials shall be in accordance with the manufacturer's material specifications. The use of recovered material made in compliance with regulatory requirements is acceptable providing that all requirements of this CID are met.

2.1.1 Adapters and flanged reducer fittings.

2.1.1.1 Aluminum flanged fittings. Aluminum flanged fittings shall be fabricated from round aluminum-alloy tubing conforming to UNS A96061-T6, wall thickness to fit the application, and flanges of aluminum-alloy forgings conforming to ASTM B247 alloy UNS A96151, or aluminum-alloy castings conforming to ASTM B26/B26M, alloy and temper to fit the application.

Beneficial comments, recommendations, additions, deletions, clarifications, and any other data that may improve this document should be sent to U.S. Army Ground Vehicle Systems Center, ATTN: FCDD-GVS-SAT, MS #268, 6501 E. 11 Mile Road, Detroit Arsenal, MI 48397-5000 or emailed to usarmy.detroit.devcom-gvsc.mbx.standardization@army.mil. Since contact information can change, you may want to verify the currency of this address information using the ASSIST online database at https://assist.dla.mil.

FSC 4730

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.1.1.2 Steel flanged fittings. Steel flanged fittings shall be fabricated from steel pipe conforming to Table I, size and weight as shown in Table II, and flanges of steel selected by the contractor subject to all the provisions of this specification.

2.1.1.3 Iron flanged fittings. Iron flanged fittings shall be fabricated from steel pipe conforming to Table I, size and weight as shown in Table II, and flanges of malleable iron castings conforming to ASTM A47/A47M, grade 32510, or ductile iron castings conforming to ASTM A536, grade 65-45-12.

2.1.2 Couplings.

2.1.2.1 Steel couplings. Steel couplings shall be steel pipe conforming to Table I, size and weight as shown in Table II.

2.1.2.2 Aluminum couplings. Aluminum couplings shall be round aluminum-alloy tube conforming to ASTM B210/B210M, alloy UNS A96061-T6, wall thickness to fit the application.

Table I. Pipe requirements.

| Nominal pipe size (inches) | Outside diameter (inches) | Wall thickness (inches) | Minimum hydrostatic test pressure (psig) |
|---|---|---|---|
| 2 | 2.375 | 0.154 | 1500 |
| 3 | 3.500 | 0.216 | 1600 |
| 4 | 4.500 | 0.219 | 1250 |
| | 4.500 | 0.237 | 1500 |
| 6 | 6.625 | 0.219 | 900 |
| | 6.625 | 0.280 | 1250 |
| 8 | 8.625 | 0.250 | 800 |
| | 8.625 | 0.322 | 1200 |
| | 8.625 | 0.375 | 1400 |
| 10 | 10.75 | 0.307 | 900 |
| 12 | 12.75 | 0.250 | 500 |
| | 12.75 | 0.281 | 600 |
| | 12.75 | 0.312 | 750 |
| | 12.75 | 0.375 | 1000 |
| 14 | 14.00 | 0.312 | 600 |
| 16 | 16.00 | 0.312 | 550 |
| 18 | 18.00 | 0.312 | 500 |

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.1.3 Fittings (except adapter, coupling, and flanged reducer).

2.1.3.1 Iron fittings. Fittings shall be malleable iron castings conforming to ASTM A47/A47M, grade 32510, or ductile iron castings conforming to ASTM A536, grade 65-45-12.

2.1.3.2 Steel fittings. Steel fittings shall be steel selected by the contractor and subject to all provisions of this specification.

2.1.3.3 Aluminum fittings. Aluminum fittings shall be aluminum-alloy forgings conforming to ASTM B247, alloy UNS A96151, or aluminum-alloy castings conforming to ASTM B26/B26M, alloy and temper to fit the application.

2.1.4 Fitting ends.

2.1.4.1 Beveled. Beveled ends shall conform to ASME B16.25.

2.1.5 Flanged ends.

2.1.5.1 Cast iron. Cast iron flanged ends shall conform to ASME B16.1, class 125 or 250.

2.1.5.2 Steel. Steel flanged ends shall conform to ASME B16.5, class 150 or 300.

2.1.5.3 Aluminum. Aluminum-alloy flanged ends shall be faced and drilled and conform to ASME B16.1, class 125 or 250, or ASME B16.5, class 150 or 300.

2.1.6 Grooved ends. Grooved ends shall conform to the dimensions shown on Figure 1. The land-sealing surface shall be smooth and free from mill marks and shall have a roughness height rating of not more than 500 and conform to ASME B46.1.

2.1.7 Threaded ends. Threaded ends shall be National Pipe Thread (NPT) and conform to ASME B1.20.1.

2.2 Design and construction. Fittings shall be malleable iron, ductile iron, steel, or aluminum alloy, as specified (see 6.1 and 6.3). All fittings shall have one end grooved and the other end beveled, flanged, grooved, or threaded. The groove may be continuous or backstop lug design. As specified (see 6.1 and 6.3), fittings may be drilled, tapped, and a pipe plug inserted for 0.25-inch, 0.50-inch, 0.75-inch, or 2-inch National Pipe Thread (NPT) connection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table II. Pipe Requirements.

| Nominal Pipe Size (inches) | Outside Pipe Diameter (inches) | Wall Thickness (inches) | Minimum Weight (lb./ft) | Minimum Hydrostatic Test Pressure (psig) |
|---|---|---|---|---|
| 3/4 | 1.050 | 0.154 | 1.13 | 2000 |
| 1 | 1.315 | 0.154 | 1.68 | 2000 |
| 1-1/4 | 1.660 | 0.154 | 2.27 | 2000 |
| 1-1/2 | 1.900 | 0.154 | 2.72 | 2000 |
| 2 | 2.375 | 0.154 | 3.65 | 2000 |
| 2-1/2 | 2.875 | 0.154 | 5.79 | 1800 |
| 3 | 3.500 | 0.216 | 7.58 | 1800 |
| 3-1/2 | 4.000 | 0.216 | 9.11 | 1800 |
| 4 | 4.500 | 0.219 | 10.79 | 1600 |
| | 4.500 | 0.237 | 10.79 | 1600 |
| 5 | 5.563 | 0.219 | 14.62 | 1600 |
| 6 | 6.625 | 0.219 | 18.97 | 1400 |
| | 6.625 | 0.280 | 18.97 | 1400 |
| 8 | 8.625 | 0.250 | 24.70 | 1200 |
| | 8.625 | 0.322 | 24.70 | 1200 |
| | 8.625 | 0.375 | 24.70 | 1200 |
| 10 | 10.750 | 0.307 | 28.04 | 1000 |
| 12 | 12.750 | 0.250 | 33.38 | 1000 |
| | 12.750 | 0.281 | 33.38 | 1000 |
| | 12.750 | 0.312 | 33.38 | 1000 |
| | 12.750 | 0.375 | 33.38 | 1000 |
| 14 | 14.000 | 0.312 | 36.71 | 800 |

2.2.1 Adapters and flanged reducers. Cast-iron adapters and flanged reducers shall consist of steel pipe threaded into a cast-iron flange. Steel adapters and flanged reducers shall consist of steel pipe threaded or welded to a steel flange. When pipe and flange are threaded together, the threads shall be coated with a nonhardening, nongalling compound inert to aromatic gasoline. Aluminum adapters and flanged reducers shall consist of aluminum-alloy tubing welded to an aluminum-alloy flange.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2.2 Tees. When specified (see 6.1) tees shall be furnished with a 1/2-inch cleaner guide. Material of cleaner guide for aluminum fittings shall be 1/2-inch aluminum. Material of cleaner guide for steel or ductile iron fittings shall be 1/2-inch steel. Cleaner guide shall be attached to the fitting by brazing or welding across the inside diameter of the branch outlet, with the inner side in line with the bore of the main outlets. Joining processes shall not reduce the strength of the fitting to the extent that the fitting could not withstand the desired hydrostatic test pressure. Appropriate filler material and flux shall be used to prevent corrosion.

2.2.3 Dimensions.

2.2.3.1 Fitting lengths. Lengths for adapters, couplings, and reducers shall be as specified as part of the specification part number (see 6.1 and 6.3). All other fitting dimensions shall conform to Table III.

Table III. Fitting length.

| **Cap** | |
|---|---|
| Nominal size (inches) 3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6, 8, 10, 12, and 14. | |
| Length: Seats flush with outside of coupling. | |
| **Cross** | |
| Nominal size (inches) | Length of cross (inches) measured center to ends, all ends grooved |
| 3/4 | 2-1/4 |
| 1 | 2-1/4 |
| 1-1/4 | 2-3/4 |
| 1-1/2 | 2-3/4 |
| 2 | 3-1/4 |
| 2-1/2 | 3-3/4 |
| 3 | 4-1/4 |
| 3-1/2 | 4-1/2 |
| 4 | 5 |
| 5 | 5-1/2 |
| 6 | 6-1/2 |
| 8 | 7-3/4 |
| 10 | 9 |
| 12 | 10 |
| 14 | 11 |

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table III. Fitting length - Continued.

| **Elbows** | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| Nominal size (inches) | Length of elbows (inches) Both ends grooved | | | | | External threaded one end | | | |
| | Center to end | | | End to end | | Center to threaded end | | Center to grooved end | |
| | 90° | 45° | 22-1/2° | 11-1/4° | Adjustable | 90° | 45° | 90° | 45° |
| 3/4 | 2-1/4 | 1-1/2 | 1-5/8 | 1-3/8 | - | 2-1/4 | 1-1/2 | 2-1/4 | 1-1/2 |
| 1 | 2-1/4 | 1-3/4 | 1-5/8 | 1-3/8 | 3-1/4 | 2-1/4 | 1-3/4 | 2-1/4 | 1-3/4 |
| 1-1/4 | 2-3/4 | 1-3/4 | 1-3/4 | 1-3/8 | - | 2-3/4 | 1-3/4 | 2-3/4 | 1-3/4 |
| 1-1/2 | 2-3/4 | 1-3/4 | 1-3/4 | 1-3/8 | - | 2-3/4 | 1-3/4 | 2-3/4 | 1-3/4 |
| 2 | 3-1/4 | 2 | 1-7/8 | 1-3/8 | 3-3/4 | 4-1/4 | 3 | 3-1/4 | 2 |
| 2-1/2 | 3-3/4 | 2-1/4 | 2 | 1-1/2 | 4 | 3-3/4 | 2-1/4 | 3-3/4 | 2-1/4 |
| 3 | 4-1/4 | 2-1/2 | 2-1/4 | 1-1/2 | 4-1/2 | 6 | 4-1/4 | 4-1/4 | 2-1/2 |
| 3-1/2 | 4-1/2 | 2-3/4 | 2-1/2 | 1-3/4 | 5 | 6-1/4 | 2-3/4 | 4-1/2 | 2-3/4 |
| 4 | 5 | 3 | 2-5/8 | 1-3/4 | 5-1/4 | 7-1/4 | 5-1/4 | 5 | 3 |
| 5 | 5-1/2 | 3-1/4 | 2-7/8 | 2 | - | - | - | - | - |
| 6 | 6-1/2 | 3-1/2 | 3-1/8 | 2 | 6-1/4 | 6-1/2 | 3-1/2 | 6-1/2 | 3-1/2 |
| 8 | 7-3/4 | 4-1/4 | 3-7/8 | 2 | 7-3/4 | - | - | - | - |
| 10 | 9 | 4-3/4 | 4-3/8 | 2-1/8 | - | - | - | - | - |
| 12 | 10 | 5-1/4 | 4-7/8 | 2-1/4 | - | - | - | - | - |
| 14 | 21 | 8-3/4 | 5 | 3-1/2 | - | - | - | - | - |

| Nominal size (inches) | **45° Lateral** | |
|---|---|---|
| | Length of lateral (inches) All ends grooved | |
| | Center to long end | Center to short end |
| 3/4 | 4-1/2 | 2 |
| 1 | 5 | 2-1/4 |
| 1-1/4 | 5-3/4 | 2-1/2 |
| 1-1/2 | 6-1/4 | 2-3/4 |
| 2 | 7 | 2-3/4 |
| 2-1/2 | 7-3/4 | 3 |
| 3 | 8-1/2 | 3-1/4 |
| 3-1/2 | 10 | 3-1/2 |
| 4 | 10-1/2 | 3-3/4 |
| 5 | 12-1/2 | 4 |
| 6 | 14 | 4-1/2 |
| 8 | 18 | 6 |
| 10 | 20-1/2 | 6-1/2 |
| 12 | 23 | 7 |
| 14 | 26-1/2 | 7-1/2 |

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table III. Fitting length - Continued.

| Tees | | |
|---|---|---|
| Nominal size (inches) | Length of tees (inches) measured center to ends | |
| | Grooved all ends | Reducing |
| 3/4 x 3/4 x 3/4 | 2-1/4 | - |
| 1 x 1 x 1 | 2-1/4 | - |
| 1-1/4 x 1-1/4 x 1-1/4 | 2-3/4 | - |
| 1-1/2 x 1-1/2 x 1-1/2 | 2-3/4 | - |
| 2 x 2 x 3/4 | - | 3-1/4 |
| x 1 | - | 3-1/4 |
| x 1-1/2 | - | 3-1/4 |
| x 2 | 3-1/4 | - |
| 2-1/2 x 2-1/2 x 2-1/2 | 3-3/4 | - |
| 3 x 3 x 1 | - | 4-1/4 |
| x 1-1/2 | - | 4-1/4 |
| x 2 | - | 4-1/4 |
| x 2-1/2 | - | 4-1/4 |
| x 3 | 4-1/4 | - |
| 3-1/2 x 3-1/2 x 3-1/2 | 4-1/2 | - |
| 4 x 4 x 1 | - | 3-3/4 |
| x 2 | - | 5 |
| x 2-1/2 | - | 5 |
| x 3 | - | 5 |
| x 4 | 5 | - |
| 5 x 5 x 2 | - | 5-1/2 |
| x 3 | - | 5-1/2 |
| x 4 | - | 5-1/2 |
| x 5 | 5-1/2 | - |
| 6 x 6 x 2 | - | 6-1/2 |
| x 2-1/2 | - | 6-1/2 |
| x 3 | - | 6-1/2 |
| x 4 | - | 6-1/2 |
| x 5 | - | 6-1/2 |
| x 6 | 6-1/2 | - |
| 8 x 8 x 2 | - | 7-3/4 |
| x 3 | - | 7-3/4 |
| x 4 | - | 7-3/4 |
| x 5 | - | 7-3/4 |
| x 6 | - | 7-3/4 |
| x 8 | 7-3/4 | - |
| 10 x 10 x 2 | - | 9 |
| x 3 | - | 9 |
| x 4 | - | 9 |
| x 5 | - | 9 |
| x 6 | - | 9 |
| x 8 | - | 9 |
| x 10 | 9 | - |
| 12 x 12 x 3 | - | 10 |
| x 4 | - | 10 |
| x 5 | - | 10 |
| x 6 | - | 10 |
| x 8 | - | 10 |
| x 10 | - | 10 |
| x 12 | 10 | - |
| 14 x 14 x 8 | - | 11 |
| x 10 | - | 11 |
| x 12 | - | 11 |
| x 14 | 11 | - |

| Union (flexible) | |
|---|---|
| Nominal size (inches) | Length of union (inches) measured end to end both ends grooved |
| 3/4 | 4 |
| 1 | 4-1/8 |
| 1-1/4 | 4-5/8 |
| 1-1/2 | 4-5/8 |
| 2 | 5 |
| 3 | 5-1/2 |
| 4 | 6-1/2 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2.4 Grooves. Pipe grooves shall be as indicated in Figure 2.

2.3 Performance.

2.3.1 Working and test pressures.

2.3.1.1 Adapter and flanged reducers. Adapter and flanged reducers shall withstand the applicable working and hydrostatic pressures shown in Table IV without evidence of leakage, rupture, or yielding.

Table IV. Working and hydrostatic test pressure.

| Class | Maximum working pressure (WOG) 1/ (psi) | Hydrostatic test pressure (psi) |
|---|---|---|
| 125 | 175 | 250 |
| 150 | 230 | 500 |
| 250 | 500 | 900 |
| 300 | 720 | 1100 |

1/ Water, oil, or gas.

2.3.1.2 Fittings (except adapter and flanged reducers). All fittings except adapter and flanged reducers shall have a working pressure of not less than 600 pounds per square inch (psi) for water, oil, or gas and shall withstand the hydrostatic pressures specified in Table V without evidence of leakage, rupture, or yielding.

Table V. Hydrostatic test pressures.

| Nominal pipe size (inches) | Hydrostatic test pressure (psi) |
|---|---|
| 3/4 | 2000 |
| 1 | 2000 |
| 1-1/4 | 2000 |
| 1-1/2 | 2000 |
| 2 | 2000 |
| 2-1/2 | 1800 |
| 3 | 1800 |
| 3-1/2 | 1800 |

| Nominal pipe size (inches) | Hydrostatic test pressure (psi) |
|---|---|
| 4 | 1600 |
| 5 | 1600 |
| 6 | 1400 |
| 8 | 1200 |
| 10 | 1000 |
| 12 | 1000 |
| 14 | 800 |

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.4 Treatment and painting. The portions of the pipe and fittings normally painted shall have corrosion resistance equal to or exceed that provided by hot dip galvanized 1020 steel, with coating thickness in accordance with ASTM A123/A123M, with zinc phosphate pre-treatment. An alternative coating shall be compared to a galvanized sample (as described above) using the Accelerated Corrosion Test GM 9540P/1 Method B 120 cycles, or until failure of one of the items.

/1 Not to be used on new programs; replaced by GMW14872.

2.5 Identification and markings. Identification and marking of the pipe fittings shall be permanent and legible and shall include, as a minimum, the manufacturer's identification code (CAGE), the contract number, the part identification number (PIN) (see 6.1), and the national stock number (NSN).

3. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered, recycled, bio based and environmentally preferable materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4. PRODUCT CONFORMANCE PROVISIONS

4.1 Responsibility for inspection. The contractor is responsible for the performance of all inspections and tests.

4.2 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID and that the product conforms to the producer's own drawings, specifications, workmanship standards, and quality assurance practices. Items with known defects shall not be submitted for Government acceptance. The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.


5. PACKING. Preservation, packing, and marking shall be as specified in the contract or order.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

6.1 Part or identification number (PIN). The PINs to be used for pipe fittings acquired to this CID are created as follows:

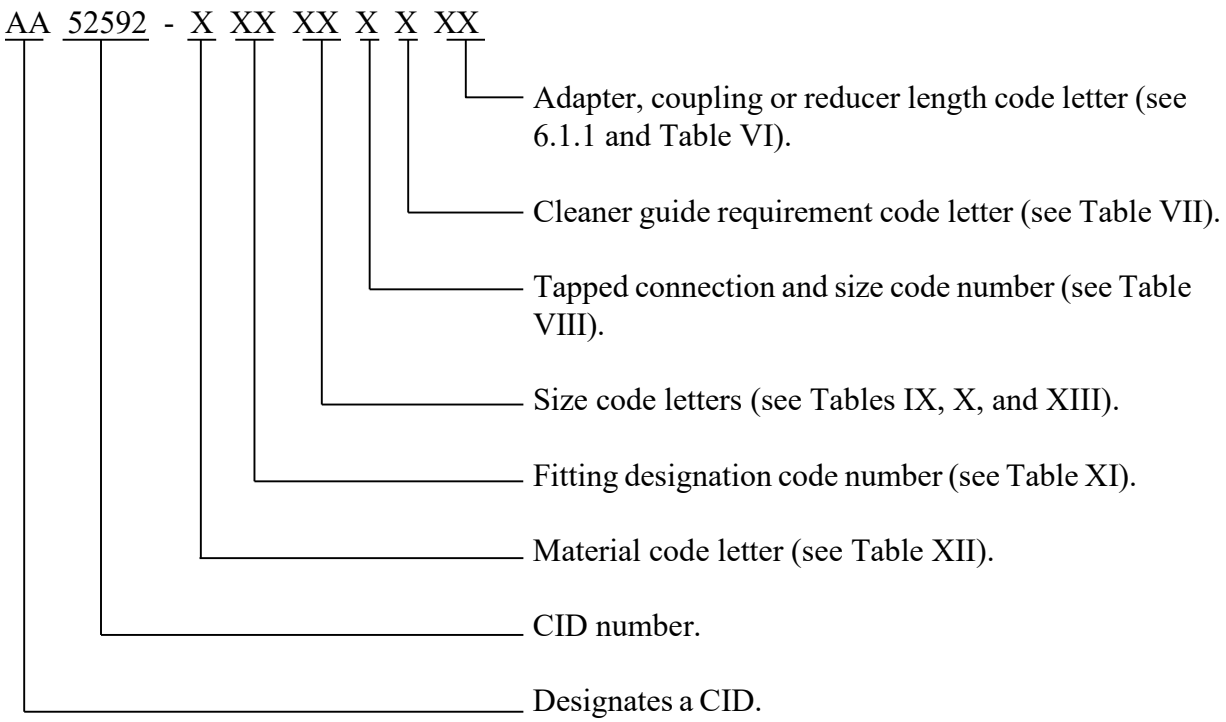


6.1.1 Adapter, coupling and reducer length. The length of the adapter, coupling, or reducer will be identified by a number and letter combination. The number is the number of whole inches in required length, and the letter code indicates the fractional part of an inch of the required length (example: a length of 8.0 inches is 8A, 5.50 inches is 5C, 0.75 inch is 0D, and 10.25 inches is 10B) (see Table VI).

Table VI. Fractional inch code letter.

| Code Letter | Fractional Inch |
|---|---|
| A | 0 |
| B | 1/4 |
| C | 1/2 |
| D | 3/4 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table VII. Cleaner guide code letter.

| Code Letter | Cleaner guide requirement |
|---|---|
| A | Without cleaner guide (for tees). |
| B | With cleaner guide (for tees). |
| C | Without cleaner guide (for fittings other than tee). |

Table VIII. Tapped connection and size code number.

| Code number | Size of drilled and tapped connection (inches) |
|---|---|
| 1 | None |
| 2 | 1/4 |
| 3 | 1/2 |
| 4 | 3/4 |
| 5 | 1 |
| 6 | 2 |

Table IX. Size code letters (except reducers and tees).

| Size code letters | Nominal pipe size (inches) |
|---|---|
| AA | 3/4 |
| AB | 1 |
| AC | 1-1/4 |
| AD | 1-1/2 |
| AE | 2 |
| AF | 2-1/2 |
| AG | 3 |
| AH | 3-1/2 |
| AI | 4 |
| AJ | 5 |
| AK | 6 |
| AL | 8 |
| AM | 10 |
| AN | 12 |
| AO | 14 |

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table X. Reducer size code letters.

| Size code letters | Nominal pipe size (inches) |
|---|---|
| BA | 1-1/2 x 1 |
| BB | 2 x 3/4 |
| BC | x 1 |
| BD | x 1-1/4 |
| BE | x 1-1/2 |
| BF | 2-1/2 x 2 |
| BM | x 2-1/2 |
| BN | x 3 |
| BO | x 3-1/2 |
| BP | 5 x 4 |
| BQ | 6 x 1 |
| BR | x 2 |
| BS | x 3 |
| BT | x 4 |
| BU | x 5 |

| Size code letters | Nominal pipe size (inches) |
|---|---|
| AG | 3 x 1 |
| BH | x 2 |
| BI | x 2-1/2 |
| BJ | 3-1/2 x 3 |
| BK | 4 x 1 |
| BL | x 2 |
| BV | 8 x 3 |
| BW | x 4 |
| BX | x 5 |
| BY | x 6 |
| BZ | 10 x 4 |
| CA | x 6 |
| CB | x 8 |
| CC | 12 x 6 |
| CD | x 8 |
| CE | x 10 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table XI. Fitting designation code number.

| Fitting code number | Fitting kind |
|---|---|
| | ADAPTERS |
| 01 | Flanged (class 125) one end. |
| 02 | Flanged (class 150) one end. |
| 03 | Flanged (class 250) one end. |
| 04 | Flanged (class 300) one end. |
| 05 | CAP |
| | COUPLINGS |
| 06 | Beveled one end. |
| 07 | External threaded one end. |
| 08 | Grooved both ends. |
| 09 | Internal threaded one end. |
| 10 | CROSS |
| | ELBOWS |
| 11 | 90 degree both ends grooved. |
| 12 | 90 degree external threaded one end. |
| 13 | 45 degree both ends grooved. |
| 14 | 45 degree external threaded one end. |
| 15 | 22-1/2 degree both ends grooved. |
| 16 | 11-1/4 degree both ends grooved. |
| 17 | Adjustable both ends grooved. |

| Fitting code number | Fitting kind |
|---|---|
| | LATERALS |
| 18 | 45 degree all ends grooved. |
| | REDUCERS |
| 19 | Grooved both ends. |
| 20 | Flanged (class 125) large end. |
| 21 | Flanged (class 150) large end. |
| 22 | Flanged (class 250) large end. |
| 23 | Flanged (class 300) large end. |
| 24 | Flanged (class 125) small end. |
| 25 | Flanged (class 150) small end. |
| 26 | Flanged (class 250) small end. |
| 27 | Flanged (class 300) small end. |
| 28 | Threaded small end. |
| | TEES |
| 29 | Grooved all ends. |
| 30 | Reduced grooved all ends. |
| 31 | Reducing run ends grooved, branch end external threaded. |
| 32 | Reducing run ends grooved, branch end internal threaded. |
| 33 | Union flexible both ends grooved. |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table XII. Type material code letter.

| Code Letter | Material |
|---|---|
| A | Aluminum alloy. |
| B | Malleable iron, ductile iron or steel. |

Table XIII. Tee size code letters.

| Size letter | Nominal pipe size (inches) |
|---|---|
| DA | 3/4 x 3/4 x 3/4 |
| DB | 1 x 1 x 1 |
| DC | 1-1/4 x 1-1/4 x 1-1/4 |
| DD | 1-1/2 x 1-1/2 x 1-1/2 |
| DE | 2 x 2 x 3/4 |
| DF | x 1 |
| DG | x 1-1/2 |
| DH | x 2 |
| DI | 2-1/2 x 2-1/2 x 2-1/2 |
| DJ | 3 x 3 x 1 |
| DK | x 1-1/2 |
| DL | x 2 |
| DM | x 2-1/2 |
| DN | x 3 |
| EB | x 4 |
| EC | x 5 |
| ED | x 6 |
| EE | 8 x 8 x 2 |
| EF | x 3 |
| EG | x 4 |
| EH | x 5 |
| EI | x 6 |
| EJ | x 8 |
| EK | 10 x 10 x 2 |
| EL | x 3 |
| EM | x 4 |
| EN | x 5 |
| EO | x 6 |

| Size letter | Nominal pipe size (inches) |
|---|---|
| DO | 3-1/2 x 3-1/2 x 3-1/2 |
| DP | 4 x 4 x 1 |
| DQ | x 2 |
| DR | x 2-1/2 |
| DS | 4 x 4 x 3 |
| DT | x 4 |
| DU | 5 x 5 x 2 |
| DV | x 3 |
| DW | x 4 |
| DX | x 5 |
| DY | 6 x 6 x 2 |
| DZ | x 2-1/2 |
| EA | x 3 |
| EP | x 8 |
| EQ | x 10 |
| ER | 12 x 12 x 3 |
| ES | x 4 |
| ET | x 5 |
| EU | x 6 |
| EV | x 8 |
| EW | x 10 |
| EX | x 12 |
| EY | 14 x 14 x 8 |
| EZ | x 10 |
| FA | x 12 |
| FB | x 14 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

6.2 Source of documents.

6.2.1 Code of federal regulations documents. Copies of the Code of Federal Regulations (FAR) are available online at https://www.ecfr.gov.

6.2.2 ASTM documents. Copies of ASTM documents are available online at www.astm.org.

6.2.3 ASME documents. Copies of ASME documents are available online at www.asme.org.

6.2.4 General Motors (GM) documents. Copies of General Motors documents are available online from www.gm.com.

6.3 Ordering data. Acquisition documents must specify the following:

a. Title, number, and date of this CID.
b. Issue of ASSIST to be cited in the solicitation.
c. Type, PIN and quantity of fittings required.
d. Selection of applicable level and packaging requirements.

6.4 Cross-reference data. Pipe fittings conforming to this CID are interchangeable/substitutable with pipe fittings conforming to MIL-P-10388H.

6.5 Changes from previous issue. The margins of this CID are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these citations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the previous issue.


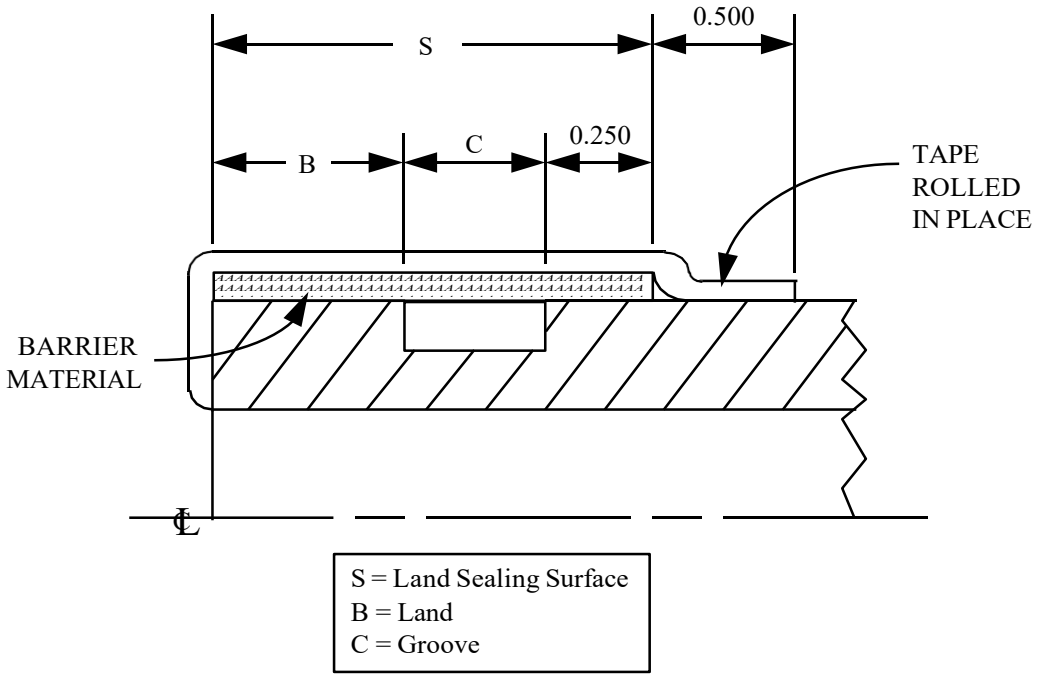



Figure 1. Land sealing surface for grooved end pipe, tube end fittings.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

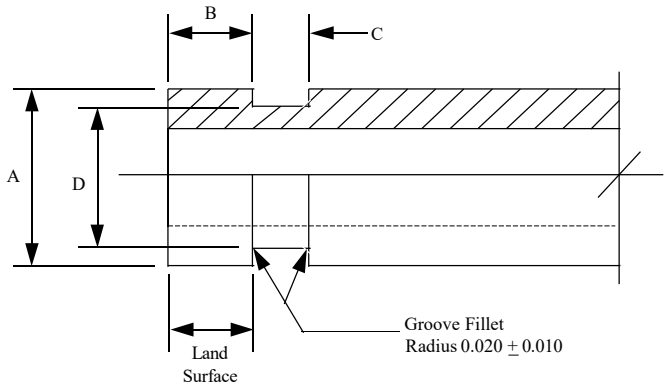


| Nominal Pipe Size | A | | B | C | D |
|---|---|---|---|---|---|
| | Aluminum | Iron 1/ | | | |
| 3/4 | 1.065 +0.000 -0.016 | 1.050 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 0.938 +0.000 -0.015 |
| 1 | 1.330 +0.000 -0.016 | 1.315 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 1.190 +0.000 -0.015 |
| 1-1/4 | 1.675 +0.000 -0.016 | 1.660 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 1.535 +0.000 -0.015 |
| 1-1/2 | 1.915 +0.000 -0.016 | 1.900 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 1.775 +0.000 -0.015 |
| 2 | 2.407 +0.000 -0.016 | 2.375 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 2.250 +0.000 -0.015 |
| 2-1/2 | 2.905 +0.000 -0.016 | 2.875 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 2.720 +0.000 -0.015 |
| 3 | 3.532 +0.000 -0.016 | 3.500 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 3.344 +0.000 -0.018 |
| 3-1/2 | 4.040 +0.000 -0.016 | 4.000 +0.031 -0.016 | 0.625 ±0.031 | 0.313 ±0.031 | 3.834 +0.000 -0.020 |
| 4 | 4.532 +0.000 -0.016 | 4.500 +0.031 -0.016 | 0.625 ±0.031 | 0.375 ±0.031 | 4.334 +0.000 -0.020 |
| 5 | 5.620 +0.000 -0.016 | 5.563 +0.031 -0.016 | 0.625 ±0.031 | 0.375 ±0.031 | 5.395 +0.000 -0.022 |
| 6 | 6.657 +0.000 -0.016 | 6.625 +0.031 -0.016 | 0.625 ±0.031 | 0.375 ±0.031 | 6.455 +0.000 -0.022 |
| 8 | 8.657 +0.000 -0.016 | 8.625 +0.031 -0.016 | 0.750 ±0.031 | 0.437 ±0.031 | 8.441 +0.000 -0.025 |
| 10 | 10.850 +0.000 -0.032 | 10.750 +0.047 -0.031 | 0.750 ±0.031 | 0.500 ±0.031 | 10.562 +0.000 -0.027 |
| 12 | 12.797 +0.000 -0.032 | 12.750 +0.047 -0.031 | 0.750 ±0.031 | 0.500 ±0.031 | 12.531 +0.000 -0.030 |
| 14 | 14.870 +0.000 -0.032 | 14.000 +0.047 -0.031 | 0.936 ±0.031 | 0.500 ±0.031 | 13.781 +0.000 -0.030 |

1/ Steel, Malleable Iron, or Ductile Iron

Figure 2. Pipe Groove.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

MILITARY INTERESTS:

CIVIL AGENCY COORDINATING ACTIVITY:
GSA - FSS

Custodian:
Army - AT

Preparing Activity:
Army - AT

(Project 4730-2023-079)

Review Activity:
DLA - CC

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.