INCH-POUND

MIL-S-13789D
31 January 1990
SUPERSEDING
MIL-S-13789C
11 October 1979

MILITARY SPECIFICATION

STRAINERS, SEDIMENT: PIPELINE, BASKET TYPE

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers basket type sediment strainers for gasoline and oil service lines.

1.2 Classification.

1.2.1. Class, body material, nominal size and type of connections. The class, body material, nominal size and type of inlet and outlet connections of the strainer are identified by a two-digit number (see table I).

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: USA Belvoir Research, Development, and Engineering Center, ATTN: STRBE-TSE, Fort Belvoir, VA 22060-5606 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4730

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

TABLE I. Class, body material, nominal size and connection code number.

Nominal size and type of connections (inches)	Class and body material					
	Class 125 bronze	Class 125 steel or ductile cast iron	Class 150 steel	Class 250 ductile cast iron	Class 300 steel	Class 600 steel
0.75 threaded	01	-	-	-	-	-
1.00 threaded	02	-	-	-	-	-
1.00 flanged	-	06	20	34	48	-
1.25 threaded	03	-	-	-	-	-
1.25 flanged	-	07	21	35	49	-
1.50 threaded	04	-	-	-	-	-
1.50 flanged	-	08	22	36	50	-
2.00 threaded	05	-	-	-	-	-
2.00 flanged	-	09	23	37	51	-
2.50 flanged	-	10	24	38	52	-
3.00 flanged	-	11	25	39	53	-
3.50 flanged	-	12	26	40	54	-
4.00 flanged	-	13	27	41	55	-

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

TABLE I. Class, body material, nominal size and connection code number - Continued.

Nominal size and type of connections (inches)	Class and body material					
	Class 125 bronze	Class 125 steel or ductile cast iron	Class 150 steel	Class 250 ductile iron	Class 300 steel	Class 600 steel
4.00 grooved	-	-	-	-	-	64
5.00 flanged	-	14	28	42	56	-
6.00 flanged	-	15	29	43	57	-
6.00 grooved	-	-	-	-	-	65
8.00 flanged	-	16	30	44	58	-
8.00 grooved	-	-	-	-	-	66
10.00 flanged	-	17	31	45	59	-
10.00 grooved	-	-	-	-	-	67
12.00 flanged	-	18	32	46	60	-
12.00 grooved	-	-	-	-	-	68
14.00 flanged	-	19	33	47	61	-
14.00 grooved	-	-	-	-	-	69

1.2.2 Strainer basket mesh or perforation size and basket pullout device. The basket mesh or perforation size and pullout devices are identified by two alpha characters (see table II).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

TABLE II. Strainer basket mesh or perforation size and basket pullout device code letters.

Strainer basket mesh or perforation size (inches)	Basket pullout device	
	Without	With
40 mesh	AN	AP
80 mesh	BN	BP
130 mesh	CN	CP
0.031 perforation	DN	DP
0.062 perforation	EN	EP
0.125 perforation	FN	FP
0.187 perforation	GN	GP
0.250 perforation	HN	HP
0.375 perforation	JN	JP

1.2.3 Flange gaskets. When strainers are furnished with flange gaskets, they are identified by a single numeric digit (see table III).

TABLE III. Flange gasket code number.

Code number	Flange
0	Without gasket
1	With gasket

1.2.4 Flanged-end-to-grooved-end adapters. When strainers are furnished with flanged-to-grooved adapters, they are identified by a single alpha character (see table IV).

TABLE IV. Flanged-end-to-grooved-end adapter code letter.

Code letter	Strainer
A	Without adapter
B	With adapter

2. APPLICABLE DOCUMENTS.

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this specification to the extent specified herein. Unless otherwise specified, the issues of these documents shall be those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation (see 6.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

SPECIFICATIONS

FEDERAL

UU-P-268	- Paper, Kraft, Wrapping.
PPP-B-601	- Boxes, Wood, Cleated-Plywood.
PPP-B-621	- Boxes, Wood, Nailed and Lock-Corner.
PPP-B-636	- Boxes, Shipping, Fiberboard.
PPP-F-320	- Fiberboard; Corrugated and Solid, Sheet Stock (Container Grade), and Cut Shapes.
PPP-T-60	- Tape: Packaging, Waterproof.

MILITARY

MIL-P-116	- Preservation, Methods of.
MIL-B-121	- Barrier Material, Greaseproofed, Waterproofed, Flexible.
MIL-T-704	- Treatment and Painting of Materiel.
MIL-S-7916	- Sealing Compound, Thread and Gasket, Fuel, Oil, and Water Resistant.
MIL-P-10388	- Pipe Fittings: One or More Ends Grooved.
MIL-G-12803	- Gasket Material, Non-metallic.
MIL-B-26195	- Boxes, Wood-Cleated, Skidded, Load Bearing Base.
MIL-C-46168	- Coating, Aliphatic Polyurethane, Chemical Agent Resistant.

STANDARDS

FEDERAL

FED-STD-H28	- Screw-Thread Standards for Federal Services.
FED-STD-H28/7	- Screw-Thread Standards for Federal Services Section 7 Pipe Threads, General Purpose.

MILITARY

MIL-STD-105	- Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	- Marking for Shipment and Storage.
MIL-STD-130	- Identification Marking of US Military Property.
MIL-STD-889	- Dissimilar Metals.
MIL-STD-1186	- Cushioning, Anchoring, Bracing, Blocking, and Waterproofing; with Appropriate Test Methods.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from the Naval Publications and Forms Center, (ATTN: NPODS), 5801 Tabor Avenue, Philadelphia, PA 19120-5099.)

2.2 Non-Government publications. The following documents form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DOD adopted are those listed in the issue of the DODISS specified in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents cited in the solicitation (see 6.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

B16.1 - Cast-Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250, and 800 LB.
B16.5 - Pipe Flanges and Flanged Fittings, Steel Nickel Alloy and Other Special Alloys.

(Application for copies should be addressed to the American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.)

AMERICAN PETROLEUM INSTITUTE (API)

5L - Specification for Line Pipe.

(Application for copies should be addressed to the American Petroleum Institute, 1220 L Street NW, Washington, DC 20037.)

(Non-Government standards and other publications are normally available from the organizations which prepare or distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein (except for associated detail specifications, specification sheets or MS standards), the text of this specification shall take precedence. Nothing in this specification, however, shall supersede applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 Description. Each sediment strainer shall consist of a body, a removable strainer basket, and a top cover. All parts shall be securely fastened so as to permit operation in any position.

3.2 First article. Unless otherwise specified (see 6.2), a sample shall be subjected to first article inspection (see 6.3) in accordance with 4.3.

3.3 Material. Material shall be as specified herein. Material not specified shall be selected by the contractor and shall be subject to all provisions of this specification (see 4.1.2).

3.3.1 Material deterioration prevention and control. The strainers shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide protection against the various forms of corrosion and deterioration that may be encountered in any of the applicable operating and storage environments to which the strainers may be exposed.

3.3.1.1 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion. Dissimilar metals and methods of protection are defined and detailed in MIL-STD-889.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

3.3.1.2 Identification of materials and finishes. The contractor shall identify the specific material, material finish or treatment for use with component and subcomponent, and shall make information available on request to the contracting officer or designated representative.

3.3.2 Recovered materials. For the purpose of this requirement, recovered materials are those materials that have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the strainer may be newly fabricated from recovered materials to the maximum extent practicable, provided the strainer produced meets all other requirements of this specification. Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the strainer.

3.4 Strainer body. The strainer body shall be designed to receive a strainer basket in such a position as to permit flow through the basket from inside out.

3.4.1 Ports and plugs. A port with a bronze plug not less than 0.50 inch in diameter shall be in the bottom and the top of the ductile cast iron and steel strainer bodies.

3.5 Threads. All screw-type threads shall be National Pipe Thread (NPT) in accordance with FED-STD-H28 and FED-STD-H28/7.

3.5.1 Thread compound. All port and plug threads shall be coated with a gasket-forming compound in accordance with MIL-S-7916.

3.6 Inlet and outlet connections. The inlet and outlet connections shall be on a common axis through the strainer body.

3.7 Strainer basket. The strainer basket shall be single or double-wall design and shall be constructed so as not to collapse or bulge when subjected to the hydrostatic pressure specified herein and the surging action during operating condition. The strainer basket shall be tested as specified in 4.5.2.1. The complete basket shall be separable from the strainer body.

3.7.1 Screen. The strainer basket screen shall be bronze, brass, type 304 or 316, or monel wire. The open area of the screen shall be not less than 30 percent of its total area.

3.7.2 Effective net open area. The net open area of the strainer basket shall be not less than 300 percent of the cross-sectional area of the inlet opening.

3.7.3 Pullout device. When specified (see 1.2.2), a pullout device shall be attached to the top of the strainer basket. The pullout device shall not interfere with the closure of the top cover or the flow through the installed strainer basket.

3.8 Flange gaskets. When specified (see 1.2.3), two 0.0625-inch thick, full-faced flange gaskets in accordance with MIL-G-12803, type 7, shall be furnished with each flanged strainer.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

3.9 Physical requirements. The physical requirements of the strainers shall be as shown in table V and as specified herein. An "X" indicates the requirement applicable to the respective class strainer. The body composition for the class 125 strainer shall be bronze, ductile cast iron or steel, as specified (see 1.2.2).

TABLE V. Physical requirements.

Requirement	Class				
	125	150	250	300	600
Body composition:					
Bronze	X	-	-	-	-
Ductile cast iron	X	-	X	-	-
Steel	X	X	-	X	-
Other (see 3.9.2)	-	-	-	-	X
Working pressure:					
For water, oil, or gas at 100 °F (38 °C) (psi).	175	275	400	720	1440
Hydrostatic pressure (psi).	270	410	600	1080	2160
Strainer basket mesh or perforation size:					
40, 80, or 130-mesh, as specified (see 1.2.2);	X	X	-	-	-
0.031, 0.062, 0.125, 0.187, 0.250, or 0.375 inch, as specified (see 1.2.2).	-	-	X	X	X
Inlet and outlet connections:					
Internally threaded, bronze only, sizes ranging from 0.75 inch to 2.00 inches, as specified (see 1.2.2).	X	-	-	-	-
Flanged, integral with body or welded to body, faced and drilled in accordance with:					
ANSI B16.1, Class 125, 250.	X	-	X	-	-
ANSI B16.5, Class 150.	-	X	-	-	-
ANSI B16.5, Class 300, 600.	-	-	-	X	-
Grooved ends (see 3.9.2).	-	-	-	-	X
Sizes (nom.) (see 1.2.2):					
3.00 inch	X	X	-	-	-
4.00 inch	X	X	X	X	X
6.00 inch	X	X	X	X	X
8.00 inch	X	X	X	X	X
12.00 inch	X	X	X	X	X

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

3.9.1 Flange-to-groove adapters. When specified (see 1.2.4), two flange-to-groove adapters in accordance with MIL-P-10388, and the same size as the strainer, shall be furnished with the strainer.

3.9.2 Class 600, strainer connections. The class 600 strainer inlet and outlet connections shall be cast integral with or welded to the body and shall have grooved ends as shown on figure 1. Welded connections shall be seamless, electric or lap-welded pipe in accordance with API 5L, as shown in table VI.

TABLE VI. Line pipe.

Nominal size	Nominal outside diameter	Nominal plain end weight
Inches	Inches	Lb/ft
4	4.500	10.00 or 10.79
6	6.625	14.97 or 18.97
8	8.625	22.36 or 28.55
12	12.750	34.45 or 41.51

3.10 Dimensions. Dimensions and tolerances for metal fits shall be in accordance with the limits specified herein.

3.10.1 Class 125, 150, 250, and 300. When specified with flange-to-groove adapters, strainers shall not exceed 36.00 inches ±0.25 inch in overall length when used with 4.00-inch and 6.00-inch size connections; 48.00 inches ±0.25 inch in overall length when used with 8.00-inch and 12.00-inch size connections.

3.10.2 Class 600. The strainer, face to face of flange shall not exceed: 36.00 inches ±0.25 inch in overall length when used with 4.00-inch and 6.00-inch sized connections; 48.00 inches ±0.25 inch in overall length when used with 8.00-inch and 12.00-inch size connections.

3.11 Treatment and painting. The portions of the strainer normally painted externally shall be cleaned, treated, and painted in accordance with MIL-T-704, type F or G, as applicable. Unless otherwise specified (see 6.2), top coat color shall be camouflage green 383 in accordance with MIL-C-46168.

3.12 Identification marking. Each strainer shall be identified in accordance with MIL-STD-130 and shall include the part or identifying number (PIN) (see 6.5). In addition, an arrow or the words "INLET" and "OUTLET" indicating the direction of flow shall be stamped, cast, or permanently marked on the strainer body near the respective connections.

3.13 Workmanship.

3.13.1 Castings and forgings. All parts, components, and assemblies of the unit which include castings and forgings shall be clean of harmful extraneous material such as sand, dirt, sprues, scale, and flux. Rework shall be limited to proce- -es which do not reduce mechanical properties or affect function.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

3.13.2 Metal fabrication. Metal used in fabrication shall be free from kinks and sharp bends. The straightening of material shall be done by methods that will not cause injury to the material. Corners shall be square and true. Flame-cutting, using tips suitable for the thickness of the steel, may be employed instead of shearing and sawing. All bends shall be made with controlled means to ensure uniformity of size and shape. Precautions shall be taken to avoid overheating. Heated steel shall be allowed to cool slowly. External surfaces shall be free from burrs, sharp edges, and corners, except when sharp edges or corners are required or where they are not detrimental to safety.

3.13.3 Welding. The surfaces of parts to be welded shall be free from rust, scale, paint, grease, mill scale and other foreign matter that can be removed by chipping and wire brushing. Parent materials, weld filler metals, and fabrication techniques shall be as required to enable the strainer to be in accordance with the examination and test requirements specified in section 4. Parts to be joined by fillet welds shall be brought into as close contact as possible and in no event shall be separated by more than 0.187 inch.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of assuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling in quality conformance does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.1.2 Component and material inspection. The contractor is responsible for ensuring that components and materials used are manufactured, examined and tested in accordance with referenced specifications and standards, as applicable.

4.2 Classification of inspections. Inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.3).

b. Quality conformance inspection (see 4.4).

c. Inspection of packaging (see 4.6).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

4.3 First article inspection.

4.3.1 First article examination. The first article shall be examined in accordance with 4.5.1. The presence of one or more defects shall be cause for rejection.

4.3.2 Test. The first article shall be tested as specified in 4.5.2.1. Failure of this test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1.

4.4.3 Test. Each strainer shall be tested as specified in 4.5.2.1. Failure of this test shall be cause for rejection.

4.5 Inspection procedure.

4.5.1 Examination. The strainer shall be examined as specified herein for the following defects:

TABLE VII. Examination schedule.

Number	Defect	Requirement paragraph
Major		
101.	Components missing or not as specified.	3.1
102.	First article not as specified.	3.2
103.	Material not as specified.	3.3
104.	Material deterioration prevention and control not as specified.	3.3.1
105.	Dissimilar metals not protected against galvanic corrosion as specified.	3.3.1.1
106.	Identification of materials and finishes not as specified.	3.3.1.2
107.	Recovered materials not as specified.	3.3.2
108.	Strainer body not as specified.	3.4
109.	Ports and plugs missing or not as specified.	3.4.1
110.	Threads not as specified.	3.5
111.	Inlet and outlet connections not as specified.	3.6
112.	Strainer basket not separable.	3.7
113.	Strainer basket screen and net open area not as specified.	3.7.1, 3.7.2

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

TABLE VII. Examination schedule - Continued.

Number	Defect	Requirement paragraph
114.	Pullout device not as specified.	3.7.3
115.	Flange gaskets missing or not as specified.	3.8
116.	Physical requirements not as specified.	3.9
117.	Flange-to-groove adapters missing or not as specified.	3.9.1
118.	Flange not integral with or welded to strainer body and connections not as specified.	3.9.2
119.	Dimensions not as specified.	3.10, 3.10.1, 3.10.2
120.	Castings and forgings not as specified.	3.13.1
121.	Metal fabrication not as specified.	3.13.2
122.	Welding not as specified.	3.13.3
Minor		
201.	Thread compound missing or not as specified.	3.5.1
202.	Treatment and painting not as specified.	3.11
203.	Paint color not as specified.	3.11
204.	Marking not as specified.	3.12

4.5.2 Test.

4.5.2.1 Hydrostatic pressure. The entire strainer shall be subjected to the hydrostatic pressure specified in table V for a period of 15 minutes. Water leakage, sweating, or visible deformation of the strainer at any point on its surface shall constitute failure of this test. Before pressure is released, the downstream closure of the strainer shall be suddenly opened. Remove the top cover and examine the strainer basket. Evidence of collapse, bulging, or indication that the strainer basket is not secure in the strainer body shall constitute failure of this test.

4.6 Inspection of packaging.

4.6.1 Quality conformance inspection of packaging.

4.6.1.1 Unit of product. For the purpose of inspection, a completed pack prepared for shipment shall be considered a unit of product.

4.6.1.2 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.6.1.3 Examination. Samples selected in accordance with 4.6.1.2 shall be examined for the following defects.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

123. Metal surfaces requiring a contact preservative not coated with preservative for level A.
124. Openings not sealed as specified for level A.
125. Flange gaskets not preserved as specified for level A.
126. Packing not as specified for level A, B, or C.
127. Strapping not as specified for level A.
128. Marking illegible, incorrect, incomplete, or missing.

5. PACKAGING

5.1 Preservation. Each strainer shall be preserved for level A in the following manner:

5.1.1 Strainers. Metal surfaces of the strainers requiring the application of a contact preservative, in accordance with MIL-P-116, shall be preserved as follows: interior surfaces shall be coated with P-10, grade 30 or P-7 preservative. Exterior surfaces shall be coated with P-1 preservative. The preservatives shall be in accordance with and be applied in accordance with MIL-P-116.

5.1.2 Openings. All openings shall be covered with barrier material in accordance with MIL-B-121, type I, grade A, class 2 and sealed to the fitting with tape in accordance with PPP-T-60, type IV. Fittings with exposed land sealing surfaces shall have these surfaces wrapped with the aforementioned barrier material and tape as shown in figure 2 prior to covering the end opening.

5.1.3 Flange gaskets. When furnished, flange gaskets shall be preserved in accordance with MIL-P-116, method IC-1. The gaskets shall be interleaved with paper in accordance with UU-P-268, and shall be placed between two sheets of fiberboard in accordance with PPP-F-320, type CF, class domestic, variety SW, grade optional. The dimensions of the fiberboard shall be 1 inch greater than that of the enclosed gaskets. The fiberboard sheet shall be secured together in a manner to prevent protrusion of the gaskets.

5.2 Packing. Packing shall be level A, level B, or level C as specified (see 6.2).

5.2.1 Level A. The strainers, with flange gaskets when furnished, shall be packed in close-fitting boxes in accordance with PPP-B-601, overseas type or PPP-B-621, class 2. When the contents exceed 1000 lbs, a box in accordance with MIL-B-26195, type II, with rubbing strips shall be used. Blocking, bracing and anchoring shall be in accordance with MIL-STD-1186. Strapping shall be in accordance with the applicable box specification.

5.2.2 Level B. Packing shall be as specified in 5.2.1 for level A except the boxes shall be domestic type or in accordance with PPP-B-636, grade V3c. Fiberboard boxes shall be closed by method V of the appendix to the box specification.

5.2.3 Level C. The strainers, with flange gaskets when furnished, shall be packed as specified for level B except the boxes shall be domestic type or in accordance with PPP-B-636. If the contents exceed the weight limitations of the PPP-B-636 box, a wood container shall be utilized that will prevent damage to the contents during shipment.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

5.3 Marking. In addition to any special markings specified by the contract or purchase order, (see 6.2), marking shall be in accordance with MIL-STD-129.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The strainers are intended for use in petroleum pipelines in front of meters, pumps, and other pipeline equipment to remove sludge and debris.

6.2 Ordering data.

6.2.1 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of this specification.

b. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).

c. PIN number required (see 6.5).

d. Timeframe required for submission of first article approval and the number of units to be furnished (see 3.2).

e. Color required when other than as specified (see 3.11).

f. Level of packing required (see 5.2).

g. Any special marking (see 5.3).


6.3 First article. When a first article inspection is required, the item(s) should be a preproduction model. The first article should consist of one or more units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of the first article test results and disposition of the first articles. Invitation for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.4 Subject term (key word) listing.

Strainers.
Strainers, sediment.
Strainers, basket type.
Strainers, pipeline, basket type.
Strainers, sediment, basket type.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

6.5 Part or identifying number (PIN). Strainers covered by this specification shall be designated in the following form (see 3.12 and 6.2):

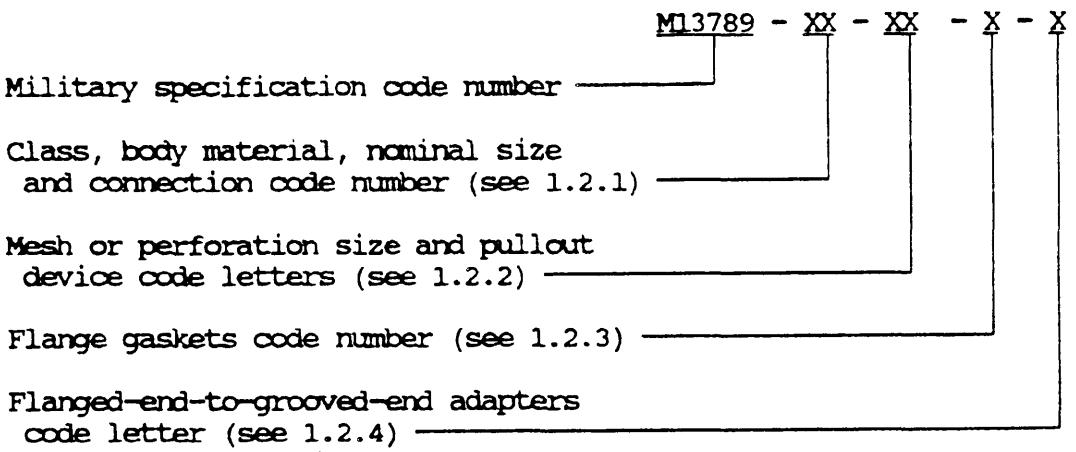

6.6 Changes from previous issue. Asterisks or vertical lines are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Custodians:
Army-ME
Navy-YD


Review activity:
DLA-CS

User activities:
Army-CE
Navy-CG

Preparing activity:
Army-ME

(Project 4730-0696)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T02:20Z
Check the source to verify that this is the current version before use.

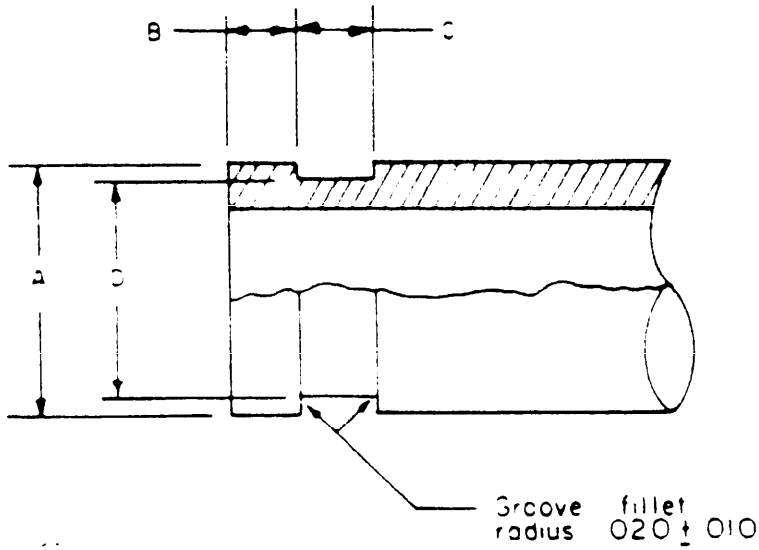


Nom. pipe size	Groove dimensions (inches)			
	A	B	C	D
4	4.500 +.031 −.016	0.625 ± .031	0.375 ± .031	4.334 +.000 −.020
6	6.625 +.031 −.016	0.625 ± .031	0.375 ± .031	6.455 +.000 −.022
8	8.625 +.031 −.016	0.750 ± .031	0.437 ± .031	8.441 +.000 −.025
12	12.750 +.047 −.031	0.750 ± .031	0.500 ± .031	12.531 +.000 −.030
14	14.000 +.047 −.031	0.937 ± .031	0.500 ± .031	13.781 +.000 −.030

FIGURE 1. Dimensions for grooved ends.

X-874

Source: https://assist.dla.mil -- Downloaded: 202610-18T02:20Z
Check the source to verify that this is the current version before use.

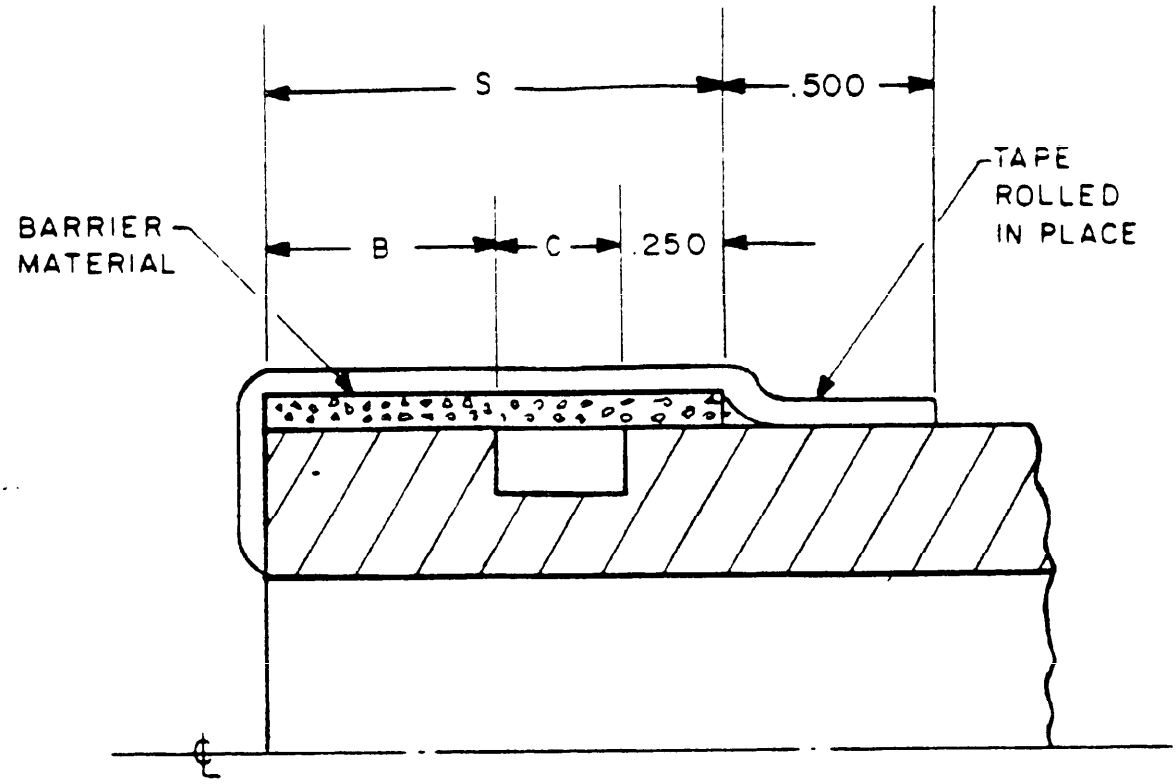

S ——— LAND SEALING SURFACE

B ——— LAND

C ——— GROOVE

FIGURE 2. Land sealing surface for grooved end pipe, tube end fittings.

X-449B

Source: https://assist.dla.mil -- Downloaded: 202610-18T02:20Z
Check the source to verify that this is the currentversion before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	1. DOCUMENT NUMBER	2. DOCUMENT DATE (YYMMDD)
	MIL-S-13789D	90-01-31

3. DOCUMENT TITLE
Strainers, Sediment: Pipeline, Basket Type

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME (Last, First, Middle Initial)	b. ORGANIZATION	
c. ADDRESS (Include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (2) AUTOVON (If applicable)	7. DATE SUBMITTED (YYMMDD)

8. PREPARING ACTIVITY

a. NAME	b. TELEPHONE (Include Area Code) (1) Commercial	(2) AUTOVON
	(703) 664-5717	354-5717
c. ADDRESS (Include Zip Code) US Army Belvoir RDE Center ATTN: STRBE-TSE Ft. Belvoir, VA 22060-5606	IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT: Defense Quality and Standardization Office 5203 Leesburg Pike, Suite 1403, Falls Church, VA 22041-3466 Telephone (703) 756-2340	AUTOVON 289-2340

Source: https://assist.dla.mil -- Downloaded: 2020-10-10T02:202
Check the source to verify that this is the current version before use.